

Technical Evaluation Report™

TER 1506-01

BASF HP+™ Wall XR Series – Limit States Design


BASF Corporation

**Product:
BASF HP+™ Wall XR Series
Utilizing WALLTITE® CM01 SPF
in Combination with Neopor®
FPIS and Horizontal Girts**

Issue Date:
October 21, 2015

Revision Date:
December 11, 2023

Subject to Renewal:
January 1, 2025



Use the QR code to access the most recent version or a sealed copy of this Technical Evaluation Report (TER) at drjcertification.org.



COMPANY
INFORMATION:

ADDITIONAL
LISTEES:

BASF Corporation
100 Park Ave
Florham Park, NJ 07932-1089

P: 973-245-6000

www.basf.com

DIVISION: 06 00 00 - WOOD, PLASTICS AND COMPOSITES

SECTION: 06 12 00 - Structural Panels

SECTION: 06 12 19 - Shear Wall Panels

SECTION: 06 16 00 - Sheathing

DIVISION: 07 00 00 - THERMAL AND MOISTURE PROTECTION

SECTION: 07 21 00 - Thermal Insulation

SECTION: 07 25 00 - Water-Resistive Barriers/Weather Barriers

1 Innovative Product Evaluated¹

- 1.1 BASF HP+™ Wall XR Series Utilizing WALLTITE® CM01 SPF in Combination with Neopor® FPIS and Horizontal Girts

2 Applicable Codes and Standards²

2.1 Codes

- 2.1.1 *NBC—10, 15, 20: National Building Code of Canada*
2.1.2 *NECB—17, 20: National Energy Code of Canada for Buildings*
2.1.3 *O Reg. 332/12: Ontario Building Code (OBC)*³

2.2 Standards and Referenced Documents

- 2.2.1 *ASTM C518: Standard Test Method for Steady-State Thermal Transmission Properties by Means of the Heat Flow Meter Apparatus*
2.2.2 *ASTM C578: Standard Specification for Rigid, Cellular Polystyrene Thermal Insulation*
2.2.3 *ASTM D1622: Standard Test Method for Apparent Density of Rigid Cellular Plastics*
2.2.4 *ASTM D1623: Standard Test Method for Tensile and Tensile Adhesion Properties of Rigid Cellular Plastics*
2.2.5 *ASTM D2126: Standard Test Method for Response of Rigid Cellular Plastics to Thermal and Humid Aging*
2.2.6 *ASTM D2842: Standard Test Method for Water Absorption of Rigid Cellular Plastics*
2.2.7 *ASTM D6226: Standard Test Method for Open Cell Content of Rigid Cellular Plastics*
2.2.8 *ASTM E72: Standard Test Methods of Conducting Strength Tests of Panels for Building Construction*
2.2.9 *ASTM E283: Standard Test Method for Determining Rate of Air Leakage Through Exterior Windows, Curtain Walls, and Doors Under Specified Pressure Differences Across the Specimen*
2.2.10 *ASTM E330: Standard Test Method for Structural Performance of Exterior Windows, Doors, Skylights, and Curtain Walls by Uniform Static Air Pressure Difference*

¹ For more information, visit drjcertification.org or call us at 608-310-6748.

² Unless otherwise noted, all references in this TER are from the 2020 version of the NBC. This alternative solution is also approved for use with the 2010 and 2015 NBC and the standards referenced therein.

³ References in this TER to the National Building Code of Canada (NBC) apply to the Ontario Building Code (OBC), unless noted otherwise.

- 2.2.11 *ASTM E564: Standard Practice for Static Load Test for Shear Resistance of Framed Walls for Buildings*
- 2.2.12 *ASTM E2126: Standard Test Methods for Cyclic (Reversed) Load Test for Shear Resistance of Vertical Elements of the Lateral Force Resisting Systems for Buildings*
- 2.2.13 *ASTM E2178: Standard Test Method for Air Permeance of Building Materials*
- 2.2.14 *CAN/ULC-S102.2: Test for Surface Burning Characteristics of Flooring, Floor Coverings, and Miscellaneous Materials and Assemblies*
- 2.2.15 *CAN/ULC-S701: Standard for Thermal Insulation, Polystyrene, Boards, and Pipe Covering*
- 2.2.16 *CAN/ULC-S705.1: Standard for Thermal Insulation - Spray Applied Rigid Polyurethane Foam, Medium Density - Material Specification*
- 2.2.17 *CSA O86-19: Engineering Design in Wood*
- 2.2.18 *CWC: Engineering Guide for Wood Frame Construction 2014 Edition*

3 Performance Evaluation

- 3.1 Testing and related engineering evaluations are defined as intellectual property and/or trade secrets.⁴
- 3.2 Engineering evaluations are conducted within DrJ's ANAB accredited ICS code scope, which are also its areas of professional engineering competence.⁵
- 3.3 BASF HP+™ Wall XR Series was evaluated to determine:
 - 3.3.1 Structural performance under lateral-load conditions in accordance with:
 - 3.3.1.1 NBC Division B Subsection 9.23.13 Bracing to Resist Lateral Loads Due to Wind and Earthquake
 - 3.3.1.2 NBC Section 4.1 Structural Loads and Procedures and the Engineering Guide for Wood Frame Construction
 - 3.3.2 Structural performance under uplift and gravity loads for use with single top plates in accordance with NBC Division B Article 9.23.11.3.
 - 3.3.3 Structural performance under transverse-load conditions for use to resist factored external wind loads in accordance with NBC Division B Subsection 9.23.13.
 - 3.3.4 Continuous insulated sheathing requirements complying with the provisions NBC Division B Part 5 and Subsection 9.25.2.
 - 3.3.5 Performance for use as a component of the air barrier in accordance with NBC Division B Section 5.4 and Subsection 9.25.3.
 - 3.3.6 Flame-spread rating and smoke-developed classification complying with the provisions of NBC Division B Subsection 3.1.12.
- 3.4 Performance of BASF HP+™ Wall XR Series or any of its component materials for use as a Water-Resistive Barrier (WRB) assembly or WRB material is outside the scope of this evaluation.
- 3.5 Performance of BASF HP+™ Wall XR Series or any of its component materials as used in the normal construction process is outside the scope of this TER.
 - 3.5.1 This includes storage, weather conditions, durability considerations, handling, installing, restraining, and bracing of BASF HP+™ Wall XR Series through the shipping, storing, and construction means and methods process.

⁴ 18 U.S. Code § 1831 - Economic espionage - Whoever, intending or knowing that the offense will benefit any foreign government, foreign instrumentality, or foreign agent, knowingly steals, or without authorization appropriates, takes, carries away, or conceals, or by fraud, artifice, or deception obtains a trade secret shall be fined not more than \$5,000,000 or imprisoned not more than 15 years, or both. Any organization that commits any offense described shall be fined not more than the greater of \$10,000,000 or 3 times the value of the stolen trade secret to the organization, including expenses for research and design and other costs of reproducing the trade secret that the organization has thereby avoided.
<https://www.law.cornell.edu/uscode/text/18/part-II/chapter-90>.

⁵ ANAB is part of the USMCA and IAF MLA, where the purpose of these agreements are to ensure mutual recognition of accredited certification and validation/verification statements between agreement signatories, and subsequent acceptance of ANAB accredited certification and validation/verification statements by professional engineers based upon having one universal approval process for the timely approval of innovative materials, products, designs, services, assemblies and/or methods of construction.

- 3.6 Use of BASF HP+™ Wall XR Series in a portal frame is outside the scope of this evaluation.
- 3.7 Any engineering evaluation conducted for this TER was performed on the dates provided in this TER and within DrJ's professional scope of work.
- 3.8 Kevin Below, P. Eng., has collaborated with DrJ through the review of this technical evaluation report.
- 3.9 Any regulation specific issues not addressed in this section are outside the scope of this TER.

4 Product Description and Materials

- 4.1 BASF HP+™ Wall XR Series is a proprietary wall system consisting of WALLTITE® CM01 Spray Polyurethane Foam (SPF) combined with Neopor® Foam Plastic Insulating Sheathing (FPIS), and horizontal Z-bar girts (or hat-channel furring, also called Omega bars) installed on wood studs.
- 4.2 The BASF HP+™ Wall XR Series described in this TER contains a combination of the following materials:
 - 4.2.1 WALLTITE® CM01 SPF – 64 mm or 76 mm.
 - 4.2.2 *Neopor® FPIS – Minimum Thickness: 25 mm or 51 mm:*
 - 4.2.2.1 Field: fastened with minimum No. 7 screw with plastic cap spaced at 300 mm o.c. into horizontal Z-bar girts.
 - 4.2.2.2 Top and bottom of each panel: fastened with 3.3 mm x 89 mm nails at 150 mm o.c., directly into the 2x6 plates (See Section 4.2.4.3).
 - 4.2.3 *Horizontal Z-bar Girts:*
 - 4.2.3.1 51 mm x 51 mm, galvanized G60 (0.60 oz/square foot), 20-gauge, at 600 mm o.c.
 - 4.2.3.2 Fastened to framing with one of the following:
 - 4.2.3.2.1 Minimum 3.3 mm x 63 mm ring-shank nail.
 - 4.2.3.2.2 Minimum No. 8, 4.2 mm dia. x 51 mm wood screw.
 - 4.2.3.3 Two fasteners per stud.
 - 4.2.4 *2x Wood Framing:*
 - 4.2.4.1 2x4 studs (38 x 89 mm), Stud-grade S-P-F or better.
 - 4.2.4.2 Each stud fastened to top and bottom plates with three (3) 3.3 mm x 83 mm nails.
 - 4.2.4.3 2x6 top (single or double) and bottom plates – No. 2 S-P-F or better.
 - 4.2.5 As an alternative to Section 4.2.3, hat-channel furring (also called Omega bars) up to 51 mm in depth, galvanized G60, 20-gauge, at 600 mm o.c.
 - 4.2.5.1 Each side of channel fastened to framing with one of the following:
 - 4.2.5.1.1 Minimum 3.3 mm x 63 mm ring-shank nail.
 - 4.2.5.1.2 Minimum No. 8, 4.2 mm x 51 mm wood screw.
 - 4.2.5.2 Two fasteners per stud.

- 4.2.6 As an alternative to Section **4.2.3**, with rough-cut or sawn wood studs measuring 44 mm x 95 mm, rough cut or sawn wood timber girts measuring 44 mm x 95 mm at 600 mm o.c. may be fastened horizontally to studs with two 3.3 mm x 83 mm nails at each stud / girt intersection. Total thickness of the stud (89 mm) and girt (44 mm) is 133 mm.
- 4.2.7 As an alternative to Section **4.2.3**, with nominal 2x4 studs (38 x 89 mm), rough-cut or sawn wood timber girts measuring a full 51 mm x 102 mm at 600 mm o.c. may be fastened horizontally to studs with two 3.3 mm x 83 mm nails at each stud / girt intersection. Total thickness of the stud (89 mm) and girt (38 mm) is 127 mm.
- 4.2.8 As an alternative to Section **4.2.3**, nominal 2x4 (38 x 89 mm) finished timber girts may be installed horizontally at 600 mm o.c. with 12.7 mm plywood strips (minimum 89 mm wide) fastened to framing with two 3.3 mm x 83 mm nails at each stud / girt intersection. Total thickness of the stud (89 mm) and girt (51 mm) is 140 mm.

5 Applications

- 5.1 BASF HP+™ Wall XR Series is used in buildings constructed in accordance with NBC Division B Section 9.23 for wood frame construction. BASF HP+™ Wall XR Series is used to provide:
 - 5.1.1 Lateral-load resistance (wind and seismic) for braced BASF HP+™ Wall XR Series panels used in wood frame construction.
 - 5.1.2 Transverse-load resistance for braced BASF HP+™ Wall XR Series panels used in wood frame construction.
 - 5.1.3 Resistance to uplift and gravity loads in single-top-plate applications for BASF HP+™ Wall XR Series assemblies used in wood frame construction in accordance with NBC Division B Article 9.23.11.3.
- 5.2 BASF HP+™ Wall XR Series is used to provide thermal resistance in the exterior wall of the building thermal envelope in accordance with NBC Division B Subsections 5.3.1 and 9.25.2.
- 5.3 BASF HP+™ Wall XR Series is used to provide resistance to air leakage in the exterior wall of the building envelope in accordance with OBC Division B Section 5.4 and Subsection 9.25.3.
- 5.4 BASF HP+™ Wall XR Series may be used in buildings designed in accordance with NBC Division B Section 4.1 Structural Loads and Procedures or the Engineering Guide for Wood Frame Construction.
- 5.5 *Structural Applications*
 - 5.5.1 Except as otherwise described in this TER, BASF HP+™ Wall XR Series shall be installed in accordance with the applicable building codes listed in Section **2** using the provisions set forth herein for the design and installation of Wood Structural Panels (WSP) and with this TER.
 - 5.5.2 BASF HP+™ Wall XR Series is permitted to be designed in accordance with NBC Division B Part 9, Articles 9.23.13.1, 9.23.13.2, and 9.23.13.3 for the design of lateral-load-resisting systems using the methods and conditions set forth therein for equivalence to the sheathing requirements in Tables 9.23.13.6 and 9.23.17.2.-A as follows:
 - 5.5.2.1 Equivalent to 12.7 mm sheathing using fasteners conforming to Table 9.23.3.1, sentence A 9.23.3.1.(2), and Table 9.23.3.5.-A, -B, or -C as appropriate and with a minimum penetration of 41 mm into framing, spaced at 150 mm o.c. along edges and at 300 mm o.c. in the field, on framing spaced at a maximum of 600 mm o.c., except as specifically allowed in this TER.

- 5.5.3 Anchorage for in-plane shear shall be provided to transfer the induced shear force into and out of each shear wall in accordance with NBC Division B Subsection 9.23.6.
- 5.5.3.1 For buildings with two or more floors supported by frame walls that are in areas where the seismic spectral response acceleration, $S_a(0.2)$, is not greater than 0.70 or where the 1-in-50 hourly wind pressure is equal to or greater than 0.80 kPa but not greater than 1.20 kPa, two anchor bolts per braced wall panel are required.
- 5.5.3.1.1 Anchor bolts shall have a diameter not less than 15.9 mm, be located within 0.5 m of the end of the foundation, and be spaced not more than 2.4 m o.c., or
- 5.5.3.1.2 Anchor bolts shall have a diameter not less than 12.7 mm, be located within 0.5 m of the end of the foundation, and be spaced not more than 1.7 m o.c.
- 5.5.3.2 For buildings supported by frame walls that are in areas where the seismic spectral response acceleration, $S_a(0.2)$, is greater than 0.70 but not greater than 1.8 and the 1-in-50 hourly wind pressure is not greater than 1.20 kPa, two anchor bolts per braced wall panel are required and spaced in accordance with Table 9.23.6.1.
- 5.5.3.3 Where the seismic spectral response acceleration, $S_a(0.2)$, is greater than 1.8 or the 1-in-50 hourly wind pressure is equal to or greater than 1.2 kPa, anchorage shall be designed according to Part 4.
- 5.5.4 The maximum aspect ratio for full-height BASF HP+™ Wall XR Series braced wall segments shall be 4:1.
- 5.5.5 The minimum full-height panel width shall be 600 mm. Panels may be installed vertically or horizontally.
- 5.5.6 Neopor® panel top and bottom edges shall be attached to the top and bottom plates of a minimum thickness of 38 mm. Abutting panel edges shall be generally centered on the framing member.
- 5.5.7 Installation is permitted for single-top-plate or double-top-plate applications in accordance with NBC Division B Article 9.23.11.3 where concentrated loads from ceilings, floors, and roofs are not more than 50 mm to one side of the studs.
- 5.5.8 Where the application exceeds the limitations set forth herein, design shall be permitted in accordance with accepted engineering procedures, experience, and technical judgment.
- 5.6 *Acceptable Solutions in Accordance with NBC Division B Part 9 Bracing Applications*
- 5.6.1 BASF HP+™ Wall XR Series may be used to brace walls of buildings as an equivalent to OSB, O-2 Grade in NBC Division B Table 9.23.13.6 Minimum Thicknesses of Cladding, Sheathing or Interior Finish for Braced Wall Panels as follows:
- 5.6.1.1 Supports at 400 mm o.c.: 11 mm minimum sheathing thickness.
- 5.6.1.2 Supports at 600 mm o.c.: 12.5 mm minimum sheathing thickness.
- 5.6.2 Where a building, or portion thereof, does not comply with one or more of the bracing requirements within the acceptable solutions of NBC Part 9, those portions shall be designed and constructed in accordance with NBC Division B Part 4 Structural Loads and Procedures or the Engineering Guide for Wood Frame Construction in accordance with NBC Division B Sentences 9.23.13.1. 2)(b)(ii & iii) as one of the following:
- 5.6.2.1 As an equivalent to OSB, O-1 or O-2 Grades in NBC Division B Table 9.23.13.6, with supports at 400 mm o.c.: 11 mm minimum sheathing thickness using fasteners conforming to Table 9.23.3.1, sentence A-9.23.3.1.(2), and Table 9.23.3.5.-A, -B, or -C as appropriate and with a minimum penetration of 41 mm into framing, spaced 150 mm o.c. along edges and 300 mm o.c. in field.
- 5.6.2.2 As an equivalent to OSB, O-1 or O-2 Grades in NBC Division B Table 9.23.13.6, with supports at 600 mm o.c.: 12.5 mm minimum sheathing thickness using fasteners conforming to Table 9.23.3.1, sentence A-9.23.3.1.(2), and Table 9.23.3.5.-A, -B, or -C as appropriate and with a minimum penetration of 41 mm into framing, spaced 150 mm o.c. along edges and 300 mm o.c. in field.
- 5.6.2.3 Using the design values given in **Table 1**.

Table 1. Shear Resistance (Limit States Design) for BASF HP+™ Wall XR Series – Wind or Seismic^{1,4,6}

Wall Assembly	Type of Girt	Max. Stud Spacing, mm	Interior Gypsum Wallboard ³ Minimum Thickness, mm	Maximum Gypsum Board Fastener ² Spacing (edge/field), mm	Specified Shear Strength, kN/m	Ductility Factor, $R_d^{5,6}$	Overstrength Factor, R_o
51 mm Neopor® + 76 mm SPF	Z-bar or Hat Channel	400	None	N/A	6.7	2.0	1.7
51 mm Neopor® + 64 mm SPF		400	12.7	300 / 300	6.9	3.0	1.7
51 mm Neopor® + 76 mm SPF		400	12.7	300 / 300	7.0	3.0	1.7
29 mm Neopor® + 64 mm SPF		400	12.7	300 / 300	6.3	3.0	1.7
25 mm Neopor® + 64 mm SPF		400	12.7	300 / 300	6.2	3.0	1.7
51 mm Neopor® + 64 mm SPF		600	None	N/A	5.7	2.0	1.7
51 mm Neopor® + 64 mm SPF		600	12.7	300 / 300	6.6	2.5	1.7
51 mm Neopor® + 51 mm SPF		400	None	N/A	6.67	2.5	1.7
51 mm Neopor® + 51 mm SPF	Timber (Section 4.2.6 through Section 4.2.8)	400	None	N/A	6.88	1.5	1.7

1. BASF HP+™ Wall XR Series fastening per Section 4.2 and Section 6.

2. Interior gypsum wallboard attached to framing with minimum 2.14 mm nail or #6 Type W screw fasteners. Minimum penetration of nails or screws into framing is 19 mm. Fastener spacing shall be as required above.

3. NBC Table 9.23.13.6 requires 15.9 mm thick gypsum with framing 600 mm o.c.

4. Building Height Limitations Above Grade:

- $I_e F_a S_a(0.2) < 0.2$ – No Limit
- $0.2 \leq I_e F_a S_a(0.2) < 0.35$ – No Limit
- $I_e F_a S_a(0.2) \geq 0.35$ – 20 m
- $I_e F_a S_a(1.0) > 0.3$ – 20 m

5. Response modification coefficient, R_d , for use throughout the NBC.

6. For combinations of different types of SFRS acting in the same direction in the same storey, $R_d R_o$ shall be taken as the lowest value of $R_d R_o$ corresponding to these systems. See NBC Division B Article 4.1.8.9.

5.7 Axial Loading

- 5.7.1 BASF HP+™ Wall XR Series will perform the same as corresponding equivalent prescriptive wall assemblies.
- 5.7.2 Designs shall have a load path capable of transferring loads from their point of origin to their final point of resistance in accordance with NBC Division C Sentence 2.2.4.3(1).

5.8 Transverse Wind Loading

- 5.8.1 BASF HP+™ Wall XR Series installed over exterior framing spaced at a maximum of 600 mm o.c. without an interior covering can resist specified wind loads as shown in **Table 2**. Hourly wind pressures (1-in-50) to be resisted are found in NBC Division B, Appendix C, Table C-2, for selected locations.

Table 2. Specified Wind Pressure^{1,2}

Wall Assembly	Maximum Stud Spacing, mm	Hourly 1-in-50 Wind Pressure, kPa
BASF HP+™ Wall XR Series with 38 mm SPF + 33 mm Neopor®	600 o.c.	2.8
<p>1. Neopor® attached to Z-bar girt at 300 mm o.c. and to top and bottom plates with 3.3 mm x 89 mm nails at 150 mm o.c. The attachment of the sheathing to the framing is primarily through the adhesion of the SPF to the framing and Neopor® sheathing.</p> <p>2. Hourly Wind Pressure (1 in 50) for selected locations can be found in NBC Division B, Appendix C, Table C-2</p>		

5.9 Thermal Resistance

- 5.9.1 BASF HP+™ Wall XR Series meets the continuous insulated sheathing requirements complying with the provisions of NBC Division B Subsection 9.36.2.5.
- 5.9.2 BASF HP+™ Wall XR Series components have the thermal resistances shown in **Table 3**.

Table 3. Thermal Resistance Properties

Product	Thickness, mm	RSI / R-Value, m ² *K/W (h ² *ft ² *°F/Btu)
Neopor®	28	0.88 (5.0)
	51	1.55 (8.8)
WALLTITE® CM01	63	2.78 (15.8)
	76	3.38 (19.2)
SI: 1 m ² *K/W = 5.678 hr ² *ft ² *°F/Btu		

5.10 Air Barrier

- 5.10.1 BASF HP+™ Wall XR Series components have the air-permeance properties shown in **Table 4** in accordance with NBC Division B Article 5.4.1.2 and Subsection 9.25.3.

Table 4. Air-Barrier Properties

Product	Air Permeance [L/(s*m ²)]
WALLTITE® CM01	≤ 0.02
1. Tested in accordance with the Technical Guide for Air Barrier Systems for Exterior Walls of Low-Rise Buildings (CCMC Evaluation Report 13467-R).	

5.11 Surface Burn

5.11.1 BASF HP+™ Wall XR Series panels have the surface-burn characteristics shown in **Table 5**.

Table 5. Flame-Spread Characteristics

Product	Flame-Spread Rating
WALLTITE® CM01	≤ 500
1. Tested in accordance with CAN/ULC-S102 including CAN/ULC-S127.	

5.12 Thermal-Barrier Requirements

5.12.1 Foam plastics that form part of a wall or ceiling assembly in combustible construction shall be protected from adjacent spaces in the building, other than adjacent concealed spaces within attic or roof spaces, crawl spaces, and wall assemblies by an approved thermal barrier as required by NBC Division B Article 3.1.4.2 and 9.10.17.10.

5.13 Where the application falls outside of the performance evaluation, conditions of use and/or installation requirements set forth herein, alternative techniques shall be permitted in accordance with accepted engineering practice and experience. This includes but is not limited to the following areas of engineering: mechanics or materials, structural, building science and fire science.

6 Installation

6.1 Installation shall comply with the manufacturer installation instructions, this TER, the approved construction documents, and the applicable building code.

6.2 In the event of a conflict between the manufacturer installation instructions this TER and the applicable building code, the more restrictive shall govern.

6.3 WALLTITE® CM01 must be installed in accordance with standard CAN/ULC-S705.2, Canadian Construction Materials Centre (CCMC) listing 13588-L, and BASF Canada's Quality Assurance and Training Program (QATP) manual by installers licensed through the QATP and certified by Caliber Quality Solutions.

6.4 A copy of the manufacturer published installation instructions shall be available at all times on the jobsite during installation.

6.5 BASF HP+™ Wall XR Series Z-bar girts or hat-channel furring (also called Omega bars) must be installed over studs, with framing that has a width of not less than 38 mm and is spaced at a maximum of 600 mm o.c.

6.6 Where gypsum wallboard is required, it shall have a minimum thickness of 12.7 mm.

6.7 Orientation

6.7.1 BASF HP+™ Wall XR Series sheathing panels must be installed vertically with the long dimension of the panels parallel to the framing behind and perpendicular to the Z-bar girts or hat-channel furring (also called Omega bars).

6.8 Fasteners

6.8.1 Neopor®:

6.8.1.1 No. 7 (0.151" dia.) screws with plastic cap. Screw must be long enough to penetrate Neopor® sheathing and Z-bar girt or hat-channel furring, plus three threads.

6.8.1.2 Top / Bottom (at the 2x6 plates): 3.3 mm x 89 mm nail with a minimum penetration of 38 mm into framing.

6.8.2 Z-Bar Girt or Hat-Channel Furring:

6.8.2.1 Minimum 3.3 mm x 63 mm ring-shank nail.

6.8.2.2 Minimum No. 8 (0.164") x 51 mm wood screw.

6.8.2.3 Two (2) fasteners into each framing member.

6.8.3 *Rough-Cut Timber:*

- 6.8.3.1 As an alternative to Section 6.5, 44 x 95 mm rough-cut timber girts at 600 mm o.c., fastened to framing as indicated in Section 4.2.6.

6.8.4 *Full-Size Rough-Cut Timber:*

- 6.8.4.1 As an alternative to Section 6.5, 51 x 102 mm rough-cut timber girts at 600 mm o.c., fastened to framing as indicated in Section 4.2.7.

6.8.5 *Finished Timber:*

- 6.8.5.1 As an alternative to Section 6.5, 38 x 89 mm timber girts installed horizontally at 600 mm o.c. with 12.7 mm plywood strips (minimum 89 mm wide), fastened to framing as indicated in Section 4.2.8.

6.8.6 *Gypsum Wallboard:*

- 6.8.6.1 Where gypsum wallboard is required, it shall be installed in accordance with NBC Division B Subsection 9.29.5.

6.9 *Fastener Spacing*

6.9.1 *BASF HP+™ Wall XR Series (Neopor® Sheathing):*

- 6.9.1.1 Maximum of 150 mm o.c. along edges and 300 mm o.c. in the field.

6.9.2 *Z-Bar Girts or Hat-Channel Furring (also called Omega Bars):*

- 6.9.2.1 Two fasteners into each framing member

6.9.3 *Gypsum Wallboard:*

- 6.9.3.1 For NBC Division B Part 9 applications, gypsum nail fasteners shall be spaced a minimum of 200 mm o.c. on all vertical wall supports and top and bottom plates.
- 6.9.3.2 For NBC Division B Part 9 applications, gypsum screw fasteners shall be spaced a maximum of 300 mm o.c. on all vertical wall supports and top and bottom plates.
- 6.9.3.3 For engineered design, see **Table 1**.

6.10 *Fastener Edge Distance*

- 6.10.1 For NBC Division B Part 9 applications, fastener edge distance is a minimum of 10 mm for both BASF HP+™ Wall XR Series and gypsum board in accordance with Division B, Articles 9.29.5.8. and 9.29.5.9.

6.11 *Neopor® Attachment with Furring Installed on the Exterior Side*

- 6.11.1 Install the plastic cap screws at the corners of each Neopor® panel only, then install minimum 19 mm x 63 mm (nominal 1" x 3") wood furring using a screw going through the furring strip, through the Neopor® and finally into the hat furring or Z-bar. The wood furring and its connection shall be designed to support the cladding weight and transfer any required loads to the framing members.

7 Test Engineering Substantiating Data

- 7.1 Testing has been performed under the supervision of a professional engineer and/or under the requirements of ISO/IEC 17025 as follows:

- 7.1.1 Lateral-load testing in accordance with ASTM E2126
- 7.1.2 Transverse wind-load testing in accordance with ASTM E330
- 7.1.3 Uplift load testing in accordance with ASTM E72
- 7.1.4 Gravity load testing for single-top-plate applications in accordance with ASTM E72
- 7.1.5 Surface burning testing in accordance with CAN/ULC S102
- 7.1.6 Material property testing in accordance with ASTM C578
- 7.1.7 WALLTITE® CM01 product listing per CCMC 13588-L
- 7.1.8 WALLTITE® CM01 product listing per CCMC 14100-L

- 7.2 Information contained herein is the result of testing and/or data analysis by sources that conform to the evaluation requirements of NBC Volume 1 Relationship of the NBC to Standards Development and Conformity Assessment and/or professional engineering regulations. DrJ relies upon accurate data to perform its ISO/IEC 17065 evaluations.
- 7.3 Where appropriate, DrJ's analysis is based on provisions that have been codified into law through provincial, territorial, or local adoption of codes and standards. The developers of these codes and standards are responsible for the reliability of published content. DrJ analysis may use code-adopted provisions as a control sample. A control sample versus a test sample establishes a innovative product as being equivalent to that prescribed in this code in quality, strength, effectiveness, fire resistance, durability and safety.
- 7.4 The accuracy of the provisions provided herein may be reliant upon the published properties of raw materials, which are defined by the grade mark, grade stamp, mill certificate, Listings, certified reports, duly authenticated reports from approved agencies, and research reports prepared by approved agencies and/or approved sources provided by the suppliers of products, materials, designs, assemblies and/or methods of construction. These are presumed to be minimum properties and relied upon to be accurate. The reliability of DrJ's engineering practice, as contained in this TER, may be dependent upon published design properties by others.
- 7.5 Testing and engineering analysis: The strength, rigidity and/or general performance of component parts and/or the integrated structure are determined by suitable tests that simulate the actual conditions of application that occur and/or by accepted engineering practice and experience.
- 7.6 Where additional condition of use and/or code compliance information is required, please search for BASF HP+™ Wall XR Series on the DrJ Certification website.

8 Findings

- 8.1 As delineated in Section 3, BASF HP+™ Wall XR Series has performance characteristics that were tested and/or meet pertinent standards and is suitable for use pursuant to its specified purpose.
- 8.2 When used and installed in accordance with this TER and the manufacturer installation instructions, BASF HP+™ Wall XR Series shall be approved for the following applications:
 - 8.2.1 Lateral-load resistance due to wind and seismic loads carried by shear walls in accordance with **Table 1**.
 - 8.2.2 Specified wind-load resistance in accordance with **Table 2**.
 - 8.2.3 Thermal resistance properties in accordance with **Table 3**.
 - 8.2.4 Air-permeance performance in accordance with **Table 4**.
 - 8.2.5 Material fire properties in accordance with **Table 5**.
- 8.3 Any application specific issues not addressed herein can be engineered by an RDP. Assistance with engineering is available from BASF Corporation.
- 8.4 This innovative product has been evaluated in the context of the codes listed in Section 2 and is compliant with all known provincial, territorial, and local building codes. Where there are known variations in provincial, territorial, or local codes applicable to this TER, they are listed here.
 - 8.4.1 No known variations
- 8.5 NBC Volume 1 Relationship of the NBC to Standards Development and Conformity Assessment:

Certification

Certification is the confirmation by an independent organization that a product, service, or system meets a requirement...Certification bodies publish lists of certified products and companies...Several organizations, including the Canadian Construction Materials Centre (CCMC), offer such evaluation services.

Evaluation

An evaluation is a written opinion by an independent professional organization that a product will perform its intended function. An evaluation is very often done to determine the ability of an innovative product, for which no standards exist, to satisfy the intent of the Code requirement...

- 8.6 ISO/IEC 17065 accredited third-party certification bodies,⁶ including but not limited to, Standards Council of Canada (SCC)⁷ and ANSI National Accreditation Board (ANAB),⁸ confirm that product certification bodies have the expertise to provide technical evaluation services within their scope of accreditation. All SCC and ANAB product certification bodies meet NBC requirements to offer evaluation services for alternative solutions.⁹
- 8.6.1 DrJ is an ISO/IEC 17065 ANAB-Accredited Product Certification Body – Accreditation #1131¹⁰ and employs professional engineers.¹¹
- 8.7 Through ANAB accreditation and the IAF Multilateral Agreements, this TER can be used to obtain innovative product approval in any jurisdiction or country that has IAF MLA Members & Signatories to meet the Purpose of the MLA – “*certified once, accepted everywhere.*” IAF specifically says, “*Once an accreditation body is a signatory of the IAF MLA, it is required to recognise certificates and validation and verification statements issued by conformity assessment bodies accredited by all other signatories of the IAF MLA, with the appropriate scope.*”¹²
- 8.8 Product certification organizations, accredited by the SCC and ANAB, are defined as equivalent evaluation services:
- 8.8.1 Canada-United States-Mexico Agreement (CUSMA), Article 11.6 Conformity Assessment confirms mutual recognition by stating, “*...each Party shall accord to conformity assessment bodies located in the territory of another Party treatment no less favorable than that it accords to conformity assessment bodies located in its own territory or in the territory of the other Party.*”
- 8.8.2 The SCC National Conformity Assessment Principles states, “*SCC is a member of a number of international organizations developing voluntary conformity assessment agreements that help ensure the international acceptance of Canadian conformity assessment results. Signatories to these agreements (like SCC) recognize each other’s accreditations as being equivalent to their own.*”¹³
- 8.9 Building official approval of a licensed professional engineer is performed by verifying the professional engineer and/or their business entity are listed by the engineering regulators of the relevant jurisdiction.

9 Conditions of Use

- 9.1 Material properties shall not fall outside the boundaries defined in Section 3.
- 9.2 As defined in Section 3, where material and/or engineering mechanics properties are created for load resisting design purposes, the resistance to the applied load shall not exceed the ability of the defined properties to resist those loads using the principles of accepted engineering practice.
- 9.2.1 Loads applied shall not exceed those recommended by the manufacturer as follows:
- 9.2.1.1 Shear loads shall not exceed values in **Table 1**, as applicable.
- 9.2.1.2 Axial loads shall not exceed values in Section 5.7.
- 9.2.1.3 Specified wind loads shall not exceed values in **Table 2**.

⁶ <https://anabpd.ansi.org/Accreditation/product-certification/DirectoryListingAccredited?menuID=1&prgID=1>

⁷ https://iaf.nu/en/member-details/?member_id=91

⁸ https://iaf.nu/en/member-details/?member_id=14

⁹ NBC Division A Clause A-1.2.1.1.(1)(b) provides information on code compliance via alternative solutions and defines alternative solutions as “...achiev[ing] at least the minimum level of performance required by Division B.” NBC Division C Section 2.3 includes additional guidance for documentation of alternative solutions.

¹⁰ <https://anabpd.ansi.org/Accreditation/product-certification/AllDirectoryDetails?&prgID=1&OrgId=2125&statusID=4>

¹¹ Through ANAB accreditation and the IAF MLA, DrJ certification can be used to obtain material, product, design, or method of construction approval in any jurisdiction or country that has IAF MLA Members & Signatories to meet the Purpose of the MLA – “certified once, accepted everywhere”.

¹² <https://iaf.nu/en/about-iaf-mla/#:~:text=required%20to%20recognise>

¹³ The National Conformity Assessment Principles states, “*Product regulations and standards may vary from country to country. If these are set arbitrarily, they could be deemed as protectionist. The World Trade Organization (WTO) Agreement on Technical Barriers to Trade (TBT Agreement) is intended to ensure that technical regulations, standards and conformity assessment procedures of member countries do not create unnecessary obstacles to trade. Under the TBT Agreement, members of the WTO agree to use international standards, including conformity assessment standards and guides, as a basis for their technical requirements.*”

- 9.3 Where required by regulation and enforced by the building official, also known as the authority having jurisdiction (AHJ) in which the project is to be constructed:
- 9.3.1 Any calculations incorporated into the construction documents shall conform to accepted engineering practice, and, when prepared by an approved source, shall be approved when signed and sealed.
 - 9.3.2 This TER and the installation instructions shall be submitted at the time of permit application.
 - 9.3.3 This innovative product has an internal quality control program and a third-party quality assurance program.
 - 9.3.4 At a minimum, this innovative product shall be installed per Section 6 of this TER.
 - 9.3.5 This TER shall be reviewed for code compliance by the AHJ in concert with the duties and powers granted to the building official by the provincial regulations governing such duties and powers.
 - 9.3.6 The application of this innovative product in the context of this TER, is dependent on the accuracy of the construction documents, implementation of installation instructions, inspections, and any other regulatory requirements that may apply.
- 9.4 Design loads shall be determined in accordance with the building code adopted by the jurisdiction in which the project is to be constructed and/or by the designer (i.e., owner).
- 9.5 The actual design, suitability, and use of this TER, for any particular building, is the responsibility of the owner or the owner's authorized agent.

10 Identification

- 10.1 The innovative product listed in Section 1.1 is identified by a label on the board or packaging material bearing the manufacturer name, product name, TER number, and other information to confirm code compliance.
- 10.2 Additional technical information can be found at www.basf.com.

11 Review Schedule

- 11.1 This TER is subject to periodic review and revision. For the most recent version, visit drjcertification.org.
- 11.2 For information on the status of this TER, contact [DrJ Certification](#).

12 Legislation that Authorizes New Product Approval in International Markets is Found in Appendix A

- 12.1 BASF HP+™ Wall XR Series has been tested by an ISO/IEC 17025 accredited laboratory and/or evaluated to be in conformance with accepted engineering practice to ensure durable, livable and safe construction.
- 12.2 This TER is published by an ISO/IEC 17065 accredited certification body with the expertise to evaluate products, materials, designs, services, assemblies and/or methods of construction.
- 12.3 This TER meets the legislative intent and definition of a duly authenticated report, which shall be accepted by the AHJ, unless there are specific reasons why the alternative shall not be approved as provided for in writing.


Appendix A

1 Legislation that Authorizes New Product Approval in Canada

- 1.1 The Competition Act is a Canadian federal law governing competition law in Canada. The Act contains both criminal and civil provisions aimed at preventing anti-competitive practices in the marketplace. The Act is enforced and administered by the Competition Bureau, whose regulations encourage the approval of NBC referenced and alternative products, materials, designs, services, assemblies and/or methods of construction that:
 - 1.1.1 Advance Innovation,
 - 1.1.2 Promote competition so all businesses have the opportunity to compete on price and quality in an open market on a level playing field unhampered by anticompetitive constraints, and
 - 1.1.3 Benefit consumers through lower prices, better quality, and greater choice.
- 1.2 **Approved by International Jurisdictions:** The USMCA and GATT agreements provide for approval of innovative materials, products, designs, services, assemblies and/or methods of construction through the Technical Barriers to Trade (TBT) agreements and the International Accreditation Forum (IAF) Multilateral Recognition Arrangement (MLA), where these agreements proclaim the desire of both countries to have their markets open to innovation.
- 1.3 These agreements:
 - 1.3.1 Permit participation of conformity assessment bodies located in the territories of other Members (defined as GATT Countries) under conditions no less favourable than those accorded to bodies located within their territory or the territory of any other country,
 - 1.3.2 State that conformity assessment procedures (i.e., ISO/IEC 17020, 17025, 17065, etc.) are prepared, adopted, and applied so as to grant access for suppliers of like products originating in the territories of other Members under conditions no less favourable than those accorded to suppliers of like products of national origin or originating in any other country, in a comparable situation.
 - 1.3.3 State that conformity assessment procedures are not prepared, adopted, or applied with a view to or with the effect of creating unnecessary obstacles to international trade. This means that conformity assessment procedures shall not be more strict or be applied more strictly than is necessary to give the importing Member adequate confidence that products conform to the applicable technical regulations or standards.
- 1.4 To this end, Canada operates an accreditation system as follows:



1.5 This includes ISO/IEC 17065 product certification as follows:

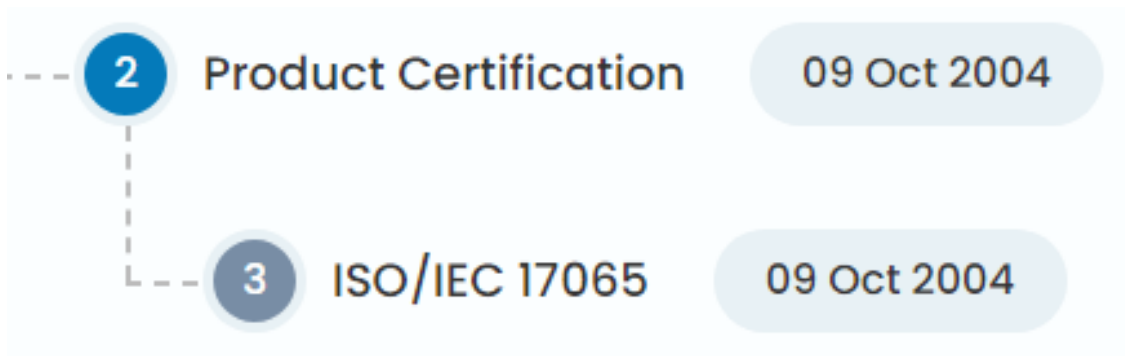


1.6 Similarly, the United States operates multiple accreditation process with ANAB being the most prominent ISO/IEC 17065 product certification organization as follows:



1.7 This includes ISO/IEC 17065 product certification as follows:



- 1.8 The list of ANAB accredited ISO/IEC 17065 product certification organizations can be found at the following link: <https://anabpd.ansi.org/Accreditation/product-certification/DirectoryListingAccredited?menuID=1&prgID=1>

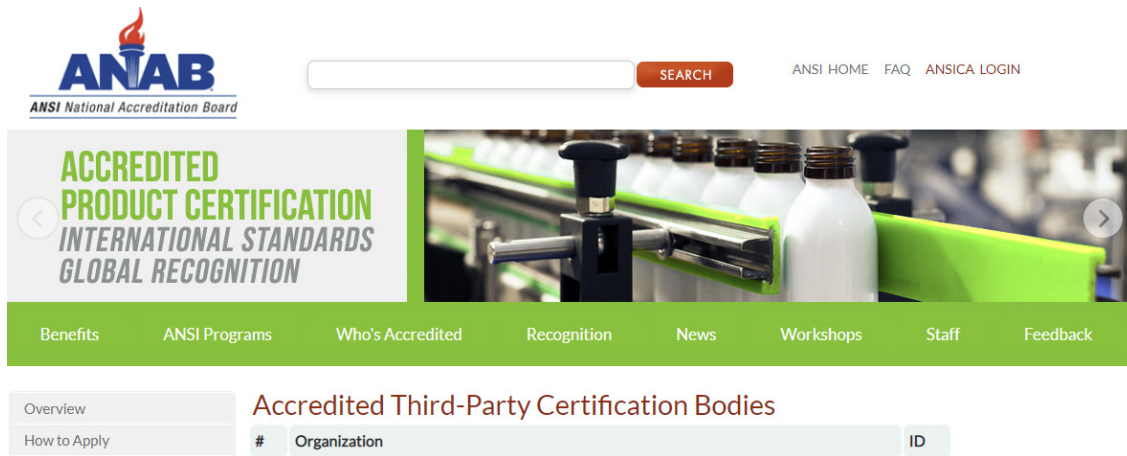

- 1.9 Approval is granted via International Agreement, where the purpose of the IAF MLA is to ensure mutual recognition of accredited certification and validation/verification statements between signatories. Subsequent acceptance of accredited certification and validation/verification statements is required so that one accreditation can be used for the timely approval of innovative materials, products, designs, services, assemblies and/or methods of construction. Accreditations granted by IAF MLA signatories are recognised worldwide based on their equivalent accreditation programs, therefore reducing costs and adding value to businesses and consumers.
- 1.10 Consequently, these agreements permit product approval of innovative Australian and New Zealand products into US markets and vice-versa.
- 1.11 Finally, a question that often arises is, why do these agreements exist? In addition, another question is why is the ISO/IEC 17065 accredited third-party certification process so important?
- 1.11.1 The answer is because all countries desire to protect the intellectual property and trade secrets of their country's businesses.
 - 1.11.2 In the US this protection is provided by 18 U.S. Code § 1831 Under Economic Espionage, where it states "whoever, intending or knowing that the offense will benefit any foreign government, foreign instrumentality, or foreign agent, knowingly steals, or without authorization appropriates, takes, carries away, or conceals, or by fraud, artifice, or deception obtains a trade secret shall be fined not more than \$5,000,000 or imprisoned not more than 15 years, or both."
 - 1.11.3 Any organization that commits any offense described shall be fined not more than the greater of \$10,000,000 or three (3) times the value of the stolen trade secret to the organization, including expenses for research and design and other costs of reproducing the trade secret that the organization has thereby avoided.¹⁴
 - 1.11.4 Protection of intellectual property and trade secrets reinforces the value of the IAF MLA, the GATT/TBT and the ISO/IEC 17065 product approval process.
 - 1.11.5 The goal is to protect everyone's best interests while also facilitating economic freedom and opportunity by promoting free and fair competition in the marketplace.

¹⁴ <https://www.law.cornell.edu/uscode/text/18/part-II/chapter-90>