

Listing and Technical Evaluation Report™

A Duly Authenticated Report from an Approved Agency

Report No: 1910-05



Issue Date: December 20, 2019

Revision Date: May 8, 2026

Subject to Renewal: July 1, 2027

SPAX® 1/4" x 2" Hex Washer Head PowerLags® Fastener Steel Side Plate Application

Trade Secret Report Holder:

Altenloh, Brinck & Company U.S., Inc.

Phone: 419-636-6715

Website: spax.us

CSI Designations:

DIVISION: 06 00 00 - WOOD, PLASTICS AND COMPOSITES

Section: 06 00 90 - Wood and Plastic Fastenings

Section: 06 05 23 - Wood, Plastic, and Composite Fastenings

1 Innovative Product Evaluated¹

- 1.1 SPAX 1/4" x 2" Hex Washer Head PowerLags (hereinafter referred to as XH250-2000 Fasteners)

2 Product Description and Materials

- 2.1 XH250-2000 Fasteners have a hex washer head with a 3/8" hex drive. The point is a threaded drill point.
- 2.2 The innovative product evaluated in this report is shown in **Figure 1**.

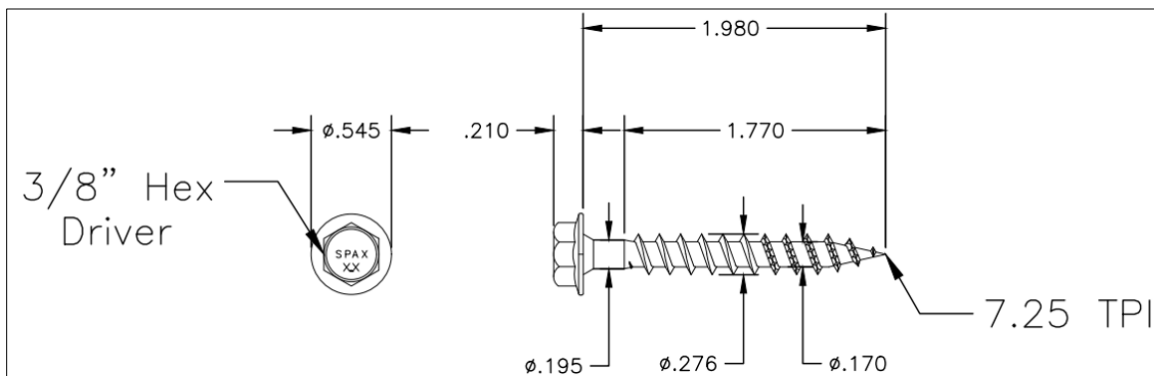


Figure 1. XH250-2000 Fastener

- 2.3 XH250-2000 Fasteners are made of hardened carbon steel grade 1022 or 10B21 wire conforming to ASTM A510 or grade 17MnB3, or 19MnB4 wire conforming to DIN 1654.



- 2.4 XH250-2000 Fasteners are manufactured using a standard cold-formed process, followed by heat-treating and coating processes.
 - 2.4.1 XH250-2000 Fastener heads have a 3/8" hex drive.
 - 2.4.2 XH250-2000 Fasteners have a gimlet point.
- 2.5 XH250-2000 Fasteners are installed without lead holes as prescribed in the NDS.
- 2.6 The innovative product evaluated in this report is outlined in **Table 1**.

Table 1. Fastener Designation⁴

Fastener	Fastener Length ¹ (in)	Thread Length ² (in)	Head (in)				Shank Diameter (in)	Diameter (in)		Bending Yield Strength, ³ F _{yb} (psi)
			Style	Marking	Diameter	Height		Minor	Major	
XH250-2000	1.980	1.770	Hex Washer	2	0.545	0.210	0.195	0.170	0.276	158,000

SI: 1 in = 25.4 mm, 1-psi = 0.00689 MPa

1. Fastener length is measured from the underside of the head to the tip.

2. Thread length includes tip (see **Figure 1**).

3. Bending yield strength, F_{yb}, determined in accordance with ASTM F1575 using minor thread diameter when fastener is tested in the threaded location.

4. Tabulated fastener dimensions are measured on uncoated fasteners. Finished dimensions are larger, due to the proprietary coatings added.

- 2.7 XH250-2000 Fasteners may be coated with a proprietary HCR™ coating system or a zinc-plate system.
 - 2.7.1 The proprietary HCR coating system exceeds the protection provided by a code-approved hot-dipped galvanized coating, meeting ASTM A153 as specified in IBC Section 2304.10.6² and IRC Section R304.3.³
 - 2.7.1.1 The HCR coating is approved for use in ground contact and pressure treated wood (Alkaline Copper Quaternary Type D, also known as ACQ-D) in general construction (freshwater) applications.
 - 2.7.1.2 HCR coated fasteners are approved for use in fire-retardant treated lumber, provided the conditions set forth by the fire-retardant treated lumber manufacturer be met, including appropriate strength reductions.
 - 2.7.2 The zinc plating system provides the equivalent protection provided by a code approved hot-dipped galvanized coating meeting ASTM A153.
 - 2.7.2.1 The zinc plating system is tested and recognized for use in ground contact, pressure treated wood (ACQ-D), in dry-unexposed applications.
- 2.8 As needed, review material properties for design in **Section 6** and the regulatory evaluation in **Section 8**.

3 Definitions⁴

- 3.1 New Materials⁵ are defined as building materials, equipment, appliances, systems, or methods of construction, not provided for by prescriptive and/or legislatively adopted regulations, known as alternative materials.⁶ The design strength and permissible stresses shall be established by tests⁷ and/or engineering analysis.⁸
- 3.2 Duly authenticated reports⁹ and research reports¹⁰ are test reports and related engineering evaluations that are written by an approved agency¹¹ and/or an approved source.¹²
 - 3.2.1 This report utilizes intellectual property and/or trade secrets to create public domain material properties for commercial end-use.
 - 3.2.1.1 This report protects confidential Intellectual Property and trade secrets under the regulation, 18.U.S.Code.90, also known as Defend Trade Secrets Act of 2016 (DTSA).¹³
- 3.3 An approved agency is “*approved*” when it is ANAB ISO/IEC 17065 accredited. DrJ Engineering, LLC (DrJ) is accredited and listed in the ANAB directory.



- 3.4 An approved source is “approved” when a professional engineer (i.e., Registered Design Professional, hereinafter RDP) is properly licensed to transact engineering commerce. The regulatory authority governing approved sources is the state legislature via its professional engineering regulations.¹⁴
- 3.5 Testing and/or inspections conducted for this duly authenticated report were performed by an ISO/IEC 17025 accredited testing laboratory, an ISO/IEC 17020 accredited inspection body, and/or a licensed RDP.
 - 3.5.1 The Center for Building Innovation (CBI) is ANAB¹⁵ ISO/IEC 17025 and ISO/IEC 17020 accredited.
- 3.6 The regulatory authority shall enforce¹⁶ the specific provisions of each legislatively adopted regulation. If there is a non-conformance, the specific regulatory section and language of the non-conformance shall be provided in writing¹⁷ stating the nonconformance and the path to its cure.
- 3.7 The regulatory authority shall accept duly authenticated reports from an approved agency and/or an approved source with respect to the quality and manner of use of new materials or assemblies as provided for in regulations regarding the use of alternative materials, designs, or methods of construction.¹⁸
- 3.8 ANAB is an International Accreditation Forum (IAF) Multilateral Recognition Arrangement (MLA) signatory. Therefore, recognition of certificates and validation statements issued by conformity assessment bodies accredited by all other signatories of the IAF MLA with the appropriate scope shall be approved.¹⁹ Thus, all ANAB ISO/IEC 17065 duly authenticated reports are approval equivalent,²⁰ and can be used in any country that is an MLA signatory found at this link: <https://iaf.nu/en/recognised-abs/>
- 3.9 Approval equity is a fundamental commercial and legal principle.²¹

4 Applicable Local, State, and Federal Approvals; Standards; Regulations²²

4.1 Local, State, and Federal

- 4.1.1 Approved in all local jurisdictions pursuant to ISO/IEC 17065 duly authenticated report use, which includes, but is not limited to, the following featured local jurisdictions: Austin, Baltimore, Broward County, Chicago, Clark County, Dade County, Dallas, Detroit, Denver, DuPage County, Fort Worth, Houston, Kansas City, King County, Knoxville, Las Vegas, Los Angeles City, Los Angeles County, Miami, Nashville, New York City, Omaha, Philadelphia, Phoenix, Portland, San Antonio, San Diego, San Jose, San Francisco, Seattle, Sioux Falls, South Holland, St. Louis County, Texas Department of Insurance, and Wichita.²³
- 4.1.2 Approved in all state jurisdictions pursuant to ISO/IEC 17065 duly authenticated report use, which includes, but is not limited to, the following featured states: California, Florida, New Jersey, Oregon, New York, Texas, Washington, and Wisconsin.²⁴
- 4.1.3 Approved by the Code of Federal Regulations Manufactured Home Construction: Pursuant to Title 24, Subtitle B, Chapter XX, Part 3282.14²⁵ and Part 3280²⁶ pursuant to the use of ISO/IEC 17065 duly authenticated reports.
- 4.1.4 Approved means complying with the requirements of local, state, or federal legislation.

4.2 Regulations

- 4.2.1 *IBC – 18, 21, 24: International Building Code®*
- 4.2.2 *IRC – 18, 21, 24: International Residential Code®*

4.3 Standards

- 4.3.1 *ANSI/AWC NDS: National Design Specification (NDS) for Wood Construction*
- 4.3.2 *ASTM A153: Standard Specification for Zinc Coating (Hot-Dip) on Iron and Steel Hardware*
- 4.3.3 *ASTM A370: Standard Test Methods and Definitions for Mechanical Testing of Steel Products*
- 4.3.4 *ASTM B117: Standard Practice for Operating Salt Spray (Fog) Apparatus*
- 4.3.5 *ASTM D1761: Standard Test Methods for Mechanical Fasteners in Wood and Wood-Based Materials*



4.3.6 ASTM F1575-21: Standard Test Method for Determining Bending Yield Moment of Nails

4.3.7 ASTM G85: Standard Practice for Modified Salt Spray (Fog) Testing

5 Listed²⁷

5.1 Equipment, materials, products, or services included in a List published by a nationally recognized testing laboratory (e.g., CBI), an approved agency (e.g., CBI and DrJ), and/or and approved source (e.g., DrJ), or other organization(s) concerned with product evaluation (e.g., DrJ), that maintains periodic inspection (e.g., CBI) of production of listed equipment or materials, and whose listing states either that the equipment or material meets nationally recognized standards or has been tested and found suitable for use in a specified manner.

6 Tabulated Properties Generated from Nationally Recognized Standards

6.1 XH250-2000 Fasteners are used to resist shear load parallel or perpendicular to grain when attaching steel side plates to solid sawn wood framing.

6.2 *Lateral Design Values*

6.2.1 The design of XH250-2000 Fasteners is governed by the applicable code and the provisions for dowel-type fasteners in the NDS. No further duration of load increases are permitted.

6.2.1.1 Lateral design values for XH250-2000 Fasteners installed into Douglas Fir-Larch with a steel side plate are provided in **Table 2**.

Table 2. Reference Lateral Design Values for Single Shear Connections in Wood with Steel Side Plate^{1,2}

Fastener ³	Main Member ⁴	Side Member Thickness (in)	Service Condition ⁵	Load Parallel to Grain (lbs)	Load Perpendicular to Grain (lbs)
XH250-2000 Fasteners	DF-L (0.50)	1/4	Dry	425	400
			Wet	310	355
		1/8	Dry	380	385
			Wet	325	355

SI: 1 in = 25.4 mm, 1 lb = 4.45 N

- Reference lateral design values apply to two-member single shear connections where the main member is wood with a specific gravity equal to or greater than 0.50 and the side member is a steel side plate with a tensile strength (F_u) of at least 65-ksi.
- Values shall be adjusted by all applicable factors per the NDS.
- Fastener is oriented perpendicular to grain.
- The entire fastener must be embedded in the main member. The tip of the fastener shall not extend beyond the backside of the main member.
- Dry service condition is defined as lumber with an in-service moisture content of less than or equal to nineteen percent (19%). Wet service condition is defined as lumber with an in-service moisture content of greater than nineteen percent (19%).

6.3 Alternative techniques shall be permitted in accordance with accepted engineering practice and experience. These provisions for the use of alternative materials, designs, and methods of construction are not intended to prevent the installation of any material or to prohibit any design or method of construction not specifically prescribed herein. This includes, but is not limited to, the following areas of engineering: mechanics of materials, structures, building science, and fire science.



7 Certified Performance²⁸

- 7.1 All construction methods shall conform to accepted engineering practices to ensure durable, livable, and safe construction and shall demonstrate acceptable workmanship reflecting journeyman quality of work of the various trades.²⁹
- 7.2 The strength and rigidity of the component parts and/or the integrated structure shall be determined by engineering analysis or by suitable load tests to simulate the actual loads and conditions of application that occur.³⁰

8 Regulatory Evaluation and Accepted Engineering Practice

- 8.1 XH250-2000 Fasteners comply with the following legislatively adopted regulations and/or accepted engineering practice for the following reasons:
 - 8.1.1 XH250-2000 Fasteners were evaluated to determine lateral design values for attaching steel side plates to wood main members in both wet and dry service conditions. The following conditions were evaluated:
 - 8.1.1.1 Bending yield in accordance with ASTM F1575
 - 8.1.1.2 Lateral resistance in accordance with ASTM D1761
 - 8.1.1.3 Corrosion resistance in accordance with ASTM B117 and ASTM G85
 - 8.1.2 Use of XH250-2000 Fasteners in locations exposed to saltwater or saltwater spray is outside the scope of this report.
- 8.2 Any building code, regulation and/or accepted engineering evaluations (e.g., research reports, duly authenticated reports, etc.) that are conducted for this Listing were performed by DrJ, which is an ISO/IEC 17065 accredited certification body and a professional engineering company operated by RDP or approved sources. DrJ is qualified³¹ to practice product and regulatory compliance services within its scope of accreditation and engineering expertise,³² respectively.
- 8.3 Engineering evaluations are conducted with DrJ's ANAB accredited ICS code scope of expertise, which is also its areas of professional engineering competence.

9 Installation

- 9.1 Installation shall comply with the approved construction documents, the manufacturer installation instructions, this report, and the applicable building code.
- 9.2 In the event of a conflict between the manufacturer installation instructions and this report, contact the manufacturer for counsel on the proper installation method.
- 9.3 XH250-2000 Fasteners must be installed with a 1/2" (12.7 mm), low rpm/high torque electric drill (450 rpm) or impact wrench using the appropriate driver bit.
- 9.4 Lead holes are not required.
- 9.5 The bottom of the fastener head must be installed flush to the surface of the steel member being connected.
 - 9.5.1 The fastener must not be overdriven.
 - 9.5.2 In the event a fastener is overdriven, contact the manufacturer for counsel on steps to take and, if needed, a repair to be made.
- 9.6 The entire fastener must be embedded into the main member. The tip of the fastener shall not extend beyond the backside of the main member.
- 9.7 Minimum requirements for fastener spacing, edge distance, and end distance shall be in accordance with **Table 3**. See **Figure 2** for associated details.

Table 3. Minimum Spacing, Edge Distance, and End Distance Requirements

Connection Geometry ^{1,2}	Figure 2 Designation	Minimum Spacing (in)
Edge Distance – Load in any direction	(a)	1½
End Distance – Load parallel to grain, towards end	(b)	3
End Distance – Load parallel to grain, away from end	(b)	2
End Distance – Load perpendicular to grain	(c)	2
Spacing between Fasteners in a Row – Parallel to grain	(d)	3
Spacing between Fasteners in a Row – Perpendicular to grain	(e)	2
Spacing between Rows of Fasteners – In-line	(f)	1
Spacing between Rows of Fasteners – Staggered	(g)	½

SI: 1 in = 25.4 mm

- Edge distances, end distances, and spacing of fasteners shall be sufficient to prevent splitting of the wood or as shown in this table, whichever is more restrictive.
- Values for “Spacing between Rows of Fasteners-Staggered” apply where the fasteners in adjacent rows are offset by one-half of the “Spacing between Fasteners in a Row”.

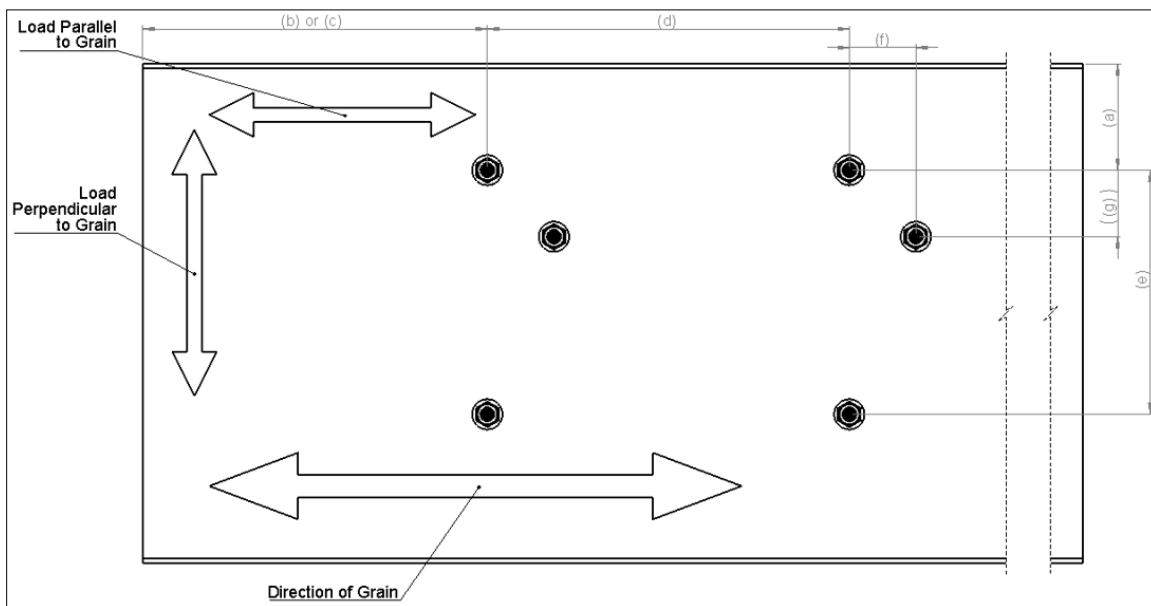


Figure 2. XH250-2000 Fastener Spacing

10 Substantiating Data

10.1 Testing has been performed under the supervision of a professional engineer and/or under the requirements of ISO/IEC 17025 as follows:

- 10.1.1 Testing for lateral resistance in accordance with ASTM D1761
- 10.1.2 Testing for bending yield in accordance with ASTM F1575



- 10.1.3 Testing for tensile strength of steel in accordance with ASTM A370
- 10.1.4 Testing for corrosion in accordance with ASTM B117 and ASTM G85
- 10.2 Information contained herein may include the result of testing and/or data analysis by sources that are approved agencies, approved sources, and/or an RDP. Accuracy of external test data and resulting analysis is relied upon.
- 10.3 Where applicable, testing and/or engineering analysis are based upon provisions that have been codified into law through state or local adoption of regulations and standards. The developers of these regulations and standards are responsible for the reliability of published content. DrJ's engineering practice may use a regulation-adopted provision as the control. A regulation-endorsed control versus a simulation of the conditions of application to occur establishes a new material as being equivalent to the regulatory provision in terms of quality, strength, effectiveness, fire resistance, durability, and safety.
- 10.4 The accuracy of the provisions provided herein may be reliant upon the published properties of raw materials, which are defined by the grade mark, grade stamp, mill certificate, or duly authenticated reports from approved agencies and/or approved sources provided by the supplier. These are presumed to be minimum properties and relied upon to be accurate. The reliability of DrJ's engineering practice, as contained in this duly authenticated report, may be dependent upon published design properties by others.
- 10.5 *Testing and Engineering Analysis*
 - 10.5.1 The strength, rigidity, and/or general performance of component parts and/or the integrated structure are determined by suitable tests that simulate the actual conditions of application that occur and/or by accepted engineering practice and experience.³³
- 10.6 Where additional condition of use and/or regulatory compliance information is required, please search for XH250-2000 Fasteners on the DrJ Certification website.

11 Findings

- 11.1 As outlined in **Section 6**, XH250-2000 Fasteners have performance characteristics that were tested and/or meet applicable regulations. In addition, they are suitable for use pursuant to its specified purpose.
- 11.2 When used and installed in accordance with this duly authenticated report and the manufacturer installation instructions, XH250-2000 Fasteners shall be approved for the following applications:
 - 11.2.1 To provide resistance to lateral loads applied to the fastener in a wood main member with a steel side plate.
- 11.3 Unless exempt by state statute, when XH250-2000 Fasteners are to be used as a structural and/or building envelope component in the design of a specific building, the design shall be performed by an RDP.
- 11.4 Any application specific issues not addressed herein can be engineered by an RDP. Assistance with engineering is available from Altenloh, Brinck & Company U.S., Inc.
- 11.5 IBC Section 104.2.3³⁴ (IRC Section R104.2.2³⁵ and IFC Section 104.2.3³⁶ are similar) in pertinent part state:

104.2.3 Alternative Materials, Design and Methods of Construction and Equipment. The provisions of this code are not intended to prevent the installation of any material or to prohibit any design or method of construction not specifically prescribed by this code, provided that any such alternative is not specifically prohibited by this code and has been approved.



- 11.6 **Approved:**³⁷ Building regulations require that the building official shall accept duly authenticated reports.³⁸
- 11.6.1 An approved agency is “*approved*” when it is ANAB ISO/IEC 17065 accredited.
- 11.6.2 An approved source is “*approved*” when an RDP is properly licensed to transact engineering commerce.
- 11.6.3 Federal law, Title 18 US Code Section 242, requires that, where the alternative product, material, service, design, assembly, and/or method of construction is not approved, the building official shall respond in writing, stating the reasons why the alternative was not approved. Denial without written reason deprives a protected right to free and fair competition in the marketplace.
- 11.7 DrJ is a licensed engineering company, employs licensed RDPs and is an ANAB Accredited Product Certification Body – Accreditation #1131.
- 11.8 Through the IAF Multilateral Arrangement (MLA), this duly authenticated report can be used to obtain product approval in any jurisdiction or country because all ANAB ISO/IEC 17065 duly authenticated reports are equivalent.³⁹

12 Conditions of Use

- 12.1 As defined in **Section 6**, where material and/or engineering mechanics properties are created for load resisting design purposes, the resistance to the applied load shall not exceed the ability of the defined properties to resist those loads using the principles of accepted engineering practice.
- 12.2 For XH250-2000 Fasteners installed in dry lumber, the wood member must have a moisture content of less than nineteen percent (19%).
- 12.3 Zinc-plated fasteners are approved for interior, dry use only.
- 12.4 Use of XH250-2000 Fasteners in locations exposed to saltwater or saltwater spray is outside the scope of this evaluation report.
- 12.5 When required by adopted legislation and enforced by the building official, also known as the Authority Having Jurisdiction (AHJ) in which the project is to be constructed:
- 12.5.1 Any calculations incorporated into the construction documents shall conform to accepted engineering practice and, when prepared by an approved source, shall be approved when signed and sealed.
- 12.5.2 This report and the installation instructions shall be submitted at the time of permit application.
- 12.5.3 This innovative product has an internal quality control program and a third-party quality assurance program.
- 12.5.4 At a minimum, this innovative product shall be installed per **Section 9**.
- 12.5.5 The review of this report by the AHJ shall comply with IBC Section 104.2.3.2 and IBC Section 105.3.1.
- 12.5.6 This innovative product has an internal quality control program and a third party quality assurance program in accordance with IBC Section 104.7.2, IBC Section 110.4, IBC Section 1703, IRC Section R104.7.2, and IRC Section R109.2.
- 12.5.7 The application of this innovative product in the context of this report is dependent upon the accuracy of the construction documents, implementation of installation instructions, inspection as required by IBC Section 110.3, IRC Section R109.2, and any other regulatory requirements that may apply.
- 12.6 The approval of this report by the AHJ shall comply with IBC Section 1707.1, where legislation states in part, “*the building official shall make, or cause to be made, the necessary tests and investigations; or the building official shall accept duly authenticated reports from approved agencies in respect to the quality and manner of use of new materials or assemblies as provided for in Section 104.2.3*”, all of IBC Section 104, and IBC Section 105.3.



- 12.7 Design loads shall be determined in accordance with the regulations adopted by the jurisdiction in which the project is to be constructed and/or by the building designer (i.e., owner or RDP).
- 12.8 The actual design, suitability, and use of this report for any particular building, is the responsibility of the owner or the authorized agent of the owner.

13 Identification

- 13.1 SPAX 1/4" x 2" Hex Washer Head PowerLags (XH250-2000 Fasteners), as listed in **Section 1.1**, are identified by a label on the board or packaging material bearing the manufacturer name, product name, this report number, and other information to confirm code compliance.
- 13.2 Additional technical information can be found at spax.us.

14 Review Schedule

- 14.1 This report is subject to periodic review and revision. For the latest version, visit www.drjcertification.org.
- 14.2 For information on the status of this report, please contact [DrJ Certification](#).



Notes

1 For more information, visit drjcertification.org or call us at 608-310-6748.

2 [2018 IBC Section 2304.10.5](#)

3 [2021 IRC Section R317.3](#)

4 Capitalized terms and responsibilities are defined pursuant to the applicable building code, applicable reference standards, the latest edition of [TPI 1](#), the [NDS](#), [AISI S202](#), [US professional engineering law](#), [Canadian building code](#), [Canada professional engineering law](#), [Qualtim External Appendix A: Definitions/Commentary](#), [Qualtim External Appendix B: Project/Deliverables](#), [Qualtim External Appendix C: Intellectual Property and Trade Secrets](#), definitions created within Design Drawings and/or definitions within Reference Sheets. Beyond this, terms not defined shall have ordinarily accepted meanings as the context implies. Words used in the present tense include the future; words stated in the masculine gender include the feminine and neuter; the singular number includes the plural and the plural, the singular.

5 <https://up.codes/viewer/mississippi/ibc-2024/chapter/17/special-inspections-and-tests#1702>

6 Alternative Materials, Design and Methods of Construction and Equipment: The provisions of any regulation code are not intended to prevent the installation of any material or to prohibit any design or method of construction not specifically prescribed by a regulation. Please review <https://www.justice.gov/atr/mission> and <https://up.codes/viewer/mississippi/ibc-2024/chapter/1/scope-and-administration#104.2.3>

7 <https://up.codes/viewer/mississippi/ibc-2024/chapter/17/special-inspections-and-tests#1706.2>:-:text=the%20design%20strengths%20and%20permissible%20stresses%20shall%20be%20established%20by%20tests

8 The [design strengths](#) and permissible stresses of any structural material shall conform to the specifications and methods of design of accepted engineering practice. <https://up.codes/viewer/mississippi/ibc-2024/chapter/17/special-inspections-and-tests#1706.1>:-:text=Conformance%20to%20Standards-.The%20design%20strengths%20and%20permissible%20stresses,-of%20any%20structural

9 <https://up.codes/viewer/mississippi/ibc-2024/chapter/17/special-inspections-and-tests#1707.1>:-:text=the%20building%20official%20shall%20make%20or%20cause%20to%20be%20made%20the%20necessary%20tests%20and%20investigations%20or%20the%20building%20official%20shall%20accept%20duly%20authenticated%20reports%20from%20approved%20agencies%20in%20respect%20to%20the%20quality%20and%20manner%20of%20use%20of%20new%20materials%20or%20assemblies%20as%20provided%20for%20in%20Section%20104.2.3.

10 <https://up.codes/viewer/mississippi/ibc-2024/chapter/17/special-inspections-and-tests#1703.4.2>

11 https://up.codes/viewer/mississippi/ibc-2024/chapter/2/definitions#approved_agency

12 https://up.codes/viewer/mississippi/ibc-2024/chapter/2/definitions#approved_source

13 <https://www.law.cornell.edu/uscode/text/18/1832> (b) Any organization that commits any offense described in subsection (a) shall be fined not more than the greater of \$5,000,000 or 3 times the value of the stolen trade secret to the organization, including expenses for research and design and other costs of reproducing the trade secret that the organization has thereby avoided. The federal government and each state have a [public records act](#). To follow DTSA and comply state public records and trade secret legislation requires approval through ANAB ISO/IEC 17065 accredited certification bodies or approved sources. For more information, please review this website: [Intellectual Property and Trade Secrets](#).

14 <https://www.nspe.org/resources/issues-and-advocacy/professional-policies-and-position-statements/regulation-professional> AND <https://apassociation.org/list-of-engineering-boards-in-each-state-archive/>

15 <https://www.cbiteest.com/accreditation/>

16 <https://up.codes/viewer/mississippi/ibc-2024/chapter/1/scope-and-administration#104.1>:-:text=directed%20to%20enforce%20the%20provisions%20of%20this%20code

17 <https://up.codes/viewer/mississippi/ibc-2024/chapter/1/scope-and-administration#104.2.3> AND <https://up.codes/viewer/mississippi/ibc-2024/chapter/1/scope-and-administration#105.3.1>

18 <https://up.codes/viewer/mississippi/ibc-2024/chapter/17/special-inspections-and-tests#1707.1>

19 <https://iaf.nu/en/about-iaf-mla/#>:-:text=Once%20an%20accreditation%20body%20is%20a%20signatory%20of%20the%20IAF%20MLA%20it%20is%20required%20to%20recognise%20certificates%20and%20validation%20and%20verification%20statements%20issued%20by%20conformity%20assessment%20bodies%20accredited%20by%20all%20other%20signatories%20of%20the%20IAF%20MLA%20with%20the%20appropriate%20scope

20 True for all ANAB accredited product evaluation agencies and all International Trade Agreements.

21 <https://www.justice.gov/crt/deprivation-rights-under-color-law> AND <https://www.justice.gov/atr/mission>

22 Unless otherwise noted, the links referenced herein use un-amended versions of the [2024 International Code Council \(ICC\) 2024 International Code Council \(ICC\) model codes](#) as foundation references. Mississippi versions of the [IBC 2024](#) and the [IRC 2024](#) are un-amended. This material, product, design, service and/or method of construction also complies with the 2000-2012 versions of the referenced codes and the standards referenced therein. As pertinent to this technical and code compliance evaluation, CBI and/or DrJ staff have reviewed any state or local regulatory amendments to assure this report is in compliance.

23 See [Adoptions by Publisher](#) for the latest adoption of a non-amended or amended model code by the local jurisdiction. <https://up.codes/codes/general>

24 See [Adoptions by Publisher](#) for the latest adoption of a non-amended or amended model code by state. <https://up.codes/codes/general>

25 <https://www.ecfr.gov/current/title-24/subtitle-B/chapter-XX/part-3282/subpart-A/section-3282.14>

26 <https://www.ecfr.gov/current/title-24/subtitle-B/chapter-XX/part-3280>

27 <https://www.ecfr.gov/current/title-24/subtitle-B/chapter-XX/part-3280#p-3280.2>(Listed%20or%20certified); <https://up.codes/viewer/mississippi/ibc-2024/chapter/2/definitions#listed> AND <https://up.codes/viewer/mississippi/ibc-2024/chapter/2/definitions#labeled>

28 <https://up.codes/viewer/mississippi/ibc-2024/chapter/17/special-inspections-and-tests#1703.4>

29 <https://www.ecfr.gov/current/title-24/subtitle-B/chapter-XX/part-3280#>:-:text=All%20construction%20methods%20shall%20be%20in%20conformance%20with%20accepted%20engineering%20practices%20to%20insure%20durable%20livable%20and%20safe%20housing%20and%20shall%20demonstrate%20acceptable%20workmanship%20reflecting%20journeyman%20quality%20of%20work%20of%20the%20various%20trades



30 <https://www.ecfr.gov/current/title-24/subtitle-B/chapter-XX/part-3280#:~:text=The%20strength%20and%20rigidity%20of%20the%20component%20parts%20and/or%20the%20integrated%20structure%20shall%20be%20determined%20by%20engineering%20analysis%20or%20by%20suitable%20load%20tests%20to%20simulate%20the%20actual%20loads%20and%20conditions%20of%20application%20that%20occur>

31 Qualification is performed by a legislatively defined Accreditation Body. ANSI National Accreditation Board (ANAB) is the largest independent accreditation body in North America and provides services in more than 75 countries. DrJ is an ANAB accredited product certification body.

32 <https://anabpd.ansi.org/Accreditation/product-certification/AllDirectoryDetails?prgID=1&orgID=2125&statusID=4#:~:text=Bill%20Payment%20Date,Accredited%20Scopes,-13%20ENVIRONMENT.%20HEALTH>

33 See Code of Federal Regulations (CFR) Title 24 Subtitle B Chapter XX Part 3280 for definition: <https://www.ecfr.gov/current/title-24/subtitle-B/chapter-XX/part-3280>

34 2021 IBC Section 104.11

35 2021 IRC Section R104.11

36 2018: <https://up.codes/viewer/wyoming/ifc-2018/chapter/1/scope-and-administration#104.9> AND 2021: <https://up.codes/viewer/wyoming/ibc-2021/chapter/1/scope-and-administration#104.11>

37 Approved is an adjective that modifies the noun after it. For example, Approved Agency means that the Agency is accepted officially as being suitable in a particular situation. This example conforms to IBC/IRC/IFC Section 201.4 (<https://up.codes/viewer/mississippi/ibc-2024/chapter/2/definitions#201.4>) where the building code authorizes sentences to have an ordinarily accepted meaning such as the context implies.

38 <https://up.codes/viewer/mississippi/ibc-2024/chapter/17/special-inspections-and-tests#1707.1>

39 Multilateral approval is true for all ANAB accredited product evaluation agencies and all International Trade Agreements.