



## Listing and Technical Evaluation Report™

Report No: 1912-07



Issue Date: May 1, 2020

Revision Date: November 29, 2023

Subject to Renewal: July 1, 2024

---

### SPAX® PowerLags® Series Structural Wood Fasteners Properties

Trade Secret Report Holder:

Altenloh, Brinck & Company U.S., Inc

Phone: 419-636-6715

Website: [www.spax.us](http://www.spax.us)

---

#### CSI Designations:

DIVISION: 06 00 00 - WOOD, PLASTICS AND COMPOSITES

Section: 06 00 90 - Wood and Plastic Fastenings

Section: 06 05 23 - Wood, Plastic, and Composite Fastenings

---

#### 1 Innovative Products Evaluated<sup>i</sup>

- 1.1 SPAX® PowerLags® Series Structural Wood Fasteners


#### 2 Product Description and Materials

- 2.1 The innovative products evaluated in this report are shown in **Figure 1**, **Figure 2**, **Figure 3**, and **Figure 4**.
- 2.2 *General*
  - 2.2.1 SPAX® PowerLags® Series Structural Wood Fasteners described in this report are threaded fasteners manufactured using a standard cold forming process and subsequently heat-treated and coated.
  - 2.2.2 The fasteners are available with a variety of coatings, including proprietary coating systems designated as zinc, yellow zinc, HCR™, HCR-X™, and WIROX®.
  - 2.2.3 SPAX® PowerLags® Series Structural Wood Fasteners are available in five different diameters and four different head types, and have lengths ranging from 1 to 24 inches (25 to 610 mm), inclusive of the threaded portion. The four head types are as follows:
    - 2.2.3.1 Hex Washer Head design (**Figure 1**)
    - 2.2.3.2 T-Star Washer Head design with 6-Lobe recess drive system (**Figure 2**)


2.2.3.3 T-Star Pancake Head design with 6-Lobe recess drive system (**Figure 3**)

2.2.3.4 T-Star plus Cylindric Head design with 6-Lobe recess drive system containing a post (**Figure 4**)


2.2.4 For fastener diameters, lengths, and head types, see **Table 1** for #14, **Table 2** for  $\frac{1}{4}$ ", **Table 3** for  $\frac{5}{16}$ ", **Table 4** for  $\frac{3}{8}$ ", and **Table 5** for  $\frac{1}{2}$ " series. All fasteners described in this report are manufactured with cold-rolled threads and a gimlet point.

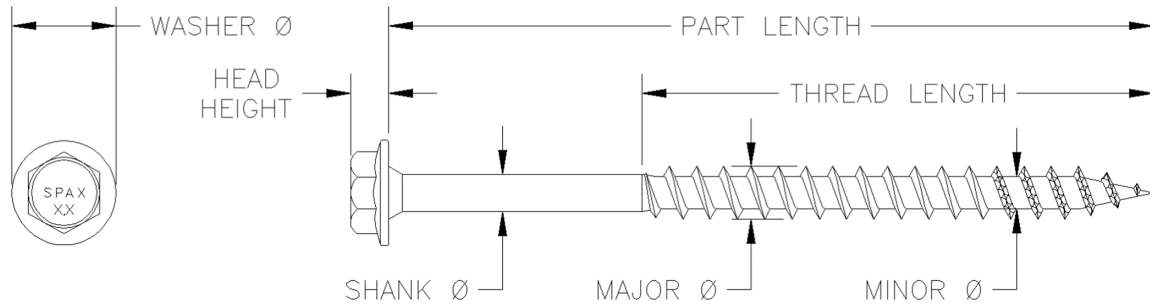


**Figure 1. SPAX® Hex Washer Head PowerLags® Fastener**

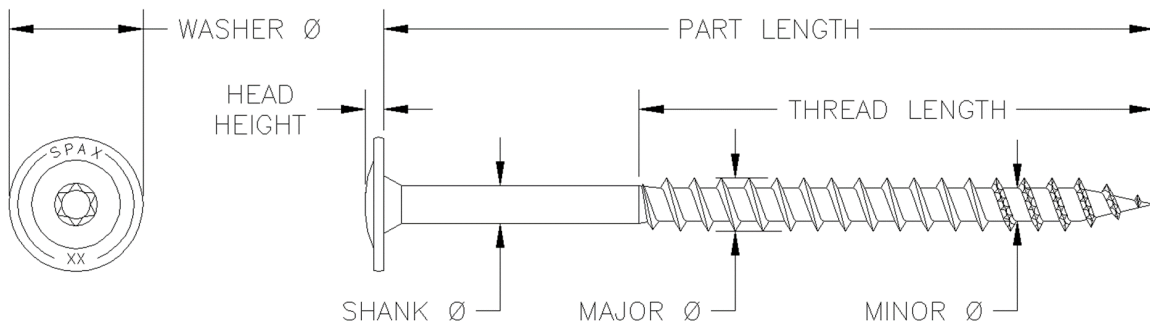

**Figure 2. SPAX® T-Star Washer Head PowerLags® Fastener**

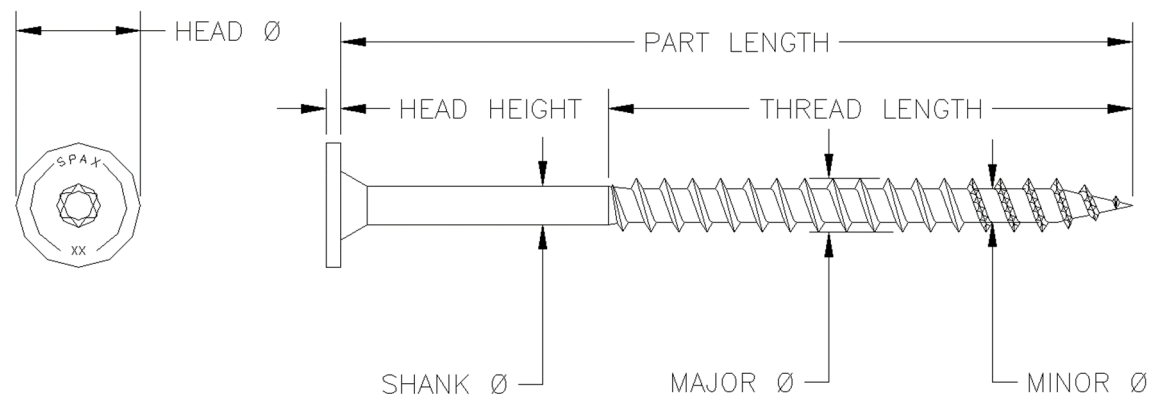

**Figure 3. SPAX® T-Star Pancake Head PowerLags® Fastener**

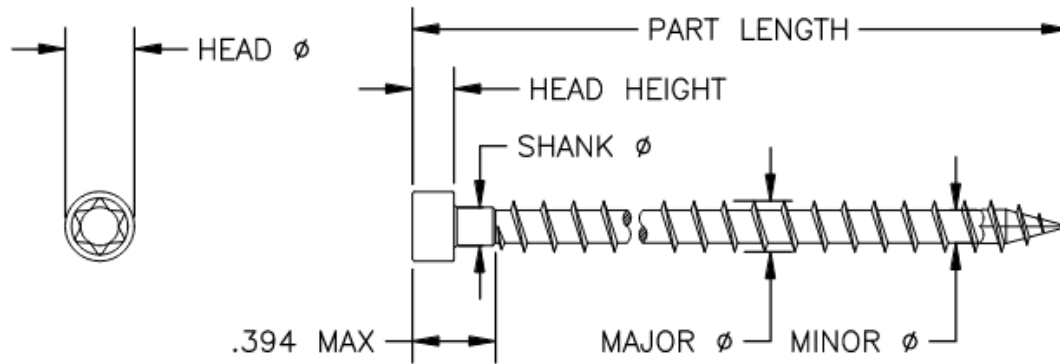

**Figure 4.** SPAX® T-Star plus Cylindric Head PowerLags® Fastener

### 2.3 Fastener Material

- 2.3.1 SPAX® PowerLags® are made of hardened carbon steel grade 10B18, 1022, or 10B21 wire conforming to ASTM A510, or grade 17MnB3 or 19MnB4 wire conforming to DIN 1654.

### 2.4 Corrosion Resistance

#### 2.4.1 Interior Wood Applications

- 2.4.1.1 The SPAX® PowerLags® series structural wood fasteners with the proprietary zinc, yellow zinc, and WIROX® coatings are equivalent to the protection provided by code-approved hot-dipped galvanized coatings meeting ASTM A153, Class D ([IBC Section 2304.10.6<sup>ii</sup>](#) and [IRC Section R317.3](#)) when recognized for use in untreated wood and above ground contact pressure treated wood with waterborne alkaline copper quaternary, Type D (ACQ-D), to a maximum retention level of 0.40 pcf (6.4 kg/m<sup>3</sup>), interior, dry/damp general construction applications (i.e., Above Ground AWPA UC1-UC2 ACQ-D).

#### 2.4.2 Exterior Wood Applications

- 2.4.2.1 The SPAX® PowerLags® series structural wood fasteners with the proprietary HCR™ and HCR-X™ coatings are equivalent to the protection provided by code-approved hot-dipped galvanized coatings meeting ASTM A153, Class D ([IBC Section 2304.10.6<sup>iii</sup>](#) and [IRC Section R317.3](#)) when recognized for use in untreated wood and ground contact pressure treated wood with waterborne alkaline copper quaternary, Type D (ACQ-D), to a minimum retention level of 0.40 pcf (6.4 kg/m<sup>3</sup>), exterior, freshwater, general construction applications (i.e., Above Ground AWPA UC1-UC4A ACQ-D).

#### 2.4.3 Fire Retardant Treated (FRT) Wood Applications

- 2.4.3.1 SPAX® PowerLags® proprietary coating systems designated as zinc, yellow zinc, HCR™, HCR-X™, and WIROX® are recognized for use in FRT lumber, provided the conditions set forth by the FRT lumber manufacturer are met, including appropriate strength reductions.

### 2.5 Wood Material

- 2.5.1 Wood main and side members must be solid-sawn lumber or boards having an assigned specific gravity as given in the respective tables of this report. Assigned specific gravity must be determined in accordance with NDS Table 12.3.3A.

- 2.6 The fasteners evaluated in this report are set forth in **Table 1**, **Table 2**, **Table 3**, **Table 4**, and **Table 5**.

**Table 1. #14 SPAX® PowerLags® Series Fastener Specifications<sup>5</sup>**

Fastener Designation	Head				Length (in)		Diameter (in)			Bending Yield Strength, <sup>3</sup> f <sub>yb</sub> (psi)	Allowable Steel Strength (lbs)	
	Style	Drive System	Diameter (in)	Height (in)	Fastener <sup>1</sup>	Thread <sup>2</sup>	Shank	Minor	Major		Tensile	Shear <sup>4</sup>
#14 x 4 <sup>3</sup> / <sub>4</sub> "	T-Star plus Cylindric Head	T-30 6 Lobe Recess	0.320	0.200	4 <sup>3</sup> / <sub>4</sub>	4.356	0.170	0.155	0.240	160,000	990	750
#14 x 6 <sup>1</sup> / <sub>4</sub> "					6 <sup>1</sup> / <sub>4</sub>	5.856						

SI: 1 in = 25.4 mm, 1 lb = 4.45 N, 1 psi = 0.00689 MPa

1. Fastener length is measured from the topside of the head to the tip.
2. Thread length includes tapered tip (**Figure 4**).
3. Bending yield strength, F<sub>yb</sub>, is determined in accordance with ASTM F1575 using minor thread diameter when fastener is tested in the threaded section.
4. Shear strength is determined in accordance with AISI S904 using minor thread diameter when fastener is tested in the threaded section.
5. Tabulated fastener dimensions are measured on uncoated fasteners. Finished dimensions are larger due to the proprietary coatings added.

**Table 2. 1/4" SPAX® PowerLags® Series Fastener Specifications<sup>5</sup>**

Fastener Designation	Head				Length (in)		Diameter (in)			Bending Yield Strength, <sup>3</sup> f <sub>yb</sub> (psi)	Allowable Steel Strength (lbs)	
	Style	Drive System	Diameter (in)	Height (in)	Fastener <sup>1</sup>	Thread <sup>2</sup>	Shank	Minor	Major		Tensile	Shear <sup>4</sup>
1/4 x 2"	Hex Washer Head	3/8" Hex Driver	0.545	0.210	2	1.770	0.195	0.170	0.276	158,000	1,160	995
1/4 x 2 <sup>1</sup> / <sub>2</sub> "					2 <sup>1</sup> / <sub>2</sub>	1.375						
1/4 x 3"					3	2.360						
1/4 x 3 <sup>1</sup> / <sub>2</sub> "					3 <sup>1</sup> / <sub>2</sub>	2.360						
All Longer Lengths					-	2.375						
1/4 x 2"	T-Star Washer Head	T-30 6 Lobe Recess	0.697	0.097	2	1.375	0.195	0.170	0.276	158,000	1,160	995
1/4 x 2 <sup>1</sup> / <sub>2</sub> "					2 <sup>1</sup> / <sub>2</sub>	1.375						
1/4 x 3"					3	1.790						
1/4 x 3 <sup>1</sup> / <sub>2</sub> "					3 <sup>1</sup> / <sub>2</sub>	1.960						
All Longer Lengths					-	2.375						

SI: 1 in = 25.4 mm, 1 lb = 4.45 N, 1 psi = 0.00689 MPa

1. Fastener length is measured from the underside of the head to the tip. These screws are manufactured in lengths up to 24 inches. See **Table 9** for additional available lengths.
2. Thread length includes tapered tip (see **Figure 1** and **Figure 2**).
3. Bending yield strength, F<sub>yb</sub>, is determined in accordance with ASTM F1575 using minor thread diameter when fastener is tested in threaded section.
4. Shear strength is determined in accordance with ASTM F1575 using shank diameter.
5. Tabulated fastener dimensions are measured on uncoated fasteners. Finished dimensions are larger due to the proprietary coatings added.

**Table 3.** 5/16" SPAX® PowerLags® Series Fastener Specifications<sup>5</sup>

Fastener Designation	Head				Length (in)		Diameter (in)			Bending Yield Strength, <sup>3</sup> f <sub>yb</sub> (psi)	Allowable Steel Strength (lbs)	
	Style	Drive System	Diameter (in)	Height (in)	Fastener <sup>1</sup>	Thread <sup>2</sup>	Shank	Minor	Major		Tensile	Shear <sup>4</sup>
5/16 x 2"	Hex Washer Head	7/16" Hex Driver	0.591	0.248	2	1.375	0.217	0.189	0.315	150,000	1,515	1,205
5/16 x 2 1/2"					2 1/2	1.375						
5/16 x 3"					3	2.360						
5/16 x 3 1/2"					3 1/2	2.993						
5/16 x 4"					4	2.993						
All Longer Lengths					-	2.375						
5/16 x 2"	T-Star Washer Head	T-40 6 Lobe Recess	0.776	0.140	2	1.375	0.217	0.189	0.315	150,000	1,515	1,205
5/16 x 2 1/2"					2 1/2	1.375						
5/16 x 3"					3	1.650						
5/16 x 3 1/2"					3 1/2	2.050						
5/16 x 4"					4	2.375						
All Longer Lengths					-	2.375						
5/16 x 2"	T-Star Pancake Head	T-40 6 Lobe Recess	0.610	0.085	2	1.375	0.217	0.189	0.315	150,000	1,515	1,205
5/16 x 2 1/2"					2 1/2	1.375						
5/16 x 3"					3	1.375						
5/16 x 3 1/2"					3 1/2	1.375						
5/16 x 4"					4	2.375						
All Longer Lengths					-	2.375						

SI: 1 in = 25.4 mm, 1 lb = 4.45 N, 1 psi = 0.00689 MPa

1. Fastener length is measured from the underside of the head to the tip. These screws are manufactured in lengths up to 24 inches. See **Table 10** for all available lengths.
2. Thread length includes tapered tip (see **Figure 1**, **Figure 2** and **Figure 3**).
3. Bending yield strength, F<sub>yb</sub>, is determined in accordance with ASTM F1575 using minor thread diameter when fastener is tested in the threaded section.
4. Shear strength is determined in accordance with ASTM F1575 using shank diameter.
5. Tabulated fastener dimensions are measured on uncoated fasteners. Finished dimensions are larger due to the proprietary coatings added.

**Table 4.** 3/8" SPAX® PowerLags® Series Fastener Specifications<sup>5</sup>

Fastener Designation	Head				Length (in)		Diameter (in)			Bending Yield Strength, <sup>3</sup> f <sub>yb</sub> (psi)	Allowable Steel Strength (lbs)	
	Style	Drive System	Diameter (in)	Height (in)	Fastener <sup>1</sup>	Thread <sup>2</sup>	Shank	Minor	Major		Tensile	Shear <sup>4</sup>
3/8 x 4"	Hex Washer Head	1/2" Hex Driver	0.748	0.307	4	2.375	0.270	0.236	0.394	144,000	2,430	1,855
3/8 x 4 1/2"					4 1/2	2.375						
All Longer Lengths					-	3.105						
3/8 x 4"	T-Star Washer Head	T-40 6 Lobe Recess	0.970	0.173	4	2.375	0.270	0.236	0.394	144,000	2,430	1,855
3/8 x 4 1/2"					4 1/2	2.375						
All Longer Lengths					-	3.105						

SI: 1 in = 25.4 mm, 1 lb = 4.45 N, 1 psi = 0.00689 MPa

1. Fastener length is measured from the underside of the head to the tip. These screws are manufactured in lengths up to 18 inches. See **Table 11** for all available lengths.
2. Thread length includes tapered tip (see **Figure 1** and **Figure 2**).
3. Bending yield strength, F<sub>yb</sub>, is determined in accordance with ASTM F1575 using minor thread diameter when fastener is tested in threaded section.
4. Shear strength is determined in accordance with ASTM F1575 using shank diameter.
5. Tabulated fastener dimensions are measured on uncoated fasteners. Finished dimensions are larger due to the proprietary coatings added.

**Table 5.** 1/2" SPAX® PowerLags® Series Fastener Specifications<sup>5</sup>

Fastener Designation	Head				Length (in)		Diameter (in)			Bending Yield Strength, <sup>3</sup> f <sub>yb</sub> (psi)	Allowable Steel Strength (lbs)	
	Style	Drive System	Diameter (in)	Height (in)	Fastener <sup>1</sup>	Thread <sup>2</sup>	Shank	Minor	Major		Tensile	Shear <sup>4</sup>
1/2" x All Lengths	Hex Washer Head	5/8" Hex Driver	0.858	0.394	-	3.150	0.335	0.295	0.480	166,000	3,415	3,245

SI: 1 in = 25.4 mm, 1 lb = 4.45 N, 1 psi = 0.00689 MPa

1. Fastener length is measured from the underside of the head to the tip. These screws are manufactured in lengths from 4 inches to 12 inches. See **Table 12** for all available lengths.
2. Thread length includes tapered tip (see **Figure 1**).
3. Bending yield strength, F<sub>yb</sub>, is determined in accordance with ASTM F1575 using minor thread diameter when fastener is tested in threaded section.
4. Shear strength is determined in accordance with ASTM F1575 using shank diameter.
5. Tabulated fastener dimensions are measured on uncoated fasteners. Finished dimensions are larger due to the proprietary coatings added.

2.7 As needed, review material properties for design in Section 6 and to regulatory evaluation in Section 8.

### 3 Definitions

- 3.1 New Materials<sup>iv</sup> are defined as building materials, equipment, appliances, systems, or methods of construction not provided for by prescriptive and/or legislatively adopted regulations, known as alternative materials.<sup>v</sup> The design strengths and permissible stresses shall be established by tests<sup>vi</sup> and/or engineering analysis.<sup>vii</sup>
- 3.2 Duly Authenticated Reports<sup>viii</sup> and Research Reports<sup>ix</sup> are test reports and related engineering evaluations, which are written by an approved agency<sup>x</sup> and/or an approved source.<sup>xi</sup>
  - 3.2.1 These reports contain intellectual property and/or trade secrets, which are protected by the Defend Trade Secrets Act (DTSA).<sup>xii</sup>



- 3.3 An approved agency is “approved” when it is ANAB ISO/IEC 17065 accredited. DrJ Engineering, LLC (DrJ) is listed in the ANAB directory.
- 3.4 An approved source is “approved” when a professional engineer (i.e., Registered Design Professional [RDP]) is properly licensed to transact engineering commerce. The regulatory authority governing approved sources is the state legislature via its professional engineering regulations.<sup>xiii</sup>
- 3.5 Testing and/or inspections conducted for this Duly Authenticated Report were performed by an ISO/IEC 17025 accredited testing laboratory, an ISO/IEC 17020 accredited inspection body, and/or a licensed RDP.
- 3.5.1 The Center for Building Innovation (CBI) is ANAB<sup>xiv</sup> ISO/IEC 17025 and ISO/IEC 17020 accredited.
- 3.6 The regulatory authority shall enforce<sup>xv</sup> the specific provisions of each legislatively adopted regulation. If there is a non-conformance, the specific regulatory section and language of the non-conformance shall be provided in writing<sup>xvi</sup> stating the nonconformance and the path to its cure.
- 3.7 The regulatory authority shall accept Duly Authenticated Reports from an approved agency and/or an approved source with respect to the quality and manner of use of new materials or assemblies as provided for in regulations regarding the use of alternative materials, designs, or methods of construction.<sup>xvii</sup>
- 3.8 ANAB is an International Accreditation Forum (IAF) Multilateral Recognition Arrangement (MLA) signatory where recognition of certificates, validation, and verification statements issued by conformity assessment bodies accredited by all other signatories of the IAF MLA with the appropriate scope, shall be approved.<sup>xviii</sup> Therefore, all ANAB ISO/IEC 17065 Duly Authenticated Reports are approval equivalent.<sup>xix</sup>
- 3.9 Approval equity is a fundamental commercial and legal principle.<sup>xx</sup>

#### **4 Applicable Standards for the Listing; Regulations for the Regulatory Evaluation<sup>xxi</sup>**

##### **4.1 Standards**

- 4.1.1 *AISI S904: Standard Test Methods for Determining the Tensile and Shear Strengths of Screws*
- 4.1.2 *ANSI/AWC NDS: National Design Specification (NDS) for Wood Construction*
- 4.1.3 *ASTM A153: Standard Specification for Zinc Coating (Hot-Dip) on Iron and Steel Hardware*
- 4.1.4 *ASTM A510: Standard Specification for General Requirements for Wire Rods and Coarse Round Wire, Carbon Steel, and Alloy Steel*
- 4.1.5 *ASTM B117: Standard Practice for Operating Salt Spray (Fog) Apparatus*
- 4.1.6 *ASTM D1037: Standard Test Methods for Evaluating Properties of Wood-Base Fiber and Particle Panel Materials*
- 4.1.7 *ASTM D1761: Standard Test Methods for Mechanical Fasteners in Wood*
- 4.1.8 *ASTM F606: Standard Test Methods for Determining the Mechanical Properties of Externally and Internally Threaded Fasteners, Washers, Direct Tension Indicators, and Rivets*
- 4.1.9 *ASTM F1575: Standard Test Method for Determining Bending Yield Moment of Nails*
- 4.1.10 *ASTM G85: Standard Practice for Modified Salt Spray (Fog) Testing*





## 4.2 Regulations

- 4.2.1 IBC – 15, 18, 21: *International Building Code®*
- 4.2.2 IRC – 15, 18, 21: *International Residential Code®*
- 4.2.3 FBC-B—20, 23: *Florida Building Code – Building<sup>xxii</sup> (FL 40711)*
- 4.2.4 FBC-R—20, 23: *Florida Building Code – Residential<sup>xxii</sup> (FL 40711)*
- 4.2.5 CBC—16, 19: *California Building Code (Title 24, Part 2)<sup>xxiii</sup>*
- 4.2.6 CRC—16, 19: *California Residential Code (Title 24, Part 2.5)<sup>xxiii</sup>*
- 4.2.7 LABC—17, 20: *Los Angeles Building Code<sup>xxiv</sup>*
- 4.2.8 LARC—17, 20: *Los Angeles Residential Code<sup>xxiv</sup>*

## 5 Listed<sup>xxv</sup>

- 5.1 A nationally recognized testing laboratory such as CBI, states that the materials, designs, methods of construction and/or equipment have met nationally recognized standards and/or have been tested and found suitable for use in a specified manner.

## 6 Tabulated Properties Generated from Nationally Recognized Standards

- 6.1 SPAX® PowerLags® are used to attach wood framing members in conventional light-frame construction and provide resistance against head pull-through, withdrawal, and shear loads.
- 6.2 *Design*
  - 6.2.1 Design of SPAX® PowerLags® is governed by the applicable code and the provisions for dowel-type fasteners in NDS.
  - 6.2.2 Unless otherwise noted, adjustment of the design stresses for duration of load shall be in accordance with the applicable code.



### 6.3 Head Pull-Through Design Values

6.3.1 Reference design values for head pull-through for SPAX® PowerLags® are specified in **Table 6**.

**Table 6.** Reference Pull-Through Design Values (P) for SPAX® PowerLags®

Fastener Series	Head Style	Pull-Through Design Value, <sup>1,2</sup> P (lbf)		
		Wood Species (Specific Gravity) <sup>3</sup>		
		SP (0.55)	DF-L (0.50)	SPF/HF (0.42)
#14 SPAX® PowerLags®	T-Star plus Cylindric Head	285	285	235
1/4" SPAX® PowerLags®	Hex Washer Head	700	640	455
	T-Star Washer Head	850	785	585
5/16" SPAX® PowerLags®	Hex Washer Head	755	680	500
	T-Star Washer Head	965	840	665
	T-Star Pancake Head	810	735	560
3/8" SPAX® PowerLags®	Hex Washer Head	985	825	575
	T-Star Washer Head	1245	1085	880
1/2" SPAX® PowerLags®	Hex Washer Head	1185	970	865
SI: 1 in = 25.4 mm, 1 lb = 4.45 N 1. Minimum 1.5" wood member thickness 2. Tabulated pull-through values shall be adjusted by all applicable adjustment factors per NDS Table 11.3.1. 3. For wood species with an assigned specific gravity between 0.42 and 0.50, use the tabulated values for specific gravity (SG) of 0.42. For wood species with an assigned specific gravity between 0.50 and 0.55, use the tabulated values for specific gravity of 0.50. For wood species with an assigned specific gravity greater than or equal to 0.55, use the tabulated values for specific gravity of 0.55.				

## 6.4 Reference Withdrawal Design Values in Face Grain Applications

6.4.1 Reference withdrawal design values for SPAX® PowerLags® fasteners are specified in **Table 7**.

**Table 7.** Reference Withdrawal Design Values (W) for SPAX® PowerLags® Fasteners in Face Grain

Fastener Series	Head Style	Reference Withdrawal Design Values, <sup>1,2</sup> W (lbf/in)		
		Wood Species (Specific Gravity <sup>3</sup> )		
		SP (0.55)	DF-L (0.50)	SPF/HF (0.42)
#14 SPAX® PowerLags®	T-Star plus Cylindric Head	205	130	130
1/4" SPAX® PowerLags®	Hex Washer Head	375	310	245
	T-Star Washer Head			
5/16" SPAX® PowerLags®	Hex Washer Head	415	300	250
	T-Star Washer Head			
	T-Star Pancake Head			
3/8" SPAX® PowerLags®	Hex Washer Head	465	300	280
	T-Star Washer Head			
1/2" SPAX® PowerLags®	Hex Washer Head	445	275	275

SI: 1 in = 25.4 mm, 1 lb = 4.45 N, 1 lb/ft = 0.0146 kN/m

- Tabulated withdrawal values shall be adjusted by all applicable adjustment factors per NDS Table 11.3.1.
- Full withdrawal strength is calculated by multiplying the length of thread embedded in the main member by the tabulated reference withdrawal values.
- For wood species with an assigned specific gravity between 0.42 and 0.50, use the tabulated values for specific gravity of 0.42. For wood species with an assigned specific gravity between 0.50 and 0.55, use the tabulated values for specific gravity of 0.50. For wood species with an assigned specific gravity greater than or equal to 0.55, use the tabulated values for specific gravity of 0.55.

## 6.5 Lateral Design Values

6.5.1 Reference lateral design values for shear load parallel and perpendicular to grain for SPAX® PowerLags® fasteners are specified in **Table 8**, **Table 9**, **Table 10**, **Table 11**, and **Table 12**.

**Table 8.** #14 SPAX® PowerLags® Fasteners Lateral Design Values

Fastener Designation	Minimum Main Member Penetration <sup>1</sup> (in)	Minimum Side Member Thickness (in)	Reference Lateral Shear Value, <sup>4,5,6</sup> Z (lbf)					
			Wood Species (Specific Gravity) <sup>2,3</sup>					
			SP (0.55)		DF-L (0.50)		SPF/HF (0.42)	
			Z <sub>  </sub>	Z <sub>⊥</sub>	Z <sub>  </sub>	Z <sub>⊥</sub>	Z <sub>  </sub>	Z <sub>⊥</sub>
#14 x 4 3/4"	1.5	1.5	185	185	170	170	145	145
#14 x 6 1/4"								

SI: 1 in = 25.4 mm, 1 lbf = 4.45 N

- Penetration depth includes the length of tapered tip.
- The species applies to both the main and side members. Where the members are different specific gravities, use the lower of the two.
- For wood species with an assigned specific gravity between 0.42 and 0.50, use the tabulated values for specific gravity of 0.42. For wood species with an assigned specific gravity between 0.50 and 0.55, use the tabulated values for specific gravity of 0.50. For wood species with an assigned specific gravity greater than or equal to 0.55, use the tabulated values for specific gravity of 0.55.
- The fastener shall be oriented perpendicular to grain, and the underside of the fastener head shall be installed flush with the surface of the side member.
- Z<sub>⊥</sub> = Lateral Design Values Perpendicular to Grain, Z<sub>||</sub> = Lateral Design Values Parallel to Grain.
- Tabulated lateral design values shall be adjusted by all applicable adjustment factors per NDS Table 11.3.1.

**Table 9. 1/4" SPAX® PowerLags® Fasteners Lateral Design Values**

Fastener Designation	Minimum Main Member Penetration <sup>1</sup> (in)	Minimum Side Member Thickness (in)	Reference Lateral Shear Value, <sup>4,5,6</sup> Z (lbf)					
			Wood Species (Specific Gravity) <sup>2,3</sup>					
			SP (0.55)		DF-L (0.50)		SPF/HF (0.42)	
			Z <sub>  </sub>	Z <sub>⊥</sub>	Z <sub>  </sub>	Z <sub>⊥</sub>	Z <sub>  </sub>	Z <sub>⊥</sub>
1/4 x 2"	1.375	0.625	305	285	265	235	250	225
1/4 x 2 1/2"								
1/4 x 3"								
1/4 x 3 1/2"								
1/4 x 4"	2.375	1.5	400	370	360	335	350	310
1/4 x 4 1/2"								
1/4 x 5"								
1/4 x 5 1/2"								
1/4 x 6"								
1/4 x 6 1/2"								
1/4 x 7"								
1/4 x 7 1/2"								
1/4 x 8"								
1/4 x 8 1/2"								
1/4 x 9"								
1/4 x 10"								
1/4 x 11"								
1/4 x 12"								
1/4 x 13"								
1/4 x 14"								
1/4 x 15"								
1/4 x 16"								
1/4 x 18"								
1/4 x 20"								
1/4 x 22"								
1/4 x 24"								

SI: 1 in = 25.4 mm, 1 lbf = 4.45 N

1. Penetration depth includes the length of tapered tip.
2. The species applies to both the main and side members. Where the members are different specific gravities, use the lower of the two.
3. For wood species with an assigned specific gravity between 0.42 and 0.50, use the tabulated values for specific gravity of 0.42. For wood species with an assigned specific gravity between 0.50 and 0.55, use the tabulated values for specific gravity of 0.50. For wood species with an assigned specific gravity greater than or equal to 0.55, use the tabulated values for specific gravity of 0.55.
4. The fastener shall be oriented perpendicular to grain, and the underside of the fastener head shall be installed flush with the surface of the side member.
5. Z<sub>⊥</sub> = Lateral Design Values Perpendicular to Grain, Z<sub>||</sub> = Lateral Design Values Parallel to Grain.
6. Tabulated lateral design values shall be adjusted by all applicable adjustment factors per NDS Table 11.3.1.

**Table 10.**  $\frac{5}{16}$ " SPAX® PowerLags® Lateral Design Values

Fastener Designation	Minimum Main Member Penetration <sup>1</sup> (in)	Minimum Side Member Thickness (in)	Reference Lateral Shear Value, <sup>4,5,6</sup> Z (lbf)					
			Wood Species (Specific Gravity) <sup>2,3</sup>					
			SP (0.55)		DF-L (0.50)		SPF/HF (0.42)	
			Z <sub>  </sub>	Z <sub>⊥</sub>	Z <sub>  </sub>	Z <sub>⊥</sub>	Z <sub>  </sub>	Z <sub>⊥</sub>
$\frac{5}{16}$ X 2"	1.375	0.625	340	305	310	280	265	230
$\frac{5}{16}$ X 2½"								
$\frac{5}{16}$ X 3"								
$\frac{5}{16}$ X 3½"								
$\frac{5}{16}$ X 4"	2.375	1.5	440	405	405	375	380	355
$\frac{5}{16}$ X 4½"								
$\frac{5}{16}$ X 5"								
$\frac{5}{16}$ X 5½"								
$\frac{5}{16}$ X 6"								
$\frac{5}{16}$ X 6½"								
$\frac{5}{16}$ X 7"								
$\frac{5}{16}$ X 7½"								
$\frac{5}{16}$ X 8"								
$\frac{5}{16}$ X 8½"								
$\frac{5}{16}$ X 9"								
$\frac{5}{16}$ X 10"								
$\frac{5}{16}$ X 11"								
$\frac{5}{16}$ X 12"								
$\frac{5}{16}$ X 13"								
$\frac{5}{16}$ X 14"								
$\frac{5}{16}$ X 15"								
$\frac{5}{16}$ X 16"								
$\frac{5}{16}$ X 18"								
$\frac{5}{16}$ X 20"								
$\frac{5}{16}$ X 22"								
$\frac{5}{16}$ X 24"								

SI: 1 in = 25.4 mm, 1 lbf = 4.45 N

1. Penetration depth includes the length of tapered tip.
2. The species applies to both the main and side members. Where the members are different specific gravities, use the lower of the two.
3. For wood species with an assigned specific gravity between 0.42 and 0.50, use the tabulated values for specific gravity of 0.42. For wood species with an assigned specific gravity between 0.50 and 0.55, use the tabulated values for specific gravity of 0.50. For wood species with an assigned specific gravity greater than or equal to 0.55, use the tabulated values for specific gravity of 0.55.
4. The fastener shall be oriented perpendicular to grain, and the underside of the fastener head shall be installed flush with the surface of the side member.
5. Z<sub>⊥</sub> = Lateral Design Values Perpendicular to Grain, Z<sub>||</sub> = Lateral Design Values Parallel to Grain.
6. Tabulated lateral design values shall be adjusted by all applicable adjustment factors per NDS Table 11.3.1.

**Table 11.** 3/8" SPAX® PowerLags® Lateral Design Values

Fastener Designation	Minimum Main Member Penetration <sup>1</sup> (in)	Minimum Side Member Thickness (in)	Reference Lateral Shear Value, <sup>4,5,6</sup> Z (lbf)					
			Wood Species (Specific Gravity) <sup>2,3</sup>					
			SP (0.55)		DF-L (0.50)		SPF/HF (0.42)	
			Z <sub>  </sub>	Z <sub>⊥</sub>	Z <sub>  </sub>	Z <sub>⊥</sub>	Z <sub>  </sub>	Z <sub>⊥</sub>
3/8 x 4"	2.375	1.5	530	485	475	440	445	405
3/8 x 4 1/2"								
3/8 x 5"								
3/8 x 5 1/2"								
3/8 x 6"								
3/8 x 6 1/2"								
3/8 x 7"								
3/8 x 7 1/2"								
3/8 x 8"								
3/8 x 8 1/2"								
3/8 x 9"								
3/8 x 10"								
3/8 x 11"								
3/8 x 12"								
3/8 x 13"								
3/8 x 14"								
3/8 x 15"								
3/8 x 16"								
3/8 x 18"								

SI: 1 in = 25.4 mm, 1 lbf = 4.45 N

1. Penetration depth includes the length of tapered tip.
2. The species applies to both the main and side members. Where the members are different specific gravities, use the lower of the two.
3. For wood species with an assigned specific gravity between 0.42 and 0.50, use the tabulated values for specific gravity of 0.42. For wood species with an assigned specific gravity between 0.50 and 0.55, use the tabulated values for specific gravity of 0.50. For wood species with an assigned specific gravity greater than or equal to 0.55, use the tabulated values for specific gravity of 0.55.
4. The fastener shall be oriented perpendicular to grain, and the underside of the fastener head shall be installed flush with the surface of the side member.
5. Z<sub>⊥</sub> = Lateral Design Values Perpendicular to Grain, Z<sub>||</sub> = Lateral Design Values Parallel to Grain.
6. Tabulated lateral design values shall be adjusted by all applicable adjustment factors per NDS Table 11.3.1.

**Table 12. 1/2" SPAX® PowerLags® Lateral Design Values**

Fastener Designation	Minimum Main Member Penetration <sup>1</sup> (in)	Minimum Side Member Thickness (in)	Reference Lateral Shear Value, <sup>4,5,6</sup> Z (lbf)					
			Wood Species (Specific Gravity) <sup>2,3</sup>					
			SP (0.55)		DF-L (0.50)		SPF/HF (0.42)	
			Z <sub>  </sub>	Z <sub>⊥</sub>	Z <sub>  </sub>	Z <sub>⊥</sub>	Z <sub>  </sub>	Z <sub>⊥</sub>
1/2 x 4"	2.375	1.5	585	475	550	400	500	370
1/2 x 4 1/2"								
1/2 x 5"								
1/2 x 5 1/2"								
1/2 x 6"								
1/2 x 6 1/2"								
1/2 x 7"								
1/2 x 7 1/2"								
1/2 x 8"								
1/2 x 8 1/2"								
1/2 x 9"								
1/2 x 10"								
1/2 x 11"								
1/2 x 12"								

SI: 1 in = 25.4 mm, 1 lbf = 4.45 N

1. Penetration depth includes the length of tapered tip.
2. The species applies to both the main and side members. Where the members are different specific gravities, use the lower of the two.
3. For wood species with an assigned specific gravity between 0.42 and 0.50, use the tabulated values for specific gravity of 0.42. For wood species with an assigned specific gravity between 0.50 and 0.55, use the tabulated values for specific gravity of 0.50. For wood species with an assigned specific gravity greater than or equal to 0.55, use the tabulated values for specific gravity of 0.55.
4. The fastener shall be oriented perpendicular to grain, and the underside of the fastener head shall be installed flush with the surface of the side member.
5. Z<sub>⊥</sub> = Lateral Design Values Perpendicular to Grain, Z<sub>||</sub> = Lateral Design Values Parallel to Grain.
6. Tabulated lateral design values shall be adjusted by all applicable adjustment factors per NDS Table 11.3.1.

6.6 Where the application falls outside of the performance evaluation, conditions of use, and/or installation requirements set forth herein, alternative techniques shall be permitted in accordance with accepted engineering practice and experience. This includes but is not limited to the following areas of engineering: mechanics or materials, structural, building science, and fire science.

## 7 Certified Performance<sup>xxvi</sup>

- 7.1 All construction methods shall conform to accepted engineering practices to ensure durable, livable, and safe construction and shall demonstrate acceptable workmanship reflecting journeyman quality of work of the various trades.<sup>xxvii</sup>
- 7.2 The strength and rigidity of the component parts and/or the integrated structure shall be determined by engineering analysis or by suitable load tests to simulate the actual loads and conditions of application that occur.<sup>xxviii</sup>

## 8 Regulatory Evaluation and Accepted Engineering Practice

- 8.1 SPAX® PowerLags® Series Structural Wood Fasteners comply with the following legislatively adopted regulations and/or accepted engineering practice for the following reasons:
- 8.1.1 SPAX® PowerLags® were tested and evaluated to determine their structural resistance properties, which are used to develop reference design values for allowable stress design (ASD). The following properties were evaluated:
- 8.1.1.1 Bending yield in accordance with ASTM F1575
  - 8.1.1.2 Tensile strength in accordance with ASTM F606 and AISI S904
  - 8.1.1.3 Shear strength in accordance with ASTM F1575 and AISI S904
  - 8.1.1.4 Head pull-through in accordance with ASTM D1037 and ASTM D1761
  - 8.1.1.5 Withdrawal strength in accordance with ASTM D1761
  - 8.1.1.6 Lateral resistance in accordance with ASTM D1761 and NDS
  - 8.1.1.7 Corrosion resistance in accordance with ASTM B117 and ASTM G85
- 8.1.2 Use of fasteners in locations exposed to saltwater or saltwater spray is outside the scope of this report.
- 8.1.3 For connection design values for truss/rafter/joist to walls, stud to plate, and plate to rim board connections see Report Number 1910-02.
- 8.2 Any building code, regulation and/or accepted engineering evaluations (i.e., research reports, duly authenticated reports, etc.) that are conducted for this report were performed by DrJ Engineering, LLC (DrJ), an ISO/IEC 17065 accredited certification body and a professional engineering company operated by RDP/approved sources. DrJ is qualified<sup>xxix</sup> to practice product and regulatory compliance services within its scope of accreditation and engineering expertise, respectively.
- 8.3 Engineering evaluations are conducted with DrJ's ANAB accredited ICS code scope of expertise, which are also its areas of professional engineering competence.
- 8.4 Any regulation specific issues not addressed in this section are outside the scope of this report.

## 9 Installation

- 9.1 Installation shall comply with the approved construction documents, the manufacturer installation instructions, this report, and the applicable building code.
- 9.2 In the event of a conflict between the manufacturer installation instructions and this report, the more restrictive shall govern.
- 9.3 SPAX® PowerLags® shall be installed using the driver bits specified in **Table 1, Table 2, Table 3, Table 4, and Table 5**, as applicable.
- 9.4 Fasteners shall not be struck with a hammer during installation.
- 9.5 *Lead Hole Requirements*
- 9.5.1 Lead holes are not required for #14, 1/4", and 5/16" SPAX® PowerLags®.
  - 9.5.2 Lead holes of 0.172" (4.37 mm) diameter are required for 3/8" SPAX® PowerLags®.
  - 9.5.3 Lead holes of 0.203" (5.16 mm) diameter are required for 1/2" SPAX® PowerLags®.
- 9.6 The fastener head must be installed flush to the surface of the wood side member being connected. The fastener must not be overdriven.
- 9.7 Minimum main member penetration is 1 1/2" unless otherwise stated in this report.
- 9.8 Minimum requirements for fastener spacing, edge distance, and end distance shall be in accordance with **Table 13**.



**Table 13.** Minimum Spacing, Edge Distance, and End Distance Requirements

Connection Geometry	Minimum Spacing/Distance <sup>1,2,3</sup> (in)				
	#14	1/4"	5/16"	3/8"	1/2"
Edge Distance – Load in any direction	1/2	1/2	5/8	2 1/4	2 3/4
End Distance – Load parallel to grain, towards end	2 5/8	3	3 3/8	4 1/2	5 1/2
End Distance – Load parallel to grain, away from end	1 3/4	2	2 1/4	1 3/8	1 3/4
End Distance – Load perpendicular to grain	1 3/4	2	2 1/4	1 3/8	1 3/4
Spacing between Fasteners in a Row – Parallel to grain	2 5/8	3	3 3/8	2 3/4	3 3/4
Spacing between Fasteners in a Row – Perpendicular to grain	1 3/4	2	2 1/4	1 3/8	1 3/4
Spacing between Rows of Fasteners – In-line	7/8	1	1 1/8	See NDS Table 12.5.1D	
Spacing between Rows of Fasteners – Staggered	1/2	1/2	5/8		
SI: 1 in = 25.4 mm					
1. Edge distances, end distances, and spacing of fasteners shall be sufficient to prevent splitting of the wood or as shown in this table, whichever is more restrictive.					
2. Values for "Spacing between Rows of Fasteners – Staggered" apply where the fasteners in adjacent rows are offset by one half of the "Spacing between Fasteners in a Row."					
3. 3/8" and 1/2" diameter screws require lead holes. See Section 9.5 for lead hole requirements.					

## 10 Substantiating Data

- 10.1 Testing has been performed under the supervision of a professional engineer and/or under the requirements of ISO/IEC 17025 as follows:
  - 10.1.1 Bending yield testing in accordance with ASTM F1575
  - 10.1.2 Tensile strength testing in accordance with AISI S904
  - 10.1.3 Shear strength testing in accordance with AISI S904
  - 10.1.4 Head pull-through testing in accordance with ASTM D1761
  - 10.1.5 Withdrawal testing in accordance with ASTM D1761
  - 10.1.6 Lateral connection testing in accordance with ASTM D1761
  - 10.1.7 Corrosion resistance testing in accordance with ASTM B117 and ASTM G85
- 10.2 Information contained herein may include the result of testing and/or data analysis by sources that are approved agencies, approved sources, and/or RDPs. Accuracy of external test data and resulting analysis is relied upon.
- 10.3 Where pertinent, testing and/or engineering analysis are based upon provisions that have been codified into law through state or local adoption of regulations and standards. The developers of these regulations and standards are responsible for the reliability of published content. DrJ's engineering practice may use a regulation-adopted provision as the control. A regulation-endorsed control versus a simulation of the conditions of application to occur establishes a new material as being equivalent to the regulatory provision in terms of quality, strength, effectiveness, fire resistance, durability, and safety.
- 10.4 The accuracy of the provisions provided herein may be reliant upon the published properties of raw materials, which are defined by the grade mark, grade stamp, mill certificate, or duly authenticated reports from approved agencies and/or approved sources provided by the supplier. These are presumed to be minimum properties and relied upon to be accurate. The reliability of DrJ's engineering practice, as contained in this duly authenticated report, may be dependent upon published design properties by others.
- 10.5 Testing and engineering analysis: The strength, rigidity, and/or general performance of component parts and/or the integrated structure are determined by suitable tests that simulate the actual conditions of application that occur and/or by accepted engineering practice and experience.<sup>xxx</sup>



- 10.6 Where additional condition of use and/or regulatory compliance information is required, please search for SPAX® PowerLags® Series Structural Wood Fasteners on the [DrJ Certification](#) website.

## 11 Findings

- 11.1 As outlined in Section 6, SPAX® PowerLags® Series Structural Wood Fasteners have performance characteristics that were tested and/or meet applicable regulations and are suitable for use pursuant to its specified purpose.
- 11.2 When used and installed in accordance with this [duly authenticated report](#) and the manufacturer installation instructions, SPAX® PowerLags® Series Structural Wood Fasteners shall be approved for the following applications:
- 11.2.1 Provide resistance to head pull-through loads as shown in **Table 6**.
- 11.2.2 Provide resistance to reference withdrawal loads as shown in **Table 7**.
- 11.3 Unless exempt by state statute, when SPAX® PowerLags® Series Structural Wood Fasteners are to be used as a structural and/or building envelope component in the design of a specific building, the design shall be performed by an [RDP](#).
- 11.4 Any application specific issues not addressed herein can be engineered by an [RDP](#). Assistance with engineering is available from Altenloh, Brinck & Company U.S., Inc.
- 11.5 [IBC Section 104.11](#) ([IRC Section R104.11](#) and [IFC Section 104.10](#)<sup>xxxii</sup> are similar) in pertinent part states:
- 104.11 Alternative materials, design and methods of construction and equipment.** The provisions of this code are not intended to prevent the installation of any material or to prohibit any design or method of construction not specifically prescribed by this code. Where the alternative material, design or method of construction is not approved, the building official shall respond in writing, stating the reasons the alternative was not approved.
- 11.6 **Approved:**<sup>xxxii</sup> Building regulations require that the [building official](#) shall accept [duly authenticated reports](#).<sup>xxxiii</sup>
- 11.6.1 An [approved agency](#) is “approved” when it is [ANAB ISO/IEC 17065 accredited](#).
- 11.6.2 An [approved source](#) is “approved” when an [RDP](#) is properly licensed to transact engineering commerce.
- 11.6.3 Federal law, [Title 18 US Code Section 242](#), requires that where the alternative product, material, service, design, assembly, and/or method of construction is not approved, the building official shall respond in writing, stating the reasons why the alternative was not approved. Denial without written reason deprives a protected right to free and fair competition in the marketplace.
- 11.7 DrJ is a licensed engineering company, employs licensed RDPs and is an [ANAB-Accredited Product Certification Body – Accreditation #1131](#).
- 11.8 Through the [IAF Multilateral Agreements](#) (MLA), this [Duly Authenticated Report](#) can be used to obtain product approval in any [jurisdiction](#) or [country](#) because all ANAB ISO/IEC 17065 [Duly Authenticated Reports](#) are equivalent.<sup>xxxiv</sup>

## 12 Conditions of Use

- 12.1 Material properties shall not fall outside the boundaries defined in Section 6.
- 12.2 As defined in Section 6, where material and/or engineering mechanics properties are created for load resisting design purposes, the resistance to the applied load shall not exceed the ability of the defined properties to resist those loads using the principles of accepted engineering practice.
- 12.3 Wood main and side members must have a moisture content of less than or equal to 19 percent. Where fasteners are installed in a wet service condition, the appropriate reduction factors shall be applied per NDS Table 11.3.1.
- 12.4 Use of fasteners in locations exposed to saltwater or saltwater spray is outside the scope of this report.



- 12.5 In cases where fastener metal capacity (instead of the wood member) controls the connection design, the allowable connection strength shall not be multiplied by the adjustment factors specified in NDS.
- 12.6 When required by adopted legislation and enforced by the building official, also known as the authority having jurisdiction (AHJ) in which the project is to be constructed:
- 12.6.1 Any calculations incorporated into the construction documents shall conform to accepted engineering practice and, when prepared by an approved source, shall be approved when signed and sealed.
  - 12.6.2 This report and the installation instructions shall be submitted at the time of permit application.
  - 12.6.3 These innovative products have an internal quality control program and a third-party quality assurance program.
  - 12.6.4 At a minimum, these innovative products shall be installed per Section 9 of this report.
  - 12.6.5 The review of this report by the AHJ shall comply with IBC Section 104 and IBC Section 105.4.
  - 12.6.6 These innovative products have an internal quality control program and a third party quality assurance program in accordance with IBC Section 104.4, IBC Section 110.4, IBC Section 1703, IRC Section R104.4, and IRC Section R109.2.
  - 12.6.7 The application of these innovative products in the context of this report is dependent upon the accuracy of the construction documents, implementation of installation instructions, inspection as required by IBC Section 110.3, IRC Section R109.2, and any other regulatory requirements that may apply.
- 12.7 The approval of this report by the AHJ shall comply with IBC Section 1707.1, where legislation states in part, *"the building official shall accept duly authenticated reports from approved agencies in respect to the quality and manner of use of new material or assemblies as provided for in Section 104.11,"* all of IBC Section 104, and IBC Section 105.4.
- 12.8 Design loads shall be determined in accordance with the regulations adopted by the jurisdiction in which the project is to be constructed and/or by the building designer (i.e., owner or RDP).
- 12.9 The actual design, suitability and use of this report for any particular building, is the responsibility of the owner or the authorized agent of the owner.



### 13 Identification

- 13.1 The innovative products listed in Section 1.1 are identified by a label on the board or packaging material bearing the manufacturer name, product name, this report number, and other information to confirm code compliance.
- 13.2 Additional technical information can be found at [www.spax.us](http://www.spax.us).

### 14 Review Schedule

- 14.1 This report is subject to periodic review and revision. For the latest version, visit [drjcertification.org](http://drjcertification.org).
- 14.2 For information on the status of this report, please contact [DrJ Certification](#).

### 15 Approved for Use Pursuant to U.S. and International Legislation Defined in Appendix A

- 15.1 SPAX® PowerLags® Series Structural Wood Fasteners are included in this report published by an approved agency that is concerned with evaluation of products or services, maintains periodic inspection of the production of listed materials or periodic evaluation of services. This report states either that the material, product, or service meets recognized standards or has been tested and found suitable for a specified purpose. This report meets the legislative intent and definition of being acceptable to the AHJ.



## Appendix A

### 1 Legislation that Authorizes AHJ Approval

- 1.1 **Fair Competition:** State legislatures have adopted Federal regulations for the examination and approval of building code referenced and alternative products, materials, designs, services, assemblies and/or methods of construction that:
  - 1.1.1 Advance Innovation,
  - 1.1.2 Promote competition so all businesses have the opportunity to compete on price and quality in an open market on a level playing field unhampered by anticompetitive constraints, and
  - 1.1.3 Benefit consumers through lower prices, better quality and greater choice.
- 1.2 **Adopted Legislation:** The following local, state and federal regulations affirmatively authorize these innovative products to be approved by AHJs, delegates of building departments and/or delegates of an agency of the federal government:
  - 1.2.1 Interstate commerce is governed by the Federal Department of Justice to encourage the use of innovative products, materials, designs, services, assemblies and/or methods of construction. The goal is to “protect economic freedom and opportunity by promoting free and fair competition in the marketplace.”
  - 1.2.2 Title 18 US Code Section 242 affirms and regulates the right of individuals and businesses to freely and fairly have new products, materials, designs, services, assemblies and/or methods of construction approved for use in commerce. Disapproval of alternatives shall be based upon non-conformance with respect to specific provisions of adopted legislation and shall be provided in writing stating the reasons why the alternative was not approved, with reference to the specific legislation violated.
  - 1.2.3 The federal government and each state have a public records act. In addition, each state also has legislation that mimics the federal Defend Trade Secrets Act 2016 (DTSA),<sup>xxxv</sup> where providing test reports, engineering analysis and/or other related IP/TS is subject to prison of not more than ten years<sup>xxxvi</sup> and/or a \$5,000,000 fine or 3 times the value of<sup>xxxvii</sup> the Intellectual Property (IP) and Trade Secrets (TS).
    - 1.2.3.1 Compliance with public records and trade secret legislation requires approval through the use of Listings, certified reports, Technical Evaluation Reports, duly authenticated reports and/or research reports prepared by approved agencies and/or approved sources.
  - 1.2.4 For new materials<sup>xxxviii</sup> that are not specifically provided for in any regulation, the design strengths and permissible stresses shall be established by tests, where suitable load tests simulate the actual loads and conditions of application that occur.
  - 1.2.5 The design strengths and permissible stresses of any structural material shall conform to the specifications and methods of design using accepted engineering practice.<sup>xxxix</sup>
  - 1.2.6 The commerce of approved sources (i.e., registered PEs) is regulated by professional engineering legislation. Professional engineering commerce shall always be approved by AHJs, except where there is evidence provided in writing, that specific legislation has been violated by an individual registered PE.
  - 1.2.7 The AHJ shall accept duly authenticated reports from approved agencies in respect to the quality and manner of use of new materials or assemblies as provided for in IBC Section 104.11.<sup>xl</sup>



- 1.3 **Approved<sup>xli</sup> by Los Angeles:** The Los Angeles Municipal Code (LAMC) states in pertinent part that the provisions of LAMC are not intended to prevent the use of any material, device, or method of construction not specifically prescribed by LAMC. The Department shall use Part III, Recognized Standards in addition to Part II, Uniform Building Code Standards of Division 35, Article 1, Chapter IX of the LAMC in evaluation of products for approval where such standard exists for the product or the material and may use other approved standards that apply. Whenever tests or certificates of any material or fabricated assembly are required by Chapter IX of the LAMC, such tests or certification shall be made by a testing agency approved by the Superintendent of Building to conduct such tests or provide such certifications. The testing agency shall publish the scope and limitation(s) of the listed material or fabricated assembly.<sup>xlii</sup> The Superintendent of Building Approved Testing Agency Roster is provided by the Los Angeles Department of Building and Safety (LADBS). The Center for Building Innovation (CBI) Certificate of Approval License is TA24945. Tests and certifications found in a DrJ Listing are LAMC approved. In addition, the Superintendent of Building shall accept duly authenticated reports from approved agencies in respect to the quality and manner of use of new materials or assemblies as provided for in the California Building Code (CBC) Section 1707.1.<sup>xliii</sup>
- 1.4 **Approved by Chicago:** The Municipal Code of Chicago (MCC) states in pertinent part that an Approved Agency is a Nationally Recognized Testing Laboratory (NRTL) acting within its recognized scope and/or a certification body accredited by the American National Standards Institute (ANSI) acting within its accredited scope. Construction materials and test procedures shall conform to the applicable standards listed in the MCC. Sufficient technical data shall be submitted to the building official to substantiate the proposed use of any product, material, service, design, assembly and/or method of construction not specifically provided for in the MCC. This technical data shall consist of research reports from approved sources (i.e., MCC defined Approved Agencies).
- 1.5 **Approved by New York City:** The 2022 NYC Building Code (NYCBC) states in part that an approved agency shall be deemed<sup>xliv</sup> an approved testing agency via ISO/IEC 17025 accreditation, an approved inspection agency via ISO/IEC 17020 accreditation and an approved product evaluation agency via ISO/IEC 17065 accreditation. Accrediting agencies, other than federal agencies, must be members of an internationally recognized cooperation of laboratory and inspection accreditation bodies subject to a mutual recognition agreement<sup>xlv</sup> (i.e., ANAB, International Accreditation Forum (IAF), etc.).
- 1.6 **Approved by Florida:** Statewide approval of products, methods, or systems of construction shall be approved, without further evaluation by:
- 1.6.1 A certification mark or listing of an approved certification agency,
  - 1.6.2 A test report from an approved testing laboratory,
  - 1.6.3 A product evaluation report based upon testing or comparative or rational analysis, or a combination thereof, from an approved product evaluation entity, or
  - 1.6.4 A product evaluation report based upon testing, comparative or rational analysis, or a combination thereof, developed, signed and sealed by a professional engineer or architect, licensed in Florida.
- 1.7 For local product approval, products or systems of construction shall demonstrate compliance with the structural wind load requirements of the Florida Building Code (FBC) through one of the following methods;
- 1.7.1 A certification mark, listing or label from a commission-approved certification agency indicating that the product complies with the code,
  - 1.7.2 A test report from a commission-approved testing laboratory indicating that the product tested complies with the code,
  - 1.7.3 A product-evaluation report based upon testing, comparative or rational analysis, or a combination thereof, from a commission-approved product evaluation entity which indicates that the product evaluated complies with the code,
  - 1.7.4 A product-evaluation report or certification based upon testing or comparative or rational analysis, or a combination thereof, developed and signed and sealed by a Florida professional engineer or Florida registered architect, which indicates that the product complies with the code, or





- 1.7.5 A statewide product approval issued by the Florida Building Commission.
- 1.8 The Florida Department of Business and Professional Regulation (DBPR) website provides a listing of companies certified as a Product Evaluation Agency (i.e., EVLMiami 13692), a Product Certification Agency (i.e., CER10642) and as a Florida Registered Engineer (i.e., ANE13741).
- 1.9 **Approved by Miami-Dade County (i.e., Notice of Acceptance [NOA]):** A Florida statewide approval is an NOA. An NOA is a Florida local product approval. By Florida law, Miami-Dade County shall accept the statewide and local Florida Product Approval as provided for in Florida legislation 553.842 and 553.8425.
- 1.10 **Approved by New Jersey:** Pursuant to the 2018 Building Code of New Jersey in IBC Section 1707.1 General,<sup>xvi</sup> it states: *“In the absence of approved rules or other approved standards, the building official shall accept duly authenticated reports from approved agencies in respect to the quality and manner of use of new materials or assemblies as provided for in the administrative provisions of the Uniform Construction Code (N.J.A.C. 5:23)”*.<sup>xvii</sup> Furthermore N.J.A.C 5:23-3.7 states: *“Municipal approvals of alternative materials, equipment, or methods of construction.”*
- 1.10.1 **Approvals:** Alternative materials, equipment, or methods of construction shall be approved by the appropriate subcode official provided the proposed design is satisfactory and that the materials, equipment, or methods of construction are suitable for the intended use and are at least the equivalent in quality, strength, effectiveness, fire resistance, durability and safety of those conforming with the requirements of the regulations.
- 1.10.1.1 A field evaluation label and report or letter issued by a nationally recognized testing laboratory verifying that the specific material, equipment, or method of construction meets the identified standards or has been tested and found to be suitable for the intended use, shall be accepted by the appropriate subcode official as meeting the requirements of the above.
- 1.10.1.2 Reports of engineering findings issued by nationally recognized evaluation service programs such as but not limited to, the Building Officials and Code Administrators (BOCA), the International Conference of Building Officials (ICBO), the Southern Building Code Congress International (SBCCI), the International Code Council (ICC) and the National Evaluation Service, Inc., shall be accepted by the appropriate subcode official as meeting the requirements of the above.
- 1.10.2 The New Jersey Department of Community Affairs has confirmed that technical evaluation reports, from any accredited entity listed by ANAB, meets the requirements of item the previous paragraph, given that the listed entities are no longer in existence and/or do not provide *“reports of engineering findings”*.
- 1.11 **Approved by the Code of Federal Regulations Manufactured Home Construction and Safety Standards:** Pursuant to Title 24, Subtitle B, Chapter XX, Part 3282.14<sup>xlviii</sup> and Part 3280,<sup>xlix</sup> the Department encourages innovation and the use of new technology in manufactured homes. The design and construction of a manufactured home shall conform to the provisions of Part 3282 and Part 3280 where key approval provisions in mandatory language follow:
- 1.11.1 *“All construction methods shall be in conformance with accepted engineering practices”*
- 1.11.2 *“The strength and rigidity of the component parts and/or the integrated structure shall be determined by engineering analysis or by suitable load tests to simulate the actual loads and conditions of application that occur.”*
- 1.11.3 *“The design stresses of all materials shall conform to accepted engineering practice.”*





- 1.12 **Approval by US, Local and State Jurisdictions in General:** In all other local and state jurisdictions, the adopted building code legislation states in pertinent part that:
- 1.12.1 For new materials that are not specifically provided for in this code, the design strengths and permissible stresses shall be established by tests.<sup>i</sup>
  - 1.12.2 For innovative alternatives and/or methods of construction, the building official shall accept duly authenticated reports from approved agencies with respect to the quality and manner of use of new materials or assemblies.<sup>ii</sup>
    - 1.12.2.1 An approved agency is “approved” when it is ANAB ISO/IEC 17065 accredited. DrJ Engineering, LLC (DrJ) is in the ANAB directory.
    - 1.12.2.2 An approved source is “approved” when an RDP is properly licensed to transact engineering commerce. The regulatory authority governing approved sources is the state legislature via its professional engineering regulations.<sup>iii</sup>
  - 1.12.3 The design strengths and permissible stresses of any structural material...shall conform to the specifications and methods of design of accepted engineering practice performed by an approved source.<sup>iiii</sup>
- 1.13 **Approval by International Jurisdictions:** The USMCA and GATT agreements provide for approval of innovative materials, designs, services and/or methods of construction through the Agreement on Technical Barriers to Trade and the IAF Multilateral Recognition Arrangement (MLA), where these agreements:
- 1.13.1 State that conformity assessment procedures (i.e., ISO/IEC 17020, 17025, 17065, etc.) are prepared, adopted and applied so as to grant access for suppliers of like products originating in the territories of other Members under conditions no less favourable than those accorded to suppliers of like products of national origin or originating in any other country, in a comparable situation.
  - 1.13.2 **Approved:** The purpose of the MLA is to ensure mutual recognition of accredited certification and validation/verification statements between signatories to the MLA and subsequently, acceptance of accredited certification and validation/verification statements in many markets based on one accreditation for the timely approval of innovative materials, designs, services and/or methods of construction.
  - 1.13.3 ANAB is an IAF-MLA signatory where recognition of certificates, validation and verification statements issued by conformity assessment bodies accredited by all other signatories of the IAF MLA, with the appropriate scope, shall be approved.<sup>iv</sup>
  - 1.13.4 Therefore, all ANAB ISO/IEC 17065 Duly Authenticated Reports are approval equivalent.<sup>iv</sup>
- 1.14 Approval equity is a fundamental commercial and legal principle.<sup>vi</sup>



Issue Date: January 31, 2022  
Subject to Renewal: July 1, 2024

## FBC Supplement to Report Number 1912-07

REPORT HOLDER: Altenloh, Brinck & Company U.S., Inc.

### 1 Evaluation Subject

- 1.1 SPAX® PowerLags® Series Structural Wood Fasteners

### 2 Purpose and Scope

- 2.1 Purpose
  - 2.1.1 The purpose of this report supplement is to show SPAX® PowerLags® Series Structural Wood Fasteners, recognized in Report Number 1912-07, have also been evaluated for compliance with the codes listed below as adopted by the Florida Building Commission.
- 2.2 *Applicable Code Editions*
  - 2.2.1 *FBC-B—20, 23: Florida Building Code – Building (FL 40711)*
  - 2.2.2 *FBC-R—20, 23: Florida Building Code – Residential (FL 40711)*

### 3 Conclusions

- 3.1 SPAX® PowerLags® Series Structural Wood Fasteners, described in Report Number 1912-07, comply with the FBC-B and FBC-R and are subject to the conditions of use described in this supplement.
- 3.2 Where there are variations between the IBC and IRC and the FBC-B and FBC-R applicable to this TER, they are listed here:
  - 3.2.1 FBC-B Section 104.4 and Section 110.4 are reserved.
  - 3.2.2 FBC-R Section R104 and Section R109 are reserved.
  - 3.2.3 FBC-B Section 2304.10.5 replaces IBC Section 2304.10.6.

### 4 Conditions of Use

- 4.1 SPAX® PowerLags® Series Structural Wood Fasteners, described in Report Number 1912-07, must comply with all of the following conditions:
  - 4.1.1 All applicable sections in Report Number 1912-07.
  - 4.1.2 The design, installation, and inspections are in accordance with additional requirements of FBC-B Chapter 16 and Chapter 17, as applicable.



Issue Date: July 27, 2022  
Subject to Renewal: July 1, 2024

## CBC and CRC Supplement to Report Number 1912-07

REPORT HOLDER: Altenloh, Brinck & Company U.S., Inc

### 1 Evaluation Subject

- 1.1 SPAX® PowerLags® Series Structural Wood Fasteners

### 2 Purpose and Scope

- 2.1 Purpose
  - 2.1.1 The purpose of this report supplement is to show SPAX® PowerLags® Series Structural Wood Fasteners, recognized in Report Number 1912-07, has also been evaluated for compliance with the codes listed below.
- 2.2 *Applicable Code Editions*
  - 2.2.1 *CBC—16, 19: California Building Code (Title 24, Part 2)*
  - 2.2.2 *CRC—16, 19: California Residential Code (Title 24, Part 2.5)*

### 3 Conclusions

- 3.1 SPAX® PowerLags® Series Structural Wood Fasteners, described in TER 1912-07, complies with the CBC and CRC and is subject to the conditions of use described in this supplement.
- 3.2 Where there are variations between the IBC and IRC and the CBC and CRC applicable to this TER, they are listed here:
  - 3.2.1 No variations.

### 4 Conditions of Use

- 4.1 SPAX® PowerLags® Series Structural Wood Fasteners, described in Report Number 1912-07, must comply with all of the following conditions:
  - 4.1.1 All applicable sections in Report Number 1912-07.
  - 4.1.2 The design, installation, and inspections are in accordance with additional requirements of the CBC and CRC, as applicable.



Issue Date: July 27, 2022  
Subject to Renewal: July 1, 2024

## LABC and LARC Supplement to TER 1912-07

REPORT HOLDER: Altenloh, Brinck & Company U.S., Inc

### 1 Evaluation Subject

- 1.1 SPAX® PowerLags® Series Structural Wood Fasteners

### 2 Purpose and Scope

- 2.1 Purpose
  - 2.1.1 The purpose of this report supplement is to show SPAX® PowerLags® Series Structural Wood Fasteners, recognized in TER 1912-07, have also been evaluated for compliance with the codes listed below as adopted by the Los Angeles Department of Building and Safety (LADBS).
- 2.2 *Applicable Code Editions*
  - 2.2.1 *LABC—17, 20: Los Angeles Building Code*
  - 2.2.2 *LARC—17, 20: Los Angeles Residential Code*

### 3 Conclusions

- 3.1 SPAX® PowerLags® Series Structural Wood Fasteners, described in Report Number 1912-07, complies with the LABC and LARC and is subject to the conditions of use described in this supplement.
- 3.2 Where there are variations between the IBC and IRC and the LABC and LARC are applicable to this report, they are listed here:
  - 3.2.1 LABC Section 91.104.2.6 replaces IBC Section 104.11
  - 3.2.2 LARC Section 91.104.2.6 replaces IRC Section R104.11
  - 3.2.3 LABC Section 91.104.2.2 replaces IBC Section 104.4
  - 3.2.4 LABC Section 91.108 replaces IBC Section 110.4
  - 3.2.5 LARC Section 91.104.2.2 replaces IRC Section R104.4
  - 3.2.6 LARC Section 91.108 replaces IRC Section R109.2
  - 3.2.7 LABC Section 91.104 replaces IBC Section 104
  - 3.2.8 LABC Section 91.108.5 replaces IBC Section 110.3.

### 4 Conditions of Use

- 4.1 SPAX® PowerLags® Series Structural Wood Fasteners, described in TER 1912-07, must comply with all of the following conditions:
  - 4.1.1 All applicable sections in TER 1912-07.
  - 4.1.2 The design, installation, conditions of use, and identification of SPAX® PowerLags® Series Structural Wood Fasteners are in accordance with the 2018 International Building Code (IBC) provisions noted in TER 1912-07.
  - 4.1.3 The design, installation, and inspections are in accordance with additional requirements of LABC Chapter 16 and 17, as applicable.



## Notes

- i For more information, visit [drjcertification.org](http://drjcertification.org) or call us at 608-310-6748.
- ii [2018 IBC Section 2304.10.5](#)
- iii [2018 IBC Section 2304.10.5](#)
- iv <https://up.codes/viewer/wyoming/ibc-2021/chapter/17/special-inspections-and-tests#1702>
- v Alternative Materials, Design and Methods of Construction and Equipment: The provisions of any regulation code are not intended to prevent the installation of any material or to prohibit any design or method of construction not specifically prescribed by a regulation. Please review <https://www.justice.gov/atr/mission> and <https://up.codes/viewer/colorado/ibc-2021/chapter/1/scope-and-administration#104.11>
- vi <https://up.codes/viewer/wyoming/ibc-2021/chapter/17/special-inspections-and-tests#1706>:-:text=the%20design%20strengths%20and%20permissible%20stresses%20shall%20be%20established%20by%20tests%20as
- vii The design strengths and permissible stresses of any structural material shall conform to the specifications and methods of design of accepted engineering practice. <https://up.codes/viewer/wyoming/ibc-2021/chapter/17/special-inspections-and-tests#1706>:-:text=shall%20conform%20to%20the%20specifications%20and%20methods%20of%20design%20of%20accepted%20engineering%20practice
- viii <https://up.codes/viewer/wyoming/ibc-2021/chapter/17/special-inspections-and-tests#1707.1>:-:text=the%20building%20official%20shall%20accept%20duly%20authenticated%20reports%20from%20approved%20agencies
- ix <https://up.codes/viewer/wyoming/ibc-2021/chapter/17/special-inspections-and-tests#1703.4.2>
- x [https://up.codes/viewer/wyoming/ibc-2021/chapter/2/definitions#approved\\_agency](https://up.codes/viewer/wyoming/ibc-2021/chapter/2/definitions#approved_agency)
- xi [https://up.codes/viewer/wyoming/ibc-2021/chapter/2/definitions#approved\\_source](https://up.codes/viewer/wyoming/ibc-2021/chapter/2/definitions#approved_source)
- xii <https://www.law.cornell.edu/uscode/text/18/1832> (b) Any organization that commits any offense described in subsection (a) shall be fined not more than the greater of \$5,000,000 or 3 times the value of the stolen trade secret to the organization, including expenses for research and design and other costs of reproducing the trade secret that the organization has thereby avoided. The federal government and each state have a public records act. To follow DTSA and comply state public records and trade secret legislation requires approval through ANAB ISO/IEC 17065 accredited certification bodies or approved sources. For more information, please review this website: [Intellectual Property and Trade Secrets](#).
- xiii <https://www.nspe.org/resources/issues-and-advocacy/professional-policies-and-position-statements/regulation-professional> AND <https://apassociation.org/list-of-engineering-boards-in-each-state-archive/>
- xiv <https://www.cbiteest.com/accreditation/>
- xv <https://up.codes/viewer/colorado/ibc-2021/chapter/1/scope-and-administration#104>:-:text=to%20enforce%20the%20provisions%20of%20this%20code
- xvi <https://up.codes/viewer/colorado/ibc-2021/chapter/1/scope-and-administration#104.11>:-:text=Where%20the%20alternative%20material%2C%20design%20or%20method%20of%20construction%20is%20not%20approved%2C%20the%20building%20official%20shall%20respond%20in%20writing%2C%20stating%20the%20reasons%20why%20the%20alternative%20was%20not%20approved AND <https://up.codes/viewer/colorado/ibc-2021/chapter/1/scope-and-administration#105.3.1>:-:text=If%20the%20application%20or%20the%20construction%20documents%20do%20not%20conform%20to%20the%20requirements%20of%20pertinent%20laws%2C%20the%20building%20official%20shall%20reject%20such%20application%20in%20writing%2C%20stating%20the%20reasons%20therefore
- xvii <https://up.codes/viewer/colorado/ibc-2021/chapter/17/special-inspections-and-tests#1707.1>:-:text=the%20building%20official%20shall%20accept%20duly%20authenticated%20reports%20from%20approved%20agencies%20in%20respect%20to%20the%20quality%20and%20manner%20of%20use%20of%20new%20materials%20or%20assemblies%20as%20provided%20for%20in%20Section%20104.11
- xviii <https://iaf.nu/en/about-iaf-mia/#>:-:text=it%20is%20required%20to%20recognise%20certificates%20and%20validation%20and%20verification%20statements%20issued%20by%20conformity%20assessment%20bodies%20accredited%20by%20all%20other%20signatories%20of%20the%20IAF%20MLA%2C%20with%20the%20appropriate%20scope
- xix True for all ANAB accredited product evaluation agencies and all International Trade Agreements.
- xx <https://www.justice.gov/crt/deprivation-rights-under-color-law> AND <https://www.justice.gov/atr/mission>
- xxi Unless otherwise noted, all references in this report are from the 2021 version of the codes and the standards referenced therein. This material, product, design, service and/or method of construction also complies with the 2000-2021 versions of the referenced codes and the standards referenced therein.
- xxii All references to the FBC-B and FBC-R are the same as the 2021 IBC and 2021 IRC unless otherwise noted in the Florida Supplement at the end of this TER.
- xxiii All references to the CBC and CRC are the same as the 2018 IBC and 2018 IRC unless otherwise noted in the California Supplement at the end of this TER.
- xxiv All references to the LABC and LARC are the same as the 2018 IBC and 2018 IRC unless otherwise noted in the Los Angeles Supplement at the end of this TER.
- xxv <https://www.ecfr.gov/current/title-24/subtitle-B/chapter-XX/part-3280#p-3280.2> (Listed%20or%20certified); <https://up.codes/viewer/colorado/ibc-2021/chapter/2/definitions#listed> AND <https://up.codes/viewer/colorado/ibc-2021/chapter/2/definitions#labeled>
- xxvi <https://up.codes/viewer/colorado/ibc-2021/chapter/17/special-inspections-and-tests#1703.4>
- xxvii <https://www.ecfr.gov/current/title-24/subtitle-B/chapter-XX/part-3280#>:-:text=All%20construction%20methods%20shall%20be%20in%20conformance%20with%20accepted%20engineering%20practices%20to%20insure%20durable%2C%20livable%2C%20and%20safe%20housing%20and%20shall%20demonstrate%20acceptable%20workmanship%20reflecting%20journeyman%20quality%20of%20work%20of%20the%20various%20trades
- xxviii <https://www.ecfr.gov/current/title-24/subtitle-B/chapter-XX/part-3280#>:-:text=The%20strength%20and%20rigidity%20of%20the%20component%20parts%20and/or%20the%20integrated%20structure%20shall%20be%20determined%20by%20engineering%20analysis%20or%20by%20suitable%20load%20tests%20to%20simulate%20the%20actual%20loads%20and%20conditions%20of%20application%20that%20occur



- Qualification is performed by a legislatively defined Accreditation Body. ANSI National Accreditation Board (ANAB) is the largest independent accreditation body in North America and provides services in more than 75 countries. DrJ is an ANAB accredited product certification body.
- See Code of Federal Regulations (CFR) Title 24 Subtitle B Chapter XX Part 3280 for definition.
- 2018 IFC Section 104.9
- Approved is an adjective that modifies the noun after it. For example, Approved Agency means that the Agency is accepted officially as being suitable in a particular situation. This example conforms to IBC/IRC/IFC Section 201.4 where the building code authorizes sentences to have an ordinarily accepted meaning such as the context implies.
- <https://up.codes/viewer/wyoming/ibc-2021/chapter/17/special-inspections-and-tests#1707.1>
- Multilateral approval is true for all ANAB accredited product evaluation agencies and all International Trade Agreements.
- <http://www.drjengineering.org/AppendixC> AND <https://www.drjcertification.org/cornell-2016-protection-trade-secrets>
- <https://www.law.cornell.edu/uscode/text/18/1832#:~:text=imprisoned%20not%20more%20than%2010%20years>
- <https://www.law.cornell.edu/uscode/text/18/1832#:~:text=Any%20organization%20that,has%20thereby%20avoided>
- <https://up.codes/viewer/wyoming/ibc-2021/chapter/17/special-inspections-and-tests#1706.2>
- IBC 2021, Section 1706.1 Conformance to Standards
- IBC 2021, Section 1707 Alternative Test Procedure, 1707.1 General
- See **Section 11.6** for the distilled building code definition of **Approved**.
- Los Angeles Municipal Code, SEC. 98.0503. TESTING AGENCIES
- <https://up.codes/viewer/california/ca-building-code-2022/chapter/17/special-inspections-and-tests#1707.1>
- New York City, The Rules of the City of New York, § 101-07 Approved Agencies
- New York City, The Rules of the City of New York, § 101-07 Approved Agencies
- <https://up.codes/viewer/new-jersey/ibc-2018/chapter/17/special-inspections-and-tests#1707.1>
- <https://www.nj.gov/dca/divisions/codes/codreg/ucc.html>
- <https://www.ecfr.gov/current/title-24/subtitle-B/chapter-XX/part-3282/subpart-A/section-3282.14>
- <https://www.ecfr.gov/current/title-24/subtitle-B/chapter-XX/part-3280>
- IBC 2021, Section 1706 Design Strengths of Materials, 1706.2 New Materials. Adopted law pursuant to IBC model code language 1706.2.
- IBC 2021, Section 1707 Alternative Test Procedure, 1707.1 General. Adopted law pursuant to IBC model code language 1707.1.
- <https://www.nspe.org/resources/issues-and-advocacy/professional-policies-and-position-statements/regulation-professional> AND <https://apassociation.org/list-of-engineering-boards-in-each-state-archive/>
- IBC 2021, Section 1706 Design Strengths of Materials, Section 1706.1 Conformance to Standards Adopted law pursuant to IBC model code language 1706.1.
- <https://iaf.nu/en/about-iaf-mla/#:~:text=it%20is%20required%20to%20recognise%20certificates%20and%20validation%20and%20verification%20statements%20issued%20by%20conformity%20assessment%20bodies%20accredited%20by%20all%20other%20signatories%20of%20the%20IAF%20MLA%2C%20with%20the%20appropriate%20scope>
- True for all ANAB accredited product evaluation agencies and all International Trade Agreements.
- <https://www.justice.gov/crt/deprivation-rights-under-color-law> AND <https://www.justice.gov/atr/mission>