

Listing and Technical Evaluation Report™

A Duly Authenticated Report from an Approved Agency

Report No: 2104-03



Issue Date: February 2, 2022

Revision Date: January 12, 2026

Subject to Renewal: April 1, 2027

CH Machine Connector Plates

Trade Secret Report Holder:

CH Machine, Inc.

Phone: 205-695-0094

Website: www.chmachineinc.com

Email: info@chmachineinc.com

CSI Designations:

DIVISION: 06 00 00 - WOOD, PLASTICS AND COMPOSITES

Section: 06 05 23 - Wood, Plastic, and Composite Fastenings

Section: 06 05 23.17 - Wood Framing Metal Connectors

Section: 06 17 53 - Shop-Fabricated Wood Trusses

1 Innovative Products Evaluated¹

1.1 CH20, CH18, and CH18 HS Truss Plates

2 Product Description and Materials

2.1 An example of the innovative products evaluated in this report is shown in **Figure 1**.

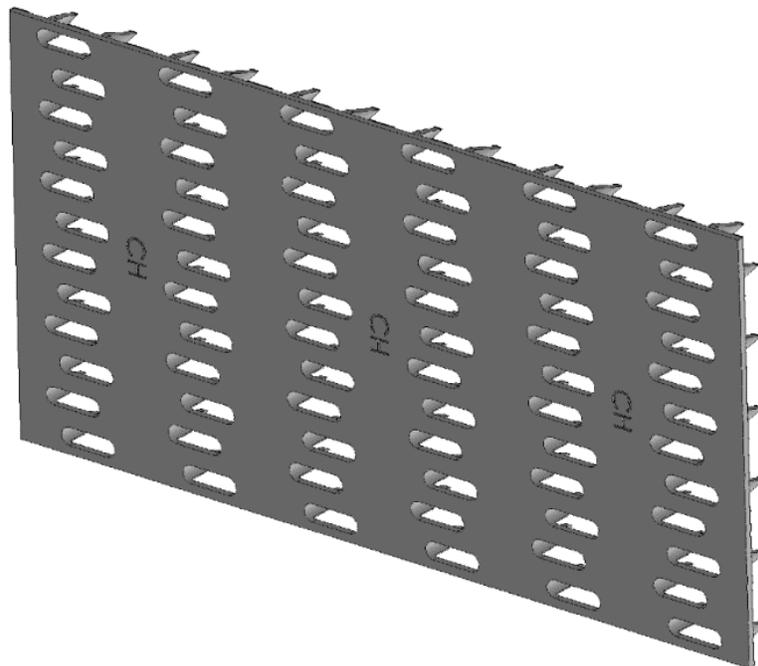


Figure 1. CH Metal Plate Connector



- 2.2 CH20, CH18, and CH18 HS Truss Plates are flat, light-gauge galvanized steel plates that use integral teeth to transfer lateral loads between wood truss members.
- 2.2.1 CH20 is manufactured from galvanized steel sheets complying with ASTM A653, SS Grade 50 with a G60 galvanized coating or 30Z30Z Electrolytic Zinc coating, in accordance with ASTM A879.
- 2.2.1.1 The minimum uncoated thickness of each steel sheet is 0.034".
- 2.2.1.2 CH20 has eight (8) teeth per square inch that are 0.35" long, 0.125" wide, and punched perpendicular to the plane of the plate.
- 2.2.2 CH18 is manufactured from galvanized steel sheets complying with ASTM A653, SS Grade 50 with a G60 galvanized coating or 30Z30Z Electrolytic Zinc coating, in accordance with ASTM A879.
- 2.2.2.1 The minimum uncoated thickness of each steel sheet is 0.045".
- 2.2.2.2 CH18 has eight (8) teeth per square inch that are 0.35" long, 0.125" wide and punched perpendicular to the plane of the plate.
- 2.2.3 CH18 HS is manufactured from galvanized steel sheets complying with ASTM A653, SS Grade 60 with a G60 galvanized coating or 30Z30Z Electrolytic Zinc coating, in accordance with ASTM A879.
- 2.2.3.1 The minimum uncoated thickness of each steel sheet is 0.045".
- 2.2.3.2 CH18 HS has eight (8) teeth per square inch that are 0.35" long, 0.125" wide and punched perpendicular to the plane of the plate.
- 2.3 As needed, review material properties for design in **Section 6** and the regulatory evaluation in **Section 8**.

3 Definitions²

- 3.1 New Materials³ are defined as building materials, equipment, appliances, systems, or methods of construction, not provided for by prescriptive and/or legislatively adopted regulations, known as alternative materials.⁴ The design strength and permissible stresses shall be established by tests⁵ and/or engineering analysis.⁶
- 3.2 Duly authenticated reports⁷ and research reports⁸ are test reports and related engineering evaluations that are written by an approved agency⁹ and/or an approved source.¹⁰
- 3.2.1 These reports utilize intellectual property and/or trade secrets to create public domain material properties for commercial end-use.
- 3.2.1.1 This report protects confidential Intellectual Property and trade secrets under the regulation, 18.US.Code.90, also known as Defend Trade Secrets Act of 2016 (DTSA).¹¹
- 3.3 An approved agency is "approved" when it is ANAB ISO/IEC 17065 accredited. DrJ Engineering, LLC (DrJ) is accredited and listed in the ANAB directory.
- 3.4 An approved source is "approved" when a professional engineer (i.e., Registered Design Professional, hereinafter RDP) is properly licensed to transact engineering commerce. The regulatory authority governing approved sources is the state legislature via its professional engineering regulations.¹²
- 3.5 Testing and/or inspections conducted for this duly authenticated report were performed by an ISO/IEC 17025 accredited testing laboratory, an ISO/IEC 17020 accredited inspection body, and/or a licensed RDP.
- 3.5.1 The Center for Building Innovation (CBI) is ANAB¹³ ISO/IEC 17025 and ISO/IEC 17020 accredited.
- 3.6 The regulatory authority shall enforce¹⁴ the specific provisions of each legislatively adopted regulation. If there is a non-conformance, the specific regulatory section and language of the non-conformance shall be provided in writing¹⁵ stating the nonconformance and the path to its cure.
- 3.7 The regulatory authority shall accept duly authenticated reports from an approved agency and/or an approved source with respect to the quality and manner of use of new materials or assemblies as provided for in regulations regarding the use of alternative materials, designs, or methods of construction.¹⁶



- 3.8 ANAB is an International Accreditation Forum (IAF) Multilateral Recognition Arrangement (MLA) signatory. Therefore, recognition of certificates and validation statements issued by conformity assessment bodies accredited by all other signatories of the IAF MLA with the appropriate scope shall be approved.¹⁷ Thus, all ANAB ISO/IEC 17065 duly authenticated reports are approval equivalent,¹⁸ and can be used in any country that is an MLA signatory found at this link: <https://iaf.nu/en/recognised-abs/>
- 3.9 Approval equity is a fundamental commercial and legal principle.¹⁹

4 Applicable Local, State, and Federal Approvals; Standards; Regulations²⁰

4.1 Local, State, and Federal

- 4.1.1 Approved in all local jurisdictions pursuant to ISO/IEC 17065 duly authenticated report use, which includes, but is not limited to, the following featured local jurisdictions: Austin, Baltimore, Broward County, Chicago, Clark County, Dade County, Dallas, Detroit, Denver, DuPage County, Fort Worth, Houston, Kansas City, King County, Knoxville, Las Vegas, Los Angeles City, Los Angeles County, Miami, Nashville, New York City, Omaha, Philadelphia, Phoenix, Portland, San Antonio, San Diego, San Jose, San Francisco, Seattle, Sioux Falls, South Holland, St. Louis County, Texas Department of Insurance, and Wichita.²¹
- 4.1.2 Approved in all state jurisdictions pursuant to ISO/IEC 17065 duly authenticated report use, which includes, but is not limited to, the following featured states: California, Florida, New Jersey, Oregon, New York, Texas, Washington, and Wisconsin.²²
- 4.1.3 Approved by the Code of Federal Regulations Manufactured Home Construction: Pursuant to Title 24, Subtitle B, Chapter XX, Part 3282.14²³ and Part 3280²⁴ pursuant to the use of ISO/IEC 17065 duly authenticated reports.
- 4.1.4 Approved means complying with the requirements of local, state, or federal legislation.

4.2 Regulations

- 4.2.1 *IBC – 18, 21, 24: International Building Code®*
- 4.2.2 *IRC – 18, 21, 24: International Residential Code®*
- 4.2.3 *FBC-B – 20, 23: Florida Building Code²⁵ – Building (FL 44405)*
- 4.2.4 *FBC-R – 20, 23: Florida Building Code²⁵ – Residential (FL 44405)*

4.3 Standards

- 4.3.1 *ASTM A653: Specification for Steel Sheet, Zinc-coated Galvanized or Zinc-iron Alloy-coated Galvannealed by the Hot-dip Process*
- 4.3.2 *ASTM A879: Standard Specification for Steel Sheet, Zinc Coated by the Electrolytic Process for Applications Requiring Designation of the Coating Mass on Each Surface*
- 4.3.3 *TPI 1: National Design Standard for Metal-plate-connected Wood Truss Construction*

5 Listed²⁶

- 5.1 Equipment, materials, products, or services included in a List published by a nationally recognized testing laboratory (i.e., CBI), an approved agency (i.e., CBI and DrJ), and/or and approved source (i.e., DrJ), or other organization(s) concerned with product evaluation (i.e., DrJ), that maintains periodic inspection (i.e., CBI) of production of listed equipment or materials, and whose listing states either that the equipment or material meets nationally recognized standards or has been tested and found suitable for use in a specified manner.



6 Tabulated Properties Generated from Nationally Recognized Standards

6.1 General

- 6.1.1 CH20, CH18, and CH18 HS Truss Plates can be used to connect wood truss members and support the lateral resistance of both vertical and horizontal loads, when used in accordance with this report and the applicable code.
- 6.1.2 Unless otherwise noted, adjustment of the allowable design values for duration of load shall be in accordance with the applicable code.

6.2 Allowable Lateral Resistance Design Values

- 6.2.1 CH20, CH18, and CH18 HS Truss Plates are allowed for use as truss plate connectors for wood trusses.
 - 6.2.1.1 Allowable lateral resistance design values are listed in **Table 1**.

Table 1. CH Plate Allowable Lateral Resistance Design Values¹

CH Plate	Wide Face or Narrow Face ²	Lumber Species ^{3,4} (Specific Gravity)	Allowable Design Value (psi/plate)			
			Orientation ⁵			
			AA	EA	AE	EE
CH20	Wide	SPF (0.42)	210	180	130	130
		HF (0.43)	210	180	130	135
		DF-L (0.50)	225	185	150	160
		SP (0.55)	235	190	160	175
	Narrow	SPF (0.42)	180	150	110	110
		HF (0.43)	180	150	115	115
		DF-L (0.50)	200	165	145	145
		SP (0.55)	210	175	165	165
CH18	Wide	SPF (0.42)	185	165	125	130
		HF (0.43)	190	165	130	135
		DF-L (0.50)	205	175	155	160
		SP (0.55)	220	185	175	180
	Narrow	SPF (0.42)	140	140	115	110
		HF (0.43)	140	140	115	115
		DF-L (0.50)	155	150	130	140
		SP (0.55)	165	160	140	155
CH18 HS	Wide	SPF (0.42)	185	165	125	130
		HF (0.43)	190	165	130	135
		DF-L (0.50)	205	175	155	160
		SP (0.55)	220	185	175	180
	Narrow	SPF (0.42)	140	140	115	110
		HF (0.43)	140	140	115	115
		DF-L (0.50)	155	150	130	140
		SP (0.55)	165	160	140	155

Table 1. CH Plate Allowable Lateral Resistance Design Values¹

CH Plate	Wide Face or Narrow Face ²	Lumber Species ^{3,4} (Specific Gravity)	Allowable Design Value (psi/plate)			
			Orientation ⁵			
			AA	EA	AE	EE
SI: 1 in = 25.4 mm, 1 lb = 4.45 N, 1 psi = 0.00689 MPa 1. To achieve the values presented in this table, plates of equal size shall be installed on opposite sides of the jointed members. Teeth shall be oriented in the same direction, as well. 2. Wide face denotes that the CH plate is connected to the face grain of each member. Narrow face denotes that the CH plate is connected to the side grain of each member. 3. Wood truss members shall have a minimum specific gravity of that listed in this table. 4. Wood truss members and overall truss design shall be designed by others and shall be of adequate size, species, and grade to resist design loads and requirements in accordance with the applicable building code. 5. Orientation refers to both the plate's slot orientation to the load and the load's orientation to grain. a. AA denotes that the plate's slots are parallel to load and the load is parallel to grain (see Figure 2 , which shows the wide face connection). b. EA denotes that the plate's slots are perpendicular to load and the load is parallel to grain (see Figure 2 , which shows the wide face connection). c. AE denotes that the plate's slots are parallel to load and the load is perpendicular to grain (see Figure 3 , which shows the wide face connection). d. EE denotes that the plate's slots are perpendicular to load and the load is perpendicular to grain (see Figure 3 , which shows the wide face connection).						

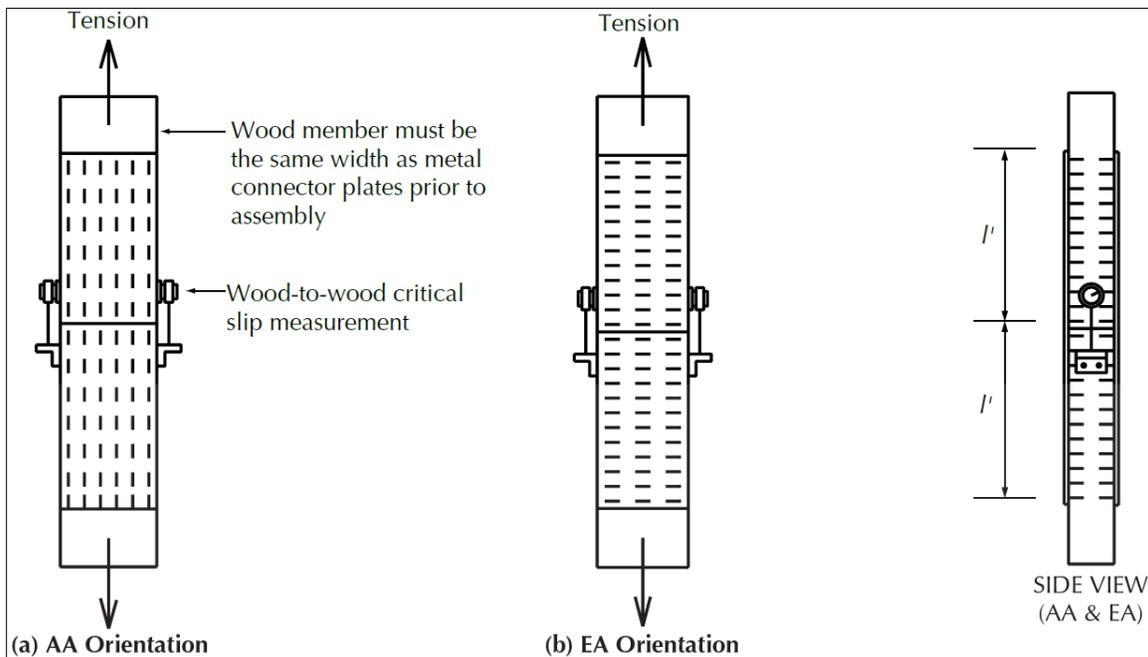


Figure 2. AA and EA Orientations (From TPI 1 Figure 5.2-3)

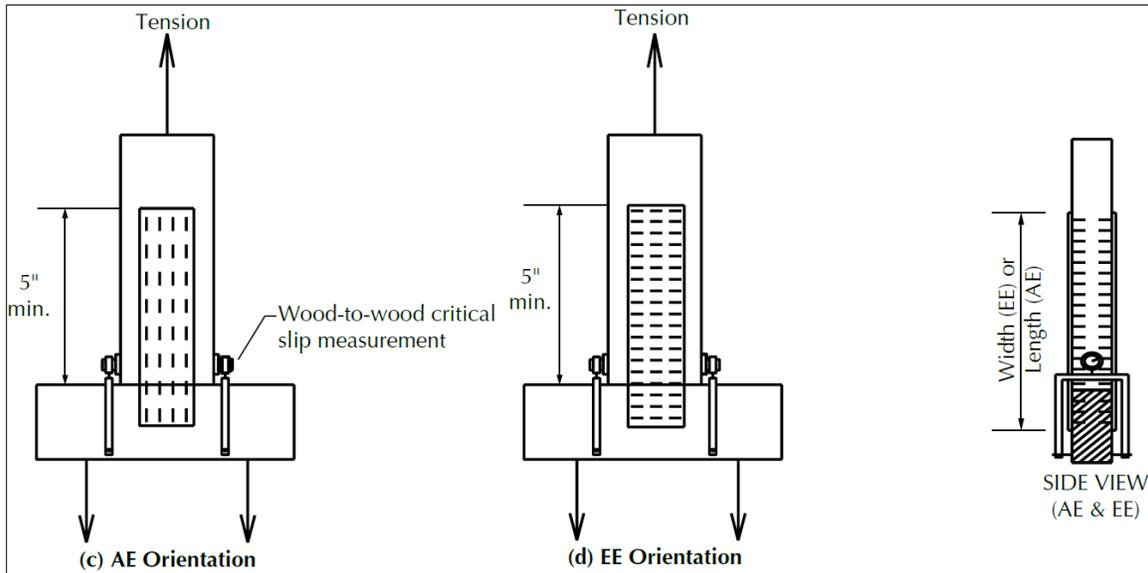


Figure 3. AE and EE Orientations (From TPI 1 Figure 5.2-3)

6.3 Allowable Tension Design Values and Effectiveness Ratios

6.3.1 CH20, CH18, and CH18 HS Truss Plates have allowable tension design values and effectiveness ratios as listed in **Table 2**.

Table 2. CH Plate Allowable Tension Design Values and Effectiveness Ratios

CH Plate	Orientation ¹	Allowable Design Value (pli)	Tensile Effectiveness Ratio ³
CH20	0° (AA)	495	0.453
	90° (EA)	470	0.431
	0° (AA, Non-Standard joint) ²	625	0.570
CH18	0° (AA)	705	0.500
	90° (EA)	715	0.507
	0° (AA, Non-Standard joint) ²	830	0.588
CH18 HS	0° (AA)	820	0.500
	90° (EA)	835	0.507
	0° (AA, Non-Standard joint) ²	965	0.588

SI: 1 in = 25.4 mm, 1 lb = 4.45 N, 1 pli = 0.175 N/mm


- Orientation refers to the plate's slot orientation to the load (0° is parallel to the plate's slots, 90° is perpendicular to the plate's slots), given tension loading is parallel to grain.
 - AA denotes that the plate's slots are parallel to load and the load is parallel to grain (see **Figure 2** and **Figure 4**).
 - EA denotes that the plate's slots are perpendicular to load and the load is parallel to grain (see **Figure 2**).
- Non-Standard joints denote full metal plate cross-sectional area across the wood member's joint plane (see **Figure 4**).
- Tensile Effectiveness Ratio (R_t) is defined in TPI 1 as:

$$R_t = \frac{F_{tp}}{F_{tc}}$$


where:

F_{tp} is the plate's ultimate tensile strength for the given orientation; and

F_{tc} is the theoretical ultimate tensile strength of the matched solid metal control specimen

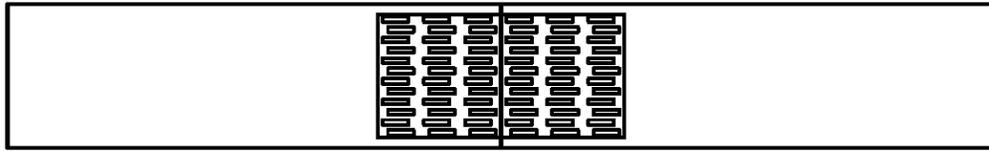

Non-standard test joint for steel tension parallel to slots
(solid steel cross-section over the joint line)

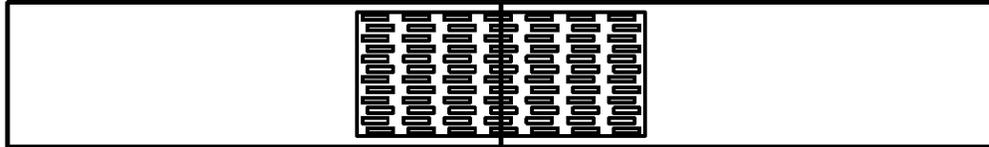

Standard test joint for steel tension parallel to slots
(minimum cross-section over the joint line)

Figure 4. Non-Standard and Standard Joints (From TPI 1 Figure 5.4-2)

6.4 Allowable Shear Design Values and Effectiveness Ratios

6.4.1 CH20, CH18, and CH18 HS Truss Plates have allowable shear design values as listed in **Table 3**.

Table 3. CH Plate Allowable Shear Design Values and Effectiveness Ratios

CH Plate	Plate Angle ¹	Allowable Design Value (pli)	Shear Effectiveness Ratio ²
CH20	0°	344	0.51
	30°	394	0.58
	60°	484	0.72
	90°	316	0.47
	120°	288	0.43
	150°	297	0.44
CH18	0°	442	0.62
	30°	472	0.66
	60°	619	0.87
	90°	451	0.63
	120°	345	0.48
	150°	372	0.52
CH18 HS	0°	580	0.62
	30°	620	0.66
	60°	810	0.87
	90°	590	0.63
	120°	450	0.48
	150°	490	0.52



Table 3. CH Plate Allowable Shear Design Values and Effectiveness Ratios

CH Plate	Plate Angle ¹	Allowable Design Value (pli)	Shear Effectiveness Ratio ²
SI: 1 in = 25.4 mm, 1 lb = 4.45 N, 1 pli = 0.175 N/mm 1. Plate angle is measured from the vertical. 2. Shear Strength Effectiveness Ratio (R_s) is defined in TPI 1 as: $R_s = \left(\frac{F_{sp}}{F_{sc}} \right) = \frac{F_{sp}}{0.577 \times F_{tc}}$ where: F_{sp} is the plate's ultimate shear stress for the given orientation; and F_{sc} is the theoretical ultimate shear stress of the matched solid metal control specimen; and F_{tc} is the average ultimate tensile stress			

6.5 Where the application falls outside of the performance evaluation, conditions of use, and/or installation requirements set forth herein, alternative techniques shall be permitted in accordance with accepted engineering practice and experience. This includes but is not limited to the following areas of engineering: mechanics or materials, structural, building science, and fire science.

7 Certified Performance²⁷

- 7.1 All construction methods shall conform to accepted engineering practices to ensure durable, livable, and safe construction and shall demonstrate acceptable workmanship reflecting journeyman quality of work of the various trades.²⁸
- 7.2 The strength and rigidity of the component parts and/or the integrated structure shall be determined by engineering analysis or by suitable load tests to simulate the actual loads and conditions of application that occur.²⁹

8 Regulatory Evaluation and Accepted Engineering Practice

- 8.1 CH20, CH18, and CH18 HS Truss Plates comply with the following legislatively adopted regulations and/or accepted engineering practice for the following reasons:
 - 8.1.1 Structural performance under load conditions for use as a metal plate connector for wood trusses in accordance with [IBC Section 2306.1](#) and TPI 1
 - 8.1.2 Tensile strength and effectiveness ratio in accordance with TPI 1
 - 8.1.3 Shear strength and effectiveness ratio in accordance with TPI 1
- 8.2 Overall truss design is outside the scope of this report.
- 8.3 Any building code, regulation and/or accepted engineering evaluations (i.e., [research reports](#), [duly authenticated reports](#), etc.) that are conducted for this Listing were performed by DrJ, which is an [ISO/IEC 17065 accredited certification body](#) and a professional engineering company operated by [RDP](#) or [approved sources](#). DrJ is qualified³⁰ to practice product and regulatory compliance services within its [scope of accreditation and engineering expertise](#),³¹ respectively.
- 8.4 Engineering evaluations are conducted with DrJ's ANAB [accredited ICS code scope](#) of expertise, which is also its areas of professional engineering competence.
- 8.5 Any regulation specific issues not addressed in this section are outside the scope of this report.



9 Installation

- 9.1 Installation shall comply with the approved construction documents, the manufacturer installation instructions, this report, and the applicable building code.
- 9.2 In the event of a conflict between the manufacturer installation instructions and this report, contact the manufacturer for counsel on the proper installation method.
- 9.3 *Installation Procedure*
 - 9.3.1 Wood trusses connected with CH20, CH18, and CH18 HS Truss Plates shall be assembled in accordance with Chapter 3 of TPI 1, [IBC Section 2303.4](#), and [IRC Section R502.12](#) or [IRC Section R802.10](#).
 - 9.3.2 Single plate installation is not allowable. Install CH20, CH18, and CH18 HS Truss Plates in corresponding pairs on opposite faces of truss member joints.
 - 9.3.3 CH20, CH18, and CH18 HS Truss Plates must be pressed into wood for the full depth of the teeth by a hydraulic platen press, multiple roller presses (partial embedment followed by full embedment presses), or combinations of hydraulic-platen presses and/or roller presses that feed into a stationary finish roller press.

10 Substantiating Data

- 10.1 Testing has been performed under the supervision of a professional engineer and/or under the requirements of ISO/IEC 17025 as follows:
 - 10.1.1 Truss plate connector testing for lateral resistance in accordance with TPI 1
 - 10.1.2 Truss plate connector testing for tensile strength in accordance with TPI 1
 - 10.1.3 Truss plate connector testing for shear strength in accordance with TPI 1
- 10.2 Information contained herein may include the result of testing and/or data analysis by sources that are [approved agencies](#), [approved sources](#), and/or an [RDP](#). Accuracy of external test data and resulting analysis is relied upon.
- 10.3 Where applicable, testing and/or engineering analysis are based upon provisions that have been codified into law through state or local adoption of regulations and standards. The developers of these regulations and standards are responsible for the reliability of published content. DrJ's engineering practice may use a regulation-adopted provision as the control. A regulation-endorsed control versus a simulation of the conditions of application to occur establishes a new material as [being equivalent](#) to the regulatory provision in terms of quality, [strength](#), effectiveness, [fire resistance](#), durability, and safety.
- 10.4 The accuracy of the provisions provided herein may be reliant upon the published properties of raw materials, which are defined by the grade mark, grade stamp, mill certificate, or [duly authenticated reports](#) from [approved agencies](#) and/or [approved sources](#) provided by the supplier. These are presumed to be minimum properties and relied upon to be accurate. The reliability of DrJ's engineering practice, as contained in this [duly authenticated report](#), may be dependent upon published design properties by others.
- 10.5 *Testing and Engineering Analysis*
 - 10.5.1 The strength, rigidity, and/or general performance of component parts and/or the integrated structure are determined by suitable tests that simulate the actual conditions of application that occur and/or by accepted engineering practice and experience.³²
- 10.6 Where additional condition of use and/or regulatory compliance information is required, please search for CH20, CH18, and CH18 HS Truss Plates on the [DrJ Certification website](#).



11 Findings

- 11.1 As outlined in **Section 6**, CH20, CH18, and CH18 HS Truss Plates have performance characteristics that were tested and/or meet applicable regulations. In addition, they are suitable for use pursuant to its specified purpose.
- 11.2 When used and installed in accordance with this duly authenticated report and the manufacturer installation instructions, CH20, CH18, and CH18 HS Truss Plates shall be approved for the following applications:
- 11.2.1 Use as a metal plate connector for wood truss construction in accordance with IBC Section 2306.1.
- 11.3 Unless exempt by state statute, when CH20, CH18, and CH18 HS Truss Plates are to be used as a structural and/or building envelope component in the design of a specific building, the design shall be performed by an RDP.
- 11.4 Any application specific issues not addressed herein can be engineered by an RDP. Assistance with engineering is available from CH Machine, Inc.
- 11.5 IBC Section 104.2.3³³ (IRC Section R104.2.2³⁴ and IFC Section 104.2.3³⁵ are similar) in pertinent part state:
- 104.2.3 Alternative Materials, Design and Methods of Construction and Equipment.** The provisions of this code are not intended to prevent the installation of any material or to prohibit any design or method of construction not specifically prescribed by this code, provided that any such alternative is not specifically prohibited by this code and has been approved.
- 11.6 **Approved:**³⁶ Building regulations require that the building official shall accept duly authenticated reports.³⁷
- 11.6.1 An approved agency is “*approved*” when it is ANAB ISO/IEC 17065 accredited.
- 11.6.2 An approved source is “*approved*” when an RDP is properly licensed to transact engineering commerce.
- 11.6.3 Federal law, Title 18 US Code Section 242, requires that, where the alternative product, material, service, design, assembly, and/or method of construction is not approved, the building official shall respond in writing, stating the reasons why the alternative was not approved. Denial without written reason deprives a protected right to free and fair competition in the marketplace.
- 11.7 DrJ is a licensed engineering company, employs licensed RDPs and is an ANAB Accredited Product Certification Body – Accreditation #1131.
- 11.8 Through the IAF Multilateral Arrangement (MLA), this duly authenticated report can be used to obtain product approval in any jurisdiction or country because all ANAB ISO/IEC 17065 duly authenticated reports are equivalent.³⁸

12 Conditions of Use

- 12.1 Material properties shall not fall outside the boundaries defined in **Section 6**.
- 12.2 As defined in **Section 6**, where material and/or engineering mechanics properties are created for load resisting design purposes, the resistance to the applied load shall not exceed the ability of the defined properties to resist those loads using the principles of accepted engineering practice.
- 12.3 This report establishes allowable metal connector plate design values only. The design values (lateral resistance values, effective tension strength ratios, and effective shear resistance ratios) used in the design of wood trusses using CH20, CH18, and CH18 HS Truss Plates must not exceed those listed in **Table 1**, **Table 2**, or **Table 3** of this report.
- 12.3.1 Design of truss, fabrication, quality assurance, and special inspection is outside the scope of this report and shall be in accordance with TPI 1, engineering drawings from an RDP, and the applicable code.



- 12.4 All lumber used in the fabrication of wood trusses connected with CH20, CH18, and CH18 HS Truss Plates shall be graded in accordance with the applicable building code and shall have a moisture content not in excess of nineteen percent (19%).
- 12.4.1 CH20, CH18, and CH18 HS Truss Plates installed in lumber having a moisture content greater than nineteen percent (19%) at the time of truss fabrication, shall have the lateral resistance values listed in **Table 1** multiplied by the wet service factor, C_M , specified in TPI 1 Table 6.4-4.
- 12.5 CH20, CH18, and CH18 HS Truss Plates must be installed in corresponding pairs on opposite faces of truss member joints.
- 12.6 Trusses assembled using CH20, CH18, and CH18 HS Truss Plates shall be in accordance with the tolerances provided for in with ANSI/TPI 1, Chapter 3.
- 12.7 Allowable loads shown in **Table 1**, **Table 2**, or **Table 3** have not been adjusted for use in preservative-treated or fire-retardant treated lumber. Allowable value shall be adjusted in accordance with the treatment manufacturer product evaluation report. If this information is not in the report, contact the treatment manufacturer for this information.
- 12.8 When required by adopted legislation and enforced by the building official, also known as the Authority Having Jurisdiction (AHJ) in which the project is to be constructed:
- 12.8.1 Any calculations incorporated into the construction documents shall conform to accepted engineering practice and, when prepared by an approved source, shall be approved when signed and sealed.
- 12.8.2 This report and the installation instructions shall be submitted at the time of permit application.
- 12.8.3 These innovative products have an internal quality control program and a third-party quality assurance program.
- 12.8.4 At a minimum, these innovative products shall be installed per **Section 9**.
- 12.8.5 The review of this report by the AHJ shall comply with IBC Section 104.2.3.2 and IBC Section 105.3.1.
- 12.8.6 These innovative products have an internal quality control program and a third party quality assurance program in accordance with IBC Section 104.7.2, IBC Section 110.4, IBC Section 1703, IRC Section R104.7.2, and IRC Section R109.2.
- 12.8.7 The application of these innovative products in the context of this report is dependent upon the accuracy of the construction documents, implementation of installation instructions, inspection as required by IBC Section 110.3, IRC Section R109.2, and any other regulatory requirements that may apply.
- 12.9 The approval of this report by the AHJ shall comply with IBC Section 1707.1, where legislation states in part, *“the building official shall make, or cause to be made, the necessary tests and investigations; or the building official shall accept duly authenticated reports from approved agencies in respect to the quality and manner of use of new materials or assemblies as provided for in Section 104.2.3”*, all of IBC Section 104, and IBC Section 105.3.
- 12.10 Design loads shall be determined in accordance with the regulations adopted by the jurisdiction in which the project is to be constructed and/or by the building designer (i.e., owner or RDP).
- 12.11 The actual design, suitability, and use of this report for any particular building, is the responsibility of the owner or the authorized agent of the owner.



13 Identification

- 13.1 CH20, CH18, and CH18 HS Truss Plates, as listed in **Section 1.1**, are identified by a label on the board or packaging material bearing the manufacturer name, product name, this report number, and other information to confirm code compliance.
- 13.2 Additional technical information can be found at www.chmachineinc.com.

14 Review Schedule

- 14.1 This report is subject to periodic review and revision. For the latest version, visit www.drjcertification.org.
- 14.2 For information on the status of this report, please contact [DrJ Certification](#).



Issue Date: February 2, 2022
Subject to Renewal: April 1, 2027

FBC Supplement to Report Number 2104-03

REPORT HOLDER: CH Machine, Inc.

1 Evaluation Subject

- 1.1 CH20, CH18, and CH18 HS Truss Plates

2 Purpose and Scope

2.1 Purpose

- 2.1.1 The purpose of this Report Supplement is to show CH20, CH18, and CH18 HS Truss Plates, recognized in Report Number 2104-03, have also been evaluated for compliance with the codes listed below as adopted by the Florida Building Commission.

2.2 Applicable Code Editions

- 2.2.1 FBC-B—20, 23: Florida Building Code – Building (FL 44405)
- 2.2.2 FBC-R—20, 23: Florida Building Code – Residential (FL 44405)

3 Conclusions

- 3.1 CH20, CH18, and CH18 HS Truss Plates, described in Report Number 2104-03, comply with the FBC-B and FBC-R and are subject to the conditions of use described in this supplement.
- 3.2 Where there are variations between the IBC and IRC and the FBC-B and FBC-R applicable to this report, they are listed here:
 - 3.2.1 FBC-B Section 104 is reserved.
 - 3.2.2 FBC-B Section 110.4 is reserved and replaces IBC Section 110.4.
 - 3.2.3 FBC-B Section 104.6 is reserved and replaces IBC Section 104.4.
 - 3.2.4 FBC-B Section 104.11 replaces IBC Section 104.2.3 and Section 104.2.3.2.
 - 3.2.5 FBC-B Section 105.3 replaces IBC Section 105.3.
 - 3.2.6 FBC-B Section 105.3.1 replaces IBC Section 105.3.1.
 - 3.2.7 FBC-B Section 110.3 replaces IBC Section 110.3.
 - 3.2.8 FBC-B Section 1707.1 replaces IBC Section 1707.1.
 - 3.2.9 FBC-B Section 2303.4 replaces IBC Section 2303.4.
 - 3.2.10 FBC-B Section 2306.1 replaces IBC Section 2306.1.
 - 3.2.11 FBC-B Section 2306.3 replaces IBC Section 2306.3.
 - 3.2.12 FBC-R Section R104 and Section R109 are reserved.
 - 3.2.13 FBC-R Section R502.11 replaces IRC Section R502.12.



4 Conditions of Use

- 4.1 CH20, CH18, and CH18 HS Truss Plates, described in Report Number 2104-03, must comply with all of the following conditions:
 - 4.1.1 All applicable sections in Report Number 2104-03.
 - 4.1.2 The design, installation, and inspections are in accordance with additional requirements of FBC-B Chapter 16 and Chapter 17, as applicable.



Notes

1 For more information, visit drjcertification.org or call us at 608-310-6748.

2 Capitalized terms and responsibilities are defined pursuant to the applicable building code, applicable reference standards, the latest edition of TPI 1, the NDS, AISI S202, US professional engineering law, Canadian building code, Canada professional engineering law, Qualtim External Appendix A: Definitions/Commentary, Qualtim External Appendix B: Project/Deliverables, Qualtim External Appendix C: Intellectual Property and Trade Secrets, definitions created within Design Drawings and/or definitions within Reference Sheets. Beyond this, terms not defined shall have ordinarily accepted meanings as the context implies. Words used in the present tense include the future; words stated in the masculine gender include the feminine and neuter; the singular number includes the plural and the plural, the singular.

3 <https://up.codes/viewer/mississippi/ibc-2024/chapter/17/special-inspections-and-tests#1702>

4 Alternative Materials, Design and Methods of Construction and Equipment: The provisions of any regulation code are not intended to prevent the installation of any material or to prohibit any design or method of construction not specifically prescribed by a regulation. Please review <https://www.justice.gov/atr/mission> and <https://up.codes/viewer/mississippi/ibc-2024/chapter/1/scope-and-administration#104.2.3>

5 <https://up.codes/viewer/mississippi/ibc-2024/chapter/17/special-inspections-and-tests#1706.2>:-:text=the%20design%20strengths%20and%20permissible%20stresses%20shall%20be%20established%20by%20tests

6 The design strengths and permissible stresses of any structural material shall conform to the specifications and methods of design of accepted engineering practice. <https://up.codes/viewer/mississippi/ibc-2024/chapter/17/special-inspections-and-tests#1706.1>:-:text=Conformance%20to%20Standards-.The%20design%20strengths%20and%20permissible%20stresses.-of%20any%20structural

7 <https://up.codes/viewer/mississippi/ibc-2024/chapter/17/special-inspections-and-tests#1707.1>:-:text=the%20building%20official%20shall%20make%20or%20cause%20to%20be%20made%20the%20necessary%20tests%20and%20investigations%20or%20the%20building%20official%20shall%20accept%20duly%20authenticated%20reports%20from%20approved%20agencies%20in%20respect%20to%20the%20quality%20and%20manner%20of%20use%20of%20new%20materials%20or%20assemblies%20as%20provided%20for%20in%20Section%20104.2.3.

8 <https://up.codes/viewer/mississippi/ibc-2024/chapter/17/special-inspections-and-tests#1703.4.2>

9 https://up.codes/viewer/mississippi/ibc-2024/chapter/2/definitions#approved_agency

10 https://up.codes/viewer/mississippi/ibc-2024/chapter/2/definitions#approved_source

11 <https://www.law.cornell.edu/uscode/text/18/1832> (b) Any organization that commits any offense described in subsection (a) shall be fined not more than the greater of \$5,000,000 or 3 times the value of the stolen trade secret to the organization, including expenses for research and design and other costs of reproducing the trade secret that the organization has thereby avoided. The federal government and each state have a public records act. To follow DTSA and comply state public records and trade secret legislation requires approval through ANAB ISO/IEC 17065 accredited certification bodies or approved sources. For more information, please review this website: Intellectual Property and Trade Secrets.

12 <https://www.nspe.org/resources/issues-and-advocacy/professional-policies-and-position-statements/regulation-professional> AND <https://apassociation.org/list-of-engineering-boards-in-each-state-archive/>

13 <https://www.cbiteest.com/accreditation/>

14 <https://up.codes/viewer/mississippi/ibc-2024/chapter/1/scope-and-administration#104.1>:-:text=directed%20to%20enforce%20the%20provisions%20of%20this%20code

15 <https://up.codes/viewer/mississippi/ibc-2024/chapter/1/scope-and-administration#104.2.3> AND <https://up.codes/viewer/mississippi/ibc-2024/chapter/1/scope-and-administration#105.3.1>

16 <https://up.codes/viewer/mississippi/ibc-2024/chapter/17/special-inspections-and-tests#1707.1>

17 <https://iaf.nu/en/about-iaf-mia/#>:-:text=Once%20an%20accreditation%20body%20is%20a%20signatory%20of%20the%20IAF%20MLA%20it%20is%20required%20to%20recognise%20certificates%20and%20validation%20and%20verification%20statements%20issued%20by%20conformity%20assessment%20bodies%20accredited%20by%20all%20other%20signatories%20of%20the%20IAF%20MLA%20with%20the%20appropriate%20scope

18 True for all ANAB accredited product evaluation agencies and all International Trade Agreements.

19 <https://www.justice.gov/crt/deprivation-rights-under-color-law> AND <https://www.justice.gov/atr/mission>

20 Unless otherwise noted, the links referenced herein use un-amended versions of the 2024 International Code Council (ICC) 2024 International Code Council (ICC) model codes as foundation references. Mississippi versions of the IBC 2024 and the IRC 2024 are un-amended. This material, product, design, service and/or method of construction also complies with the 2000-2012 versions of the referenced codes and the standards referenced therein. As pertinent to this technical and code compliance evaluation, CBI and/or DrJ staff have reviewed any state or local regulatory amendments to assure this report is in compliance.

21 See Adoptions by Publisher for the latest adoption of a non-amended or amended model code by the local jurisdiction. <https://up.codes/codes/general>

22 See Adoptions by Publisher for the latest adoption of a non-amended or amended model code by state. <https://up.codes/codes/general>

23 <https://www.ecfr.gov/current/title-24/subtitle-B/chapter-XX/part-3282/subpart-A/section-3282.14>

24 <https://www.ecfr.gov/current/title-24/subtitle-B/chapter-XX/part-3280>

25 All references to the FBC-B and FBC-R are the same as the 2024 IBC and 2024 IRC unless otherwise noted in the Florida Supplement at the end of this report.

26 <https://www.ecfr.gov/current/title-24/subtitle-B/chapter-XX/part-3280#p-3280.2>(Listed%20or%20certified); <https://up.codes/viewer/mississippi/ibc-2024/chapter/2/definitions#listed> AND <https://up.codes/viewer/mississippi/ibc-2024/chapter/2/definitions#labeled>

27 <https://up.codes/viewer/mississippi/ibc-2024/chapter/17/special-inspections-and-tests#1703.4>

28 <https://www.ecfr.gov/current/title-24/subtitle-B/chapter-XX/part-3280#>:-:text=All%20construction%20methods%20shall%20be%20in%20conformance%20with%20accepted%20engineering%20practices%20to%20insure%20durable%20livable%20and%20safe%20housing%20and%20shall%20demonstrate%20acceptable%20workmanship%20reflecting%20journeyman%20quality%20of%20work%20of%20the%20various%20trades

29 <https://www.ecfr.gov/current/title-24/subtitle-B/chapter-XX/part-3280#>:-:text=The%20strength%20and%20rigidity%20of%20the%20component%20parts%20and/or%20the%20integrated%20structure%20shall%20be%20determined%20by%20engineering%20analysis%20or%20by%20suitable%20load%20tests%20to%20simulate%20the%20actual%20loads%20and%20conditions%20of%20application%20that%20occur



- 30 Qualification is performed by a legislatively defined Accreditation Body. ANSI National Accreditation Board (ANAB) is the largest independent accreditation body in North America and provides services in more than 75 countries. DrJ is an ANAB accredited product certification body.
- 31 <https://anabpd.ansi.org/Accreditation/product-certification/AllDirectoryDetails?prgID=1&orgID=2125&statusID=4#:~:text=Bill%20Payment%20Date-.Accredited%20Scopes,-13%20ENVIRONMENT.%20HEALTH>
- 32 See Code of Federal Regulations (CFR) Title 24 Subtitle B Chapter XX Part 3280 for definition: <https://www.ecfr.gov/current/title-24/subtitle-B/chapter-XX/part-3280>
- 33 2021 IBC Section 104.11
- 34 2021 IRC Section R104.11
- 35 2018: <https://up.codes/viewer/wyoming/ifc-2018/chapter/1/scope-and-administration#104.9> AND 2021: <https://up.codes/viewer/wyoming/ibc-2021/chapter/1/scope-and-administration#104.11>
- 36 Approved is an adjective that modifies the noun after it. For example, Approved Agency means that the Agency is accepted officially as being suitable in a particular situation. This example conforms to IBC/IRC/IFC Section 201.4 (<https://up.codes/viewer/mississippi/ibc-2024/chapter/2/definitions#201.4>) where the building code authorizes sentences to have an ordinarily accepted meaning such as the context implies.
- 37 <https://up.codes/viewer/mississippi/ibc-2024/chapter/17/special-inspections-and-tests#1707.1>
- 38 Multilateral approval is true for all ANAB accredited product evaluation agencies and all International Trade Agreements.