

Listing

A Duly Authenticated Report from an Approved Agency

Report No: 2411-108



Issue Date: January 7, 2025

Revision Date: January 7, 2025

Subject to Renewal: April 1, 2026

OX-IS™ High Shear Assembly Performance

Trade Secret Report Holder:

OX Engineered Products, Inc.

Phone: 800-345-8881

Website: www.oxengineeredproducts.com

CSI Designations:

DIVISION: 06 00 00 - WOOD, PLASTICS AND COMPOSITES

Section: 06 12 00 - Structural Panels

Section: 06 12 19 - Shear Wall Panels

Section: 06 16 00 - Sheathing

DIVISION: 07 00 00 - THERMAL AND MOISTURE PROTECTION

Section: 07 21 00 - Thermal Insulation

Section: 07 25 00 - Water-Resistive Barriers/Weather Barriers

Section: 07 27 00 - Air Barriers

1 Innovative Product Evaluated¹

- 1.1 1/2" OX-IS Structural Insulated Sheathing

2 Product Description and Materials

- 2.1 The innovative product evaluated in this report is shown in **Figure 1**.

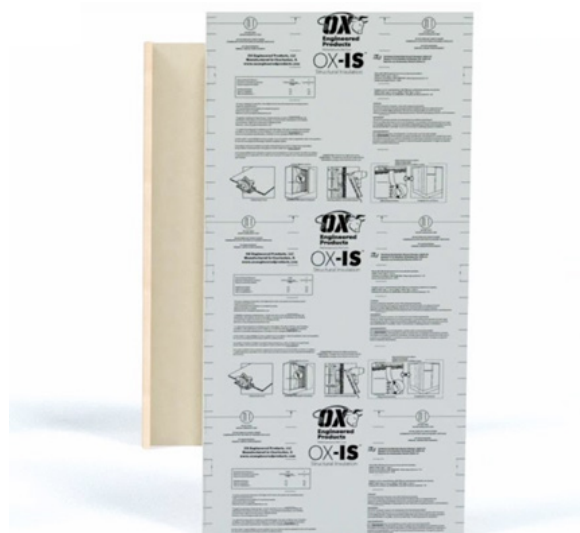


Figure 1. OX-IS Structural Insulation Sheathing Panel



- 2.2 OX-IS is an insulated structural sheathing panel consisting of a proprietary fibrous sheathing board laminated to one side of a proprietary rigid Foam Plastic Insulating Sheathing (FPIS) panel.
- 2.2.1 The proprietary fibrous sheathing is made of specially treated plies that are pressure-laminated with a water resistant adhesive.
- 2.2.1.1 A protective polymer layer is applied on both sides. The surface finish consists of a foil facer on one or both sides.
- 2.2.2 The rigid foam plastic insulating sheathing component is a proprietary polyisocyanurate (polyiso) insulation sheathing, which may have facings on one or both sides and conforms to ASTM C1289, Type 1, Class 1.
- 2.3 *Material Availability*
- 2.3.1 *Foam Thickness:*
- 2.3.1.1 1/2" (12.7 mm) to 1" (25.4 mm)
- 2.3.2 *Standard Product Width:*
- 2.3.2.1 48" (1,219 mm)
- 2.3.3 *Standard Product Lengths:*
- 2.3.3.1 96" (2,438 mm)
- 2.3.3.2 108" (2,743 mm)
- 2.3.3.3 120" (3,048 mm)
- 2.4 OX-IS assemblies that are evaluated in this report, are wood-framed wall assemblies sheathed with 1/2" thick OX-IS structural insulating sheathing panel on the exterior side, and with or without a 1/2" lightweight Gypsum Wallboard (GWB) on the interior side.
- 2.4.1 The framing evaluated in this report is shown in **Figure 2** through **Figure 5**.
- 2.4.1.1 *Framing Configuration 1 (Figure 2):*
- 2.4.1.1.1 Nominal 2x dimensional lumber
- 2.4.1.1.2 Unblocked
- 2.4.1.1.3 Single top plate
- 2.4.1.1.4 Single bottom plate
- 2.4.1.1.5 Single end studs
- 2.4.1.2 *Framing Configuration 2 (Figure 3):*
- 2.4.1.2.1 Nominal 2x dimensional lumber
- 2.4.1.2.2 Blocking directly below top plate and directly above bottom plate
- 2.4.1.2.3 Single top plate
- 2.4.1.2.4 Single bottom plate
- 2.4.1.2.5 Double end studs
- 2.4.1.3 *Framing Configuration 3 (Figure 4):*
- 2.4.1.3.1 Nominal 2x dimensional lumber
- 2.4.1.3.2 Blocking directly below top plate, above bottom plate, and mid-height
- 2.4.1.3.3 Single top plate
- 2.4.1.3.4 Single bottom plate

2.4.1.4 Framing Configuration 4 (Figure 5):

- 2.4.1.4.1 Nominal 2x dimensional lumber
- 2.4.1.4.2 Blocking directly below top plate, above bottom plate, mid-height, and quarter-heights
- 2.4.1.4.3 Single top plate
- 2.4.1.4.4 Single bottom plate

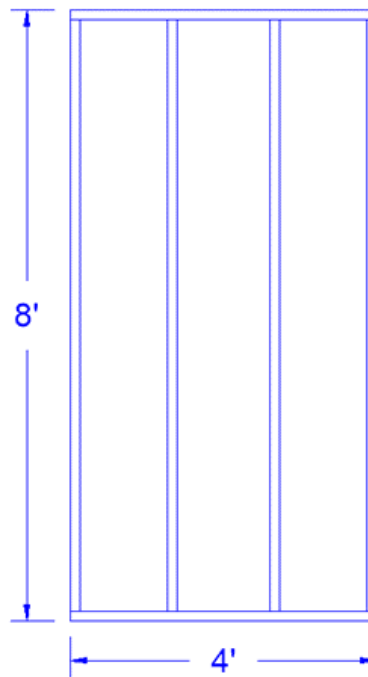


Figure 2. Framing Configuration 1

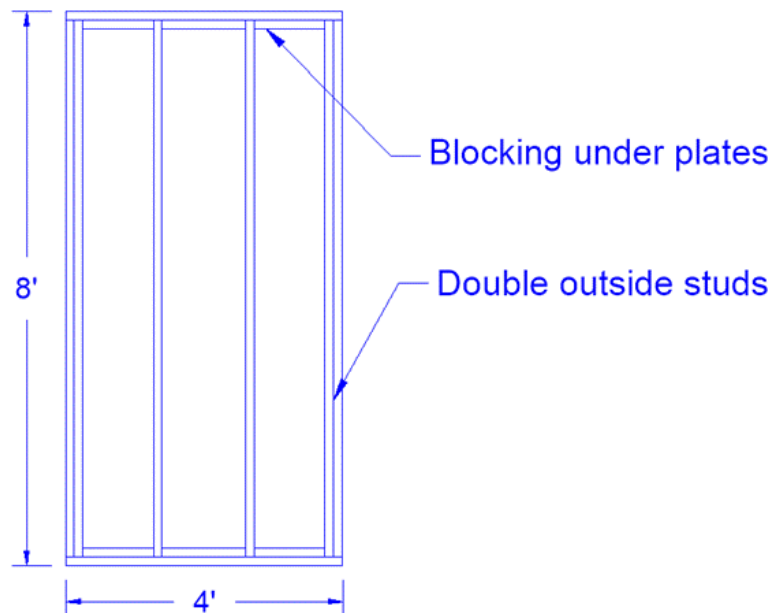


Figure 3. Framing Configuration 2

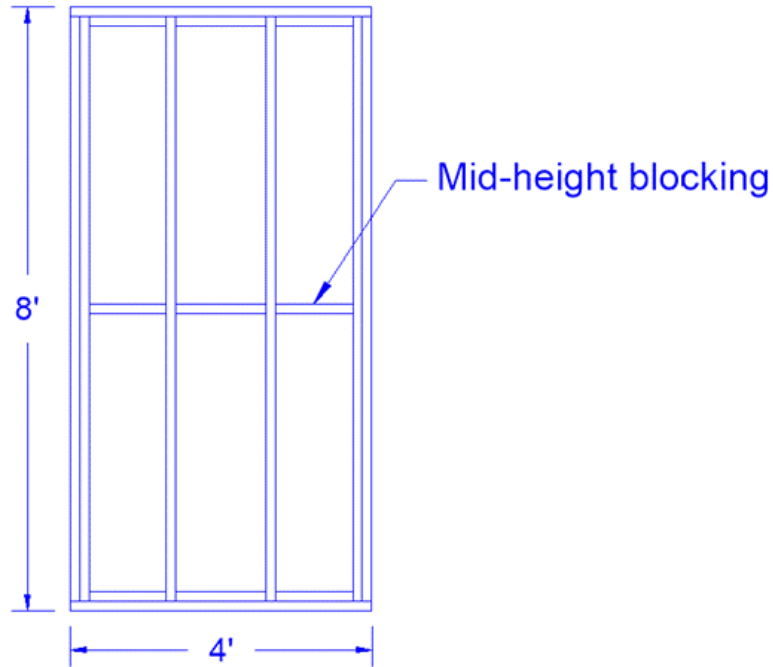


Figure 4. Framing Configuration 3

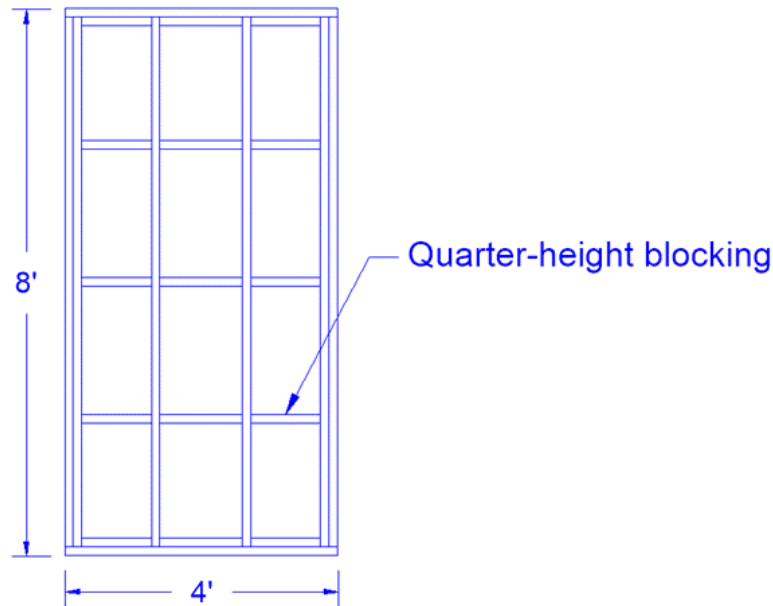


Figure 5. Framing Configuration 4

2.5 As needed, review material properties for design in **Section 6**.



3 Definitions

- 3.1 New Materials² are defined as building materials, equipment, appliances, systems or methods of construction not provided for by prescriptive and/or legislatively adopted regulations, known as alternative materials.³ The design strengths and permissible stresses shall be established by tests⁴ and/or engineering analysis.⁵
- 3.2 Duly Authenticated Reports⁶ and Research Reports⁷ are test reports and related engineering evaluations, which are written by an approved agency⁸ and/or an approved source.⁹
- 3.2.1 These reports contain intellectual property and/or trade secrets, which are protected by the Defend Trade Secrets Act (DTSA).¹⁰
- 3.3 An approved agency is “approved” when it is ANAB ISO/IEC 17065 accredited. DrJ Engineering, LLC (DrJ) is listed in the ANAB directory.
- 3.4 An approved source is “approved” when a professional engineer (i.e., Registered Design Professional) is properly licensed to transact engineering commerce. The regulatory authority governing approved sources is the state legislature via its professional engineering regulations.¹¹
- 3.5 Testing and/or inspections conducted for this Duly Authenticated Report were performed by an ISO/IEC 17025 accredited testing laboratory, an ISO/IEC 17020 accredited inspection body and/or a licensed Registered Design Professional (RDP).
- 3.5.1 The Center for Building Innovation (CBI) is ANAB¹² ISO/IEC 17025 and ISO/IEC 17020 accredited.
- 3.6 The regulatory authority shall enforce¹³ the specific provisions of each legislatively adopted regulation. If there is a non-conformance, the specific regulatory section and language of the non-conformance shall be provided in writing¹⁴ stating the nonconformance and the path to its cure.
- 3.7 The regulatory authority shall accept Duly Authenticated Reports from an approved agency and/or an approved source with respect to the quality and manner of use of new materials or assemblies as provided for in regulations regarding the use of alternative materials, designs or methods of construction.¹⁵
- 3.8 ANAB is an International Accreditation Forum (IAF) Multilateral Recognition Arrangement (MLA) signatory where recognition of certificates, validation and verification statements issued by conformity assessment bodies accredited by all other signatories of the IAF MLA with the appropriate scope, shall be approved.¹⁶ Therefore, all ANAB ISO/IEC 17065 Duly Authenticated Reports are approval equivalent.¹⁷
- 3.9 Approval equity is a fundamental commercial and legal principle.¹⁸

4 Applicable Standards for the Listing; Regulations for the Regulatory Evaluation¹⁹

- 4.1 *Standards*
- 4.1.1 *ANSI/AWC SDPWS: Special Design Provisions for Wind and Seismic*
- 4.1.2 *ASCE/SEI 7: Minimum Design Loads and Associated Criteria for Buildings and Other Structures*
- 4.1.3 *ASTM D7989: Standard Practice for Demonstrating Equivalent In-Plane Lateral Seismic Performance to Wood-Frame Shear Walls Sheathed with Wood Structural Panels*
- 4.1.4 *ASTM E564: Standard Practice for Static Load Test for Shear Resistance of Framed Walls for Buildings*
- 4.2 Structural performance for shear wall assemblies used as lateral force resisting systems in Seismic Design Categories A through F, have been tested and evaluated in accordance with the following standards:
- 4.2.1 *ASCE/SEI 7: Minimum Design Loads and Associated Criteria for Buildings and Other Structures*
- 4.2.2 *ASTM D7989: Standard Practice for Demonstrating Equivalent In-Plane Lateral Seismic Performance to Wood-Frame Shear Walls Sheathed with Wood Structural Panels*
- 4.2.3 *ASTM E72: Standard Test Methods of Conducting Strength Tests of Panels for Building Construction*
- 4.2.4 *ASTM E564: Standard Practice for Static Load Test for Shear Resistance of Framed Walls for Buildings*



4.2.5 *ASTM E2126: Standard Test Methods for Cyclic (Reversed) Load Test for Shear Resistance of Vertical Elements of the Lateral Force Resisting Systems for Buildings*

- 4.2.5.1 ASTM D7989 is accepted engineering practice used to establish Seismic Design Coefficients (SDCs). Test data generated by ISO/IEC 17025 approved agencies and/or professional engineers and all associated professional engineering evaluations which use ASTM D7989 as their basis, are defined as intellectual property and/or trade secrets and are also defined as an Independent Design Review (i.e., Listings, certified reports, duly authenticated reports from approved agencies and/or research reports prepared by approved agencies and/or approved sources).

5 Listed²⁰

- 5.1 Equipment, materials, products or services included in a List published by a nationally recognized testing laboratory (i.e., CBI), approved agency (i.e., CBI and DrJ), and/or approved source (i.e., DrJ) or other organization concerned with product evaluation (i.e., DrJ) that maintains periodic inspection (i.e., CBI) of production of listed equipment or materials, and whose listing states either that the equipment or material meets nationally recognized standards or has been tested and found suitable for use in a specified manner.

6 Tabulated Properties Generated from Nationally Recognized Standards

6.1 *Structural Applications*

6.1.1 *General Provisions:*

- 6.1.1.1 Except as otherwise described in this report, OX-IS shall be installed in accordance with the applicable building codes using the provisions set forth herein for the design and installation of WSP.
- 6.1.1.2 OX-IS shall be permitted to be designed in accordance with SDPWS for the design of shear walls using the methods set forth therein, and subject to the SDPWS boundary conditions, except as specifically allowed in this report.
- 6.1.1.3 Anchorage for in-plane shear shall be provided to transfer the induced shear force into and out of each shear wall.
- 6.1.1.3.1 For wind design, anchor bolt spacing shall not exceed 6' o.c.
- 6.1.1.3.2 For seismic design, anchor bolt spacing shall not exceed 4' o.c.
- 6.1.1.4 Maximum aspect ratio for OX-IS shall be 2:1 when designed and installed in accordance with this report.
- 6.1.1.4.1 A maximum aspect ratio for OX-IS of 4:1 is permitted when OX-IS is designed and installed in accordance with Report Number 0804-01.
- 6.1.1.5 All panel edges shall be blocked with a minimum 2" nominal lumber.
- 6.1.1.6 Fasteners may be countersunk beneath the outer surface of the foam plastic sheathing layer.
- 6.1.1.7 Installation is permitted for single top plate (advanced framing method) or double top plate applications.



6.1.2 Performance-Based Wood-Framed Construction:

- 6.1.2.1 OX-IS wall assemblies designed as shear walls are permitted to resist lateral wind load forces using the allowable shear loads (in pounds per linear foot) set forth in **Table 1**.

Table 1. Wind Allowable Unit Shear Capacity for Light-Frame Wood Walls Sheathed with OX-IS

Structural Sheathing Product	Structural Sheathing Thickness (in)	Maximum Fastener Spacing ^{1,2,3} (edge:field), (in)	Framing Configuration ⁸	GWB Thickness (in)	GWB Fastener ⁴ Spacing (edge:field), (in)	Allowable Unit Shear Capacity (plf)
OX-IS	1/2"	3:3 o.c. ⁵	Figure 3	1/2"	8:8 o.c.	475
	1/2"	3:3 o.c. ⁵	Figure 3	1/2"	4:16 o.c. ⁶	555
	1/2"	3:3 o.c. ⁵	Figure 3	1/2"	4:16 o.c. ⁷	680
	1/2"	3:3 o.c. ⁵	Figure 4	1/2"	8:8 o.c.	505
	1/2"	3:3 o.c. ⁵	Figure 5	1/2"	8:8 o.c.	530

SI: 1 in = 25.4 mm, 1 lb/ft = 0.0146 kN/m

- Unless otherwise stated, OX-IS attached to wood framing with minimum 16-gauge, 7/16" crown galvanized staples, shall penetrate a minimum of 1.0" into the wood framing members.
- Fasteners are to be installed with the crown parallel to the framing.
- Fastener edge distance shall be a minimum of 3/8". Fastener head shall be in contact with the panel surface. Alternately, fastener heads are permitted to be overdriven into foam portion of the panel with no reduction in shear capacities.
- Where applicable, GWB shall be attached with minimum #6 type W or S screws, 1 1/4" long with a minimum edge distance of 3/8".
- OX-IS were fastened as follows:
 - Two rows of fasteners – one row of fasteners into each end stud (wall framing contains two end studs at the panel edges)
 - One row of fasteners in the intermediate studs
 - One row of fasteners into the plates
 - One of fasteners into the blocking members
- GWB was fastened with one row into the outermost framing members, and one row into the mid-height blocking members. OX-IS were not fastened at the interior end studs and blocking members adjacent to the plates.
- GWB were fastened as follows:
 - Two rows of fasteners – one row of fasteners into each end stud (wall framing contains two end studs at the panel edges)
 - One row of fasteners in the intermediate studs
 - One row of fasteners into the plates
 - One of fasteners into the all blocking members
- Maximum stud spacing shall be 16" o.c.



- 6.1.2.2 OX-IS wall assemblies designed as shear walls are permitted to resist seismic load forces using the seismic allowable unit shear capacities set forth in **Table 2** when seismic design is required in accordance with the applicable building code.

Table 2. Seismic Allowable Unit Shear Capacity for Light-Frame Wood Walls Sheathed with OX-IS

Product	Product Thickness (in)	Maximum Fastener Spacing ^{1,2,3} (edge:field), (in)	Framing Configuration ⁸	GWB Thickness (in)	GWB Fastening Spacing ⁴ (edge:field), (in)	Seismic Allowable Unit Shear Capacity (plf)	Apparent Shear Stiffness, G_a (kips/in)
OX-IS	1/2"	3:3 o.c. ⁵	Figure 3	1/2"	8:8 o.c.	380	13.0
	1/2"	3:3 o.c. ⁵	Figure 3	1/2"	4:16 o.c. ⁶	445	19.3
	1/2"	3:3 o.c. ⁵	Figure 3	1/2"	4:16 o.c. ⁷	545	29.3
	1/2"	3:3 o.c. ⁵	Figure 4	1/2"	8:8 o.c.	405	14.0
	1/2"	3:3 o.c. ⁵	Figure 5	1/2"	8:8 o.c.	420	14.7

SI: 1 in = 25.4 mm, 1 lb/ft = 0.0146 kN/m, 1 kips/in = 175.1 kN/m

- Unless otherwise stated, OX-IS attached to wood framing with minimum 16-gauge 7/16" crown galvanized staples, shall penetrate a minimum of 1.0" into the wood framing members.
- Fasteners are to be installed with the crown parallel to the framing.
- Fastener edge distance shall be a minimum of 3/8". Fastener head shall be in contact with the panel surface. Alternately, fastener heads are permitted to be overdriven into foam portion of the panel with no reduction in shear capacities.
- Where applicable, GWB shall be attached with minimum #6 type W or S screws, 1 1/4" long with a minimum edge distance of 3/8".
- OX-IS were fastened as follows:
 - Two rows of fasteners – one row of fasteners into each end stud (wall framing contains two end studs at the panel edges)
 - One row of fasteners in the intermediate studs
 - One row of fasteners into the plates
 - One of fasteners into the blocking members
- GWB was fastened with one row into the outermost framing members, and one row into the mid-height blocking members. OX-IS were not fastened at the interior end studs and blocking members adjacent to the plates.
- GWB were fastened as follows:
 - Two rows of fasteners – one row of fasteners into each end stud (wall framing contains two end studs at the panel edges)
 - One row of fasteners in the intermediate studs
 - One row of fasteners into the plates
 - One of fasteners into the all blocking members.
- Maximum stud spacing shall be 16" o.c.

- 6.2 Where the application falls outside of the performance evaluation, conditions of use and/or installation requirements set forth herein, alternative techniques shall be permitted in accordance with accepted engineering practice and experience. This includes but is not limited to the following areas of engineering: mechanics or materials, structural, building science and fire science.

7 Certified Performance²¹

- 7.1 All construction methods shall conform to accepted engineering practices to ensure durable, livable and safe construction and shall demonstrate acceptable workmanship reflecting journeyman quality of work of the various trades.²²
- 7.2 The strength and rigidity of the component parts and/or the integrated structure shall be determined by engineering analysis or by suitable load tests to simulate the actual loads and conditions of application that occur.²³



8 Installation

- 8.1 Installation shall comply with the approved construction documents, the manufacturer installation instructions, this report and the applicable building code.
- 8.2 In the event of a conflict between the manufacturer installation instructions and this report, the more restrictive shall govern.
- 8.3 OX-IS may be installed vertically or horizontally over studs, with framing that has a nominal thickness of not less than 2" (50.8 mm) and spaced a maximum of 16" (406 mm) o.c.
- 8.4 Sheathing joints shall be butted at framing members, and all panel edges shall be blocked.
 - 8.4.1 A single row of fasteners must be applied to each panel edge into the stud or blocking below.
 - 8.4.2 Do not tack product to framing, but fasten each panel completely after fastening begins.
- 8.5 Where hold-down straps are used, install structural sheathing first, remove foam at the strap location, then install the strap over the face of the structural sheathing backer, and attach per the manufacturer installation instructions.
- 8.6 *OX-IS Fastening Details*
 - 8.6.1 Where used, always fasten staples parallel to the framing member.
 - 8.6.2 Minimum $\frac{7}{16}$ " crown by $1\frac{1}{2}$ " leg, 16-gauge, galvanized staples with a 1.0" minimum embedment into the stud unless otherwise stated in **Section 6**.
 - 8.6.3 Fastener spacing shall be a maximum of 3" o.c. (76.2 mm) along the edge and 3" o.c. in the field unless otherwise permitted in **Section 6**.
- 8.7 *GWB Fastening Details*
 - 8.7.1 Fasteners shall be installed with a nominal edge distance of $\frac{3}{8}$ " (9.5 mm) for GWB.
 - 8.7.2 Where required, GWB shall be a minimum $\frac{1}{2}$ " thickness and shall be attached with one of the following:
 - 8.7.2.1 #6 x $1\frac{1}{4}$ " Type W or S screws
 - 8.7.3 Fastener spacing shall be as shown in **Section 6**.
- 8.8 *Treatment of Joints*
 - 8.8.1 OX-IS sheathing joints must be butted at framing members, and a single row of fasteners must be applied to each panel edge into the stud below.
 - 8.8.1.1 Install staples parallel to framing.
- 8.9 *Window Treatments*
 - 8.9.1 OX-IS must be installed with appropriate flashing and counter-flashing in conformance with accepted building standards and in compliance with local building codes and the flashing manufacturer installation instructions.

9 Substantiating Data

- 9.1 Testing has been performed under the supervision of a professional engineer and/or under the requirements of ISO/IEC 17025 as follows:
 - 9.1.1 Lateral wall testing performed in accordance with ASTM E564
- 9.2 Information contained herein may include the result of testing and/or data analysis by sources that are approved agencies, approved sources and/or RDPs. Accuracy of external test data and resulting analysis is relied upon.



- 9.3 Where pertinent, testing and/or engineering analysis are based upon provisions that have been codified into law through state or local adoption of regulations and standards. The developers of these regulations and standards are responsible for the reliability of published content. DrJ's engineering practice may use a regulation-adopted provision as the control. A regulation-endorsed control versus a simulation of the conditions of application to occur establishes a new material as being equivalent to the regulatory provision in terms of quality, strength, effectiveness, fire resistance, durability and safety.
- 9.4 The accuracy of the provisions provided herein may be reliant upon the published properties of raw materials, which are defined by the grade mark, grade stamp, mill certificate, or duly authenticated reports from approved agencies and/or approved sources provided by the supplier. These are presumed to be minimum properties and relied upon to be accurate. The reliability of DrJ's engineering practice, as contained in this Duly Authenticated Report, may be dependent upon published design properties by others.
- 9.5 Testing and engineering analysis: The strength, rigidity and/or general performance of component parts and/or the integrated structure are determined by suitable tests that simulate the actual conditions of application that occur and/or by accepted engineering practice and experience.²⁴
- 9.6 Where additional condition of use and/or regulatory compliance information is required, please search for OX-IS on the DrJ Certification website.

10 Findings

- 10.1 As outlined in **Section 6**, OX-IS has performance characteristics that were tested and/or meet applicable regulations and is suitable for use pursuant to its specified purpose.
- 10.2 When used and installed in accordance with this Duly Authenticated Report and the manufacturer installation instructions, OX-IS shall be approved for the following applications:
- 10.2.1 Use to resist wind loading and seismic loading in accordance with the applicable building codes for light-frame wood wall assemblies.
- 10.3 Unless exempt by state statute, when OX-IS is to be used as a structural and/or building envelope component in the design of a specific building, the design shall be performed by an RDP.
- 10.4 Any application specific issues not addressed herein can be engineered by an RDP. Assistance with engineering is available from OX Engineered Products, Inc.
- 10.5 IBC Section 104.11 (IRC Section R104.11 and IFC Section 104.10²⁵ are similar) in pertinent part states:
- 104.11 Alternative materials, design and methods of construction and equipment.** The provisions of this code are not intended to prevent the installation of any material or to prohibit any design or method of construction not specifically prescribed by this code. Where the alternative material, design or method of construction is not approved, the building official shall respond in writing, stating the reasons the alternative was not approved.
- 10.6 **Approved:**²⁶ Building regulations require that the building official shall accept Duly Authenticated Reports.²⁷
- 10.6.1 An approved agency is "approved" when it is ANAB ISO/IEC 17065 accredited.
- 10.6.2 An approved source is "approved" when an RDP is properly licensed to transact engineering commerce.
- 10.6.3 Federal law, Title 18 US Code Section 242, requires that where the alternative product, material, service, design, assembly and/or method of construction is not approved, the building official shall respond in writing, stating the reasons why the alternative was not approved. Denial without written reason deprives a protected right to free and fair competition in the marketplace.
- 10.7 DrJ is a licensed engineering company, employs licensed RDPs and is an ANAB-Accredited Product Certification Body – Accreditation #1131.
- 10.8 Through the IAF Multilateral Agreements (MLA), this Duly Authenticated Report can be used to obtain product approval in any jurisdiction or country because all ANAB ISO/IEC 17065 Duly Authenticated Reports are equivalent.²⁸



11 Conditions of Use

- 11.1 Material properties shall not fall outside the boundaries defined in **Section 6**.
- 11.2 As defined in **Section 6**, where material and/or engineering mechanics properties are created for load resisting design purposes, the resistance to the applied load shall not exceed the ability of the defined properties to resist those loads using the principles of accepted engineering practice.
- 11.3 As listed herein, OX-IS shall not be used:
 - 11.3.1 As a nailing base for claddings, trim, windows, or doors.
 - 11.3.1.1 Fastening through the OX-IS into the framing may be acceptable.
 - 11.3.2 To resist horizontal loads from concrete and masonry walls.
 - 11.3.2.1 When used behind masonry, devices such as masonry ties shall be used to transfer the load to the main force resisting system.
- 11.4 Design loads shall be determined in accordance with the building code adopted by the jurisdiction in which the project is to be constructed.
- 11.5 Allowable shear loads shall not exceed the values in **Table 1** for wind loads or **Table 2** for seismic loads.
- 11.6 All panel edges shall be supported by nominal 2x wall framing or solid blocking.
- 11.7 When required by adopted legislation and enforced by the building official, also known as the authority having jurisdiction (AHJ) in which the project is to be constructed:
 - 11.7.1 Any calculations incorporated into the construction documents shall conform to accepted engineering practice and, when prepared by an approved source, shall be approved when signed and sealed.
 - 11.7.2 This report and the installation instructions shall be submitted at the time of permit application.
 - 11.7.3 This innovative product has an internal quality control program and a third-party quality assurance program.
 - 11.7.4 At a minimum, this innovative product shall be installed per **Section 8** of this report.
 - 11.7.5 The review of this report by the AHJ shall comply with IBC Section 104 and IBC Section 105.4.
 - 11.7.6 This innovative product has an internal quality control program and a third party quality assurance program in accordance with IBC Section 104.4, IBC Section 110.4, IBC Section 1703, IRC Section R104.4 and IRC Section R109.2.
 - 11.7.7 The application of this innovative product in the context of this report is dependent upon the accuracy of the construction documents, implementation of installation instructions, inspection as required by IBC Section 110.3, IRC Section R109.2 and any other regulatory requirements that may apply.
- 11.8 The approval of this report by the AHJ shall comply with IBC Section 1707.1, where legislation states in part, *"the building official shall accept duly authenticated reports from approved agencies in respect to the quality and manner of use of new material or assemblies as provided for in Section 104.11",* all of IBC Section 104 and IBC Section 105.4.
- 11.9 Design loads shall be determined in accordance with the regulations adopted by the jurisdiction in which the project is to be constructed and/or by the building designer (i.e., owner or RDP).
- 11.10 The actual design, suitability and use of this report for any particular building, is the responsibility of the owner or the authorized agent of the owner.



12 Identification

- 12.1 The innovative product listed in **Section 1.1** is identified by a label on the board or packaging material bearing the manufacturer name, product name, this report number and other information to confirm code compliance.
- 12.2 Additional technical information can be found at www.oxengineeredproducts.com/product/ox-is.

13 Review Schedule

- 13.1 This report is subject to periodic review and revision. For the latest version, visit www.drjcertification.org.
- 13.2 For information on the status of this report, please contact [DrJ Certification](#).

14 Approved for Use Pursuant to U.S. and International Legislation Defined in Appendix A

- 14.1 1/2" OX-IS Structural Insulated Sheathing is included in this report published by an approved agency that is concerned with evaluation of products or services, maintains periodic inspection of the production of listed materials or periodic evaluation of services. This report states either that the material, product, or service meets recognized standards or has been tested and found suitable for a specified purpose. This report meets the legislative intent and definition of being acceptable to the AHJ.



Appendix A

1 Legislation that Authorizes AHJ Approval

- 1.1 **Fair Competition:** State legislatures have adopted Federal regulations for the examination and approval of building code referenced and alternative products, materials, designs, services, assemblies and/or methods of construction that:
 - 1.1.1 Advance innovation,
 - 1.1.2 Promote competition so all businesses have the opportunity to compete on price and quality in an open market on a level playing field unhampered by anticompetitive constraints, and
 - 1.1.3 Benefit consumers through lower prices, better quality and greater choice.
- 1.2 **Adopted Legislation:** The following local, state and federal regulations affirmatively authorize this innovative product to be approved by AHJs, delegates of building departments and/or delegates of an agency of the federal government:
 - 1.2.1 Interstate commerce is governed by the Federal Department of Justice to encourage the use of innovative products, materials, designs, services, assemblies and/or methods of construction. The goal is to “*protect economic freedom and opportunity by promoting free and fair competition in the marketplace.*”
 - 1.2.2 Title 18 US Code Section 242 affirms and regulates the right of individuals and businesses to freely and fairly have new products, materials, designs, services, assemblies and/or methods of construction approved for use in commerce. Disapproval of alternatives shall be based upon non-conformance with respect to specific provisions of adopted legislation and shall be provided in writing stating the reasons why the alternative was not approved, with reference to the specific legislation violated.
 - 1.2.3 The federal government and each state have a public records act. In addition, each state also has legislation that mimics the federal Defend Trade Secrets Act 2016 (DTSA),²⁹ where providing test reports, engineering analysis and/or other related IP/TS is subject to prison of not more than ten years³⁰ and/or a \$5,000,000 fine or 3 times the value of³¹ the Intellectual Property (IP) and Trade Secrets (TS).
 - 1.2.3.1 Compliance with public records and trade secret legislation requires approval through the use of Listings, certified reports, Technical Evaluation Reports, Duly Authenticated Reports and/or research reports prepared by approved agencies and/or approved sources.
 - 1.2.4 For new materials³² that are not specifically provided for in any regulation, the design strengths and permissible stresses shall be established by tests, where suitable load tests simulate the actual loads and conditions of application that occur.
 - 1.2.5 The design strengths and permissible stresses of any structural material shall conform to the specifications and methods of design using accepted engineering practice.³³
 - 1.2.6 The commerce of approved sources (i.e., registered PEs) is regulated by professional engineering legislation. Professional engineering commerce shall always be approved by AHJs, except where there is evidence provided in writing, that specific legislation have been violated by an individual registered PE.
 - 1.2.7 The AHJ shall accept Duly Authenticated Reports from approved agencies in respect to the quality and manner of use of new materials or assemblies as provided for in IBC Section 104.11.³⁴



- 1.3 **Approved³⁵ by Los Angeles:** The Los Angeles Municipal Code (LAMC) states in pertinent part that the provisions of LAMC are not intended to prevent the use of any material, device, or method of construction not specifically prescribed by LAMC. The Department shall use Part III, Recognized Standards in addition to Part II, Uniform Building Code Standards of Division 35, Article 1, Chapter IX of the LAMC in evaluation of products for approval where such standard exists for the product or the material and may use other approved standards that apply. Whenever tests or certificates of any material or fabricated assembly are required by Chapter IX of the LAMC, such tests or certification shall be made by a testing agency approved by the Superintendent of Building to conduct such tests or provide such certifications. The testing agency shall publish the scope and limitation(s) of the listed material or fabricated assembly.³⁶ The Superintendent of Building Approved Testing Agency Roster is provided by the Los Angeles Department of Building and Safety (LADBS). The Center for Building Innovation (CBI) Certificate of Approval License is TA24945. Tests and certifications found in a DrJ Listing are LAMC approved. In addition, the Superintendent of Building shall accept Duly Authenticated Reports from approved agencies in respect to the quality and manner of use of new materials or assemblies as provided for in the California Building Code (CBC) Section 1707.1.³⁷
- 1.4 **Approved by Chicago:** The Municipal Code of Chicago (MCC) states in pertinent part that an Approved Agency is a Nationally Recognized Testing Laboratory (NRTL) acting within its recognized scope and/or a certification body accredited by the American National Standards Institute (ANSI) acting within its accredited scope. Construction materials and test procedures shall conform to the applicable standards listed in the MCC. Sufficient technical data shall be submitted to the building official to substantiate the proposed use of any product, material, service, design, assembly and/or method of construction not specifically provided for in the MCC. This technical data shall consist of research reports from approved sources (i.e., MCC defined Approved Agencies).
- 1.5 **Approved by New York City:** The 2022 NYC Building Code (NYCBC) states in part that an approved agency shall be deemed³⁸ an approved testing agency via ISO/IEC 17025 accreditation, an approved inspection agency via ISO/IEC 17020 accreditation and an approved product evaluation agency via ISO/IEC 17065 accreditation. Accrediting agencies, other than federal agencies, must be members of an internationally recognized cooperation of laboratory and inspection accreditation bodies subject to a mutual recognition agreement³⁹ (i.e., ANAB, International Accreditation Forum (IAF), etc.).
- 1.6 **Approved by Florida:** Statewide approval of products, methods, or systems of construction shall be approved, without further evaluation by:
- 1.6.1 A certification mark or listing of an approved certification agency,
 - 1.6.2 A test report from an approved testing laboratory,
 - 1.6.3 A product evaluation report based upon testing or comparative or rational analysis, or a combination thereof, from an approved product evaluation entity, or
 - 1.6.4 A product evaluation report based upon testing, comparative or rational analysis, or a combination thereof, developed, signed and sealed by a professional engineer or architect, licensed in Florida.
- 1.7 For local product approval, products or systems of construction shall demonstrate compliance with the structural wind load requirements of the Florida Building Code (FBC) through one of the following methods:
- 1.7.1 A certification mark, listing or label from a commission-approved certification agency indicating that the product complies with the code,
 - 1.7.2 A test report from a commission-approved testing laboratory indicating that the product tested complies with the code,
 - 1.7.3 A product-evaluation report based upon testing, comparative or rational analysis, or a combination thereof, from a commission-approved product evaluation entity which indicates that the product evaluated complies with the code,



- 1.7.4 A product-evaluation report or certification based upon testing or comparative or rational analysis, or a combination thereof, developed and signed and sealed by a Florida professional engineer or Florida registered architect, which indicates that the product complies with the code, or
- 1.7.5 A statewide product approval issued by the Florida Building Commission.
- 1.8 The [Florida Department of Business and Professional Regulation \(DBPR\)](#) website provides a listing of companies certified as a [Product Evaluation Agency](#) (i.e., EVLMiami 13692), a [Product Certification Agency](#) (i.e., CER10642) and as a [Florida Registered Engineer](#) (i.e., ANE13741).
- 1.9 **Approved by Miami-Dade County (i.e., Notice of Acceptance [NOA]):** A Florida statewide approval is an NOA. An NOA is a Florida local product approval. By Florida law, Miami-Dade County shall accept the statewide and local Florida Product Approval as provided for in Florida legislation [553.842](#) and [553.8425](#).
- 1.10 **Approved by New Jersey:** Pursuant to the 2018 Building Code of New Jersey in [IBC Section 1707.1 General](#),⁴⁰ it states: “*In the absence of approved rules or other approved standards, the building official shall accept duly authenticated reports from [approved agencies](#) in respect to the quality and manner of use of new materials or assemblies as provided for in the administrative provisions of the Uniform Construction Code (N.J.A.C. 5:23)*”.⁴¹ Furthermore N.J.A.C 5:23-3.7 states: “*Municipal approvals of alternative materials, equipment, or methods of construction.*”
- 1.10.1 **Approvals:** Alternative materials, equipment, or methods of construction shall be approved by the appropriate subcode official provided the proposed design is satisfactory and that the materials, equipment, or methods of construction are suitable for the intended use and are at least the equivalent in quality, strength, effectiveness, fire resistance, durability and safety of those conforming with the requirements of the regulations.
- 1.10.1.1 A field evaluation label and report or letter issued by a nationally recognized testing laboratory verifying that the specific material, equipment, or method of construction meets the identified standards or has been tested and found to be suitable for the intended use, shall be accepted by the appropriate subcode official as meeting the requirements of the above.
- 1.10.1.2 Reports of engineering findings issued by nationally recognized evaluation service programs such as but not limited to, the Building Officials and Code Administrators (BOCA), the International Conference of Building Officials (ICBO), the Southern Building Code Congress International (SBCCI), the International Code Council (ICC) and the National Evaluation Service, Inc., shall be accepted by the appropriate subcode official as meeting the requirements of the above.
- 1.10.2 The [New Jersey Department of Community Affairs](#) has confirmed that technical evaluation reports, from any accredited entity listed by [ANAB](#), meets the requirements of item the previous paragraph, given that the listed entities are no longer in existence and/or do not provide “*reports of engineering findings*”.
- 1.11 **Approved by the Code of Federal Regulations Manufactured Home Construction and Safety Standards:** Pursuant to Title 24, Subtitle B, Chapter XX, [Part 3282.14](#)⁴² and [Part 3280](#),⁴³ the Department encourages innovation and the use of new technology in manufactured homes. The design and construction of a manufactured home shall conform to the provisions of Part 3282 and Part 3280 where key approval provisions in mandatory language follow:
- 1.11.1 “*All construction methods shall be in conformance with accepted engineering practices.*”
- 1.11.2 “*The strength and rigidity of the component parts and/or the integrated structure shall be determined by engineering analysis or by suitable load tests to simulate the actual loads and conditions of application that occur.*”
- 1.11.3 “*The design stresses of all materials shall conform to accepted engineering practice.*”



- 1.12 **Approval by US, Local and State Jurisdictions in General:** In all other local and state jurisdictions, the adopted building code legislation states in pertinent part that:
- 1.12.1 For new materials that are not specifically provided for in this code, the design strengths and permissible stresses shall be established by tests.⁴⁴
 - 1.12.2 For innovative alternatives and/or methods of construction, the building official shall accept duly authenticated reports from approved agencies with respect to the quality and manner of use of new materials or assemblies.⁴⁵
 - 1.12.2.1 An approved agency is “*approved*” when it is ANAB ISO/IEC 17065 accredited. DrJ Engineering, LLC (DrJ) is in the ANAB directory.
 - 1.12.2.2 An approved source is “*approved*” when an RDP is properly licensed to transact engineering commerce. The regulatory authority governing approved sources is the state legislature via its professional engineering regulations.⁴⁶
 - 1.12.3 The design strengths and permissible stresses of any structural material...shall conform to the specifications and methods of design of accepted engineering practice performed by an approved source.⁴⁷
- 1.13 **Approval by International Jurisdictions:** The USMCA and GATT agreements provide for approval of innovative materials, designs, services and/or methods of construction through the Agreement on Technical Barriers to Trade and the IAF Multilateral Recognition Arrangement (MLA), where these agreements:
- 1.13.1 State that conformity assessment procedures (i.e., ISO/IEC 17020, 17025, 17065, etc.) are prepared, adopted and applied so as to grant access for suppliers of like products originating in the territories of other Members under conditions no less favourable than those accorded to suppliers of like products of national origin or originating in any other country, in a comparable situation.
 - 1.13.2 **Approved:** The purpose of the MLA is to ensure mutual recognition of accredited certification and validation/verification statements between signatories to the MLA and subsequently, acceptance of accredited certification and validation/verification statements in many markets based on one accreditation for the timely approval of innovative materials, designs, services and/or methods of construction.
 - 1.13.3 ANAB is an IAF-MLA signatory where recognition of certificates, validation and verification statements issued by conformity assessment bodies accredited by all other signatories of the IAF MLA, with the appropriate scope, shall be approved.⁴⁸
 - 1.13.4 Therefore, all ANAB ISO/IEC 17065 Duly Authenticated Reports are approval equivalent.⁴⁹
- 1.14 Approval equity is a fundamental commercial and legal principle.⁵⁰



For more information, visit www.dricertification.org or call us at 608-310-6748.

<https://up.codes/viewer/wyoming/ibc-2021/chapter/17/special-inspections-and-tests#1702>

Alternative Materials, Design and Methods of Construction and Equipment: The provisions of any regulation code are not intended to prevent the installation of any material or to prohibit any design or method of construction not specifically prescribed by a regulation. Please review <https://www.justice.gov/atr/mision> and <https://up.codes/viewer/colorado/ibc-2021/chapter/1/scope-and-administration#104.11>

<https://up.codes/viewer/wyoming/ibc-2021/chapter/17/special-inspections-and-tests#1706>:~:text=the%20design%20strengths%20and%20permissible%20stresses%20shall%20be%20established%20by%20tests%20as

The design strengths and permissible stresses of any structural material shall conform to the specifications and methods of design of accepted engineering practice.

<https://up.codes/viewer/wyoming/ibc-2021/chapter/17/special-inspections-and-tests#1706>:~:text=shall%20conform%20to%20the%20specifications%20and%20methods%20of%20design%20of%20accepted%20engineering%20practice

<https://up.codes/viewer/wyoming/ibc-2021/chapter/17/special-inspections-and-tests#1707.1>:~:text=the%20building%20official%20shall%20accept%20duly%20authenticated%20reports%20from%20approved%20agencies

<https://up.codes/viewer/wyoming/ibc-2021/chapter/17/special-inspections-and-tests#1703.4.2>

https://up.codes/viewer/wyoming/ibc-2021/chapter/2/definitions#approved_agency

https://up.codes/viewer/wyoming/ibc-2021/chapter/2/definitions#approved_source

<https://www.law.cornell.edu/uscode/text/18/1832> (b) Any organization that commits any offense described in subsection (a) shall be fined not more than the greater of \$5,000,000 or 3 times the value of the stolen trade secret to the organization, including expenses for research and design and other costs of reproducing the trade secret that the organization has thereby avoided. The federal government and each state have a public records act. To follow DTSA and comply state public records and trade secret legislation requires approval through ANAB ISO/IEC 17065 accredited certification bodies or approved sources. For more information, please review this website: Intellectual Property and Trade Secrets.

<https://www.nspe.org/resources/issues-and-advocacy/professional-policies-and-position-statements/regulation-professional> AND <https://apassociation.org/list-of-engineering-boards-in-each-state-archive/>

<https://www.cbtest.com/accreditation/>

<https://up.codes/viewer/colorado/ibc-2021/chapter/1/scope-and-administration#104>:~:text=to%20enforce%20the%20provisions%20of%20this%20code

<https://up.codes/viewer/colorado/ibc-2021/chapter/1/scope-and-administration#104.11>:~:text=Where%20the%20alternative%20material%2C%20design%20or%20method%20of%20construction%20is%20not%20approved%2C%20the%20building%20official%20shall%20respond%20in%20writing%2C%20stating%20the%20reasons%20why%20the%20alternative%20was%20not%20approved AND

<https://up.codes/viewer/colorado/ibc-2021/chapter/1/scope-and-administration#105.3.1>:~:text=If%20the%20application%20or%20the%20construction%20documents%20do%20not%20conform%20to%20the%20requirements%20of%20pertinent%20laws%2C%20the%20building%20official%20shall%20reject%20such%20application%20in%20writing%2C%20stating%20the%20reasons%20therefore

<https://up.codes/viewer/colorado/ibc-2021/chapter/17/special-inspections-and-tests#1707.1>:~:text=the%20building%20official%20shall%20accept%20duly%20authenticated%20reports%20from%20approved%20agencies%20in%20respect%20to%20the%20quality%20and%20manner%20of%20use%20of%20new%20materials%20or%20assemblies%20as%20provided%20for%20in%20Section%20104.11

<https://iaf.nu/en/about-iaf-mla/#>:~:text=it%20is%20required%20to%20recognise%20certificates%20and%20validation%20and%20verification%20statements%20issued%20by%20conformity%20assessment%20bodies%20accredited%20by%20all%20other%20signatories%20of%20the%20IAF%20MLA%2C%20with%20the%20appropriate%20scope

True for all ANAB accredited product evaluation agencies and all International Trade Agreements.

<https://www.justice.gov/crt/deprivation-rights-under-color-law> AND <https://www.justice.gov/atr/mision>

Unless otherwise noted, all references in this Listing are from the 2021 version of the codes and the standards referenced therein. This material, product, design, service and/or method of construction also complies with the 2000-2021 versions of the referenced codes and the standards referenced therein.

<https://www.ecfr.gov/current/title-24/subtitle-B/chapter-XX/part-3280#p-3280.2>(Listed%20or%20certified); <https://up.codes/viewer/colorado/ibc-2021/chapter/2/definitions#listed> AND <https://up.codes/viewer/colorado/ibc-2021/chapter/2/definitions#labeled>

<https://up.codes/viewer/colorado/ibc-2021/chapter/17/special-inspections-and-tests#1703.4>

<https://www.ecfr.gov/current/title-24/subtitle-B/chapter-XX/part-3280#>:~:text=All%20construction%20methods%20shall%20be%20in%20conformance%20with%20accepted%20engineering%20practices%20to%20insure%20durable%2C%20livable%2C%20and%20safe%20housing%20and%20shall%20demonstrate%20acceptable%20workmanship%20reflecting%20journeyman%20quality%20of%20work%20of%20the%20various%20trades

<https://www.ecfr.gov/current/title-24/subtitle-B/chapter-XX/part-3280#>:~:text=The%20strength%20and%20rigidity%20of%20the%20component%20parts%20and/or%20the%20integrated%20structure%20shall%20be%20determined%20by%20engineering%20analysis%20or%20by%20suitable%20load%20tests%20to%20simulate%20the%20actual%20loads%20and%20conditions%20of%20application%20that%20occur

See Code of Federal Regulations (CFR) Title 24 Subtitle B Chapter XX Part 3280 for definition.

[2018 IFC Section 104.9](#)

Approved is an adjective that modifies the noun after it. For example, Approved Agency means that the Agency is accepted officially as being suitable in a particular situation. This example conforms to IBC/IRC/IFC Section 201.4 where the building code authorizes sentences to have an ordinarily accepted meaning such as the context implies.

<https://up.codes/viewer/wyoming/ibc-2021/chapter/17/special-inspections-and-tests#1707.1>

Multilateral approval is true for all ANAB accredited product evaluation agencies and all International Trade Agreements.

<http://www.driengineering.org/AppendixC> AND <https://www.dricertification.org/cornell-2016-protection-trade-secrets>

<https://www.law.cornell.edu/uscode/text/18/1832#>:~:text=imprisoned%20not%20more%20than%2010%20years

<https://www.law.cornell.edu/uscode/text/18/1832#>:~:text=Any%20organization%20that%20has%20therebv%20avoided



<https://up.codes/viewer/wyoming/ibc-2021/chapter/17/special-inspections-and-tests#1706.2>

IBC 2021, Section 1706.1 Conformance to Standards

IBC 2021, Section 1707 Alternative Test Procedure, 1707.1 General

See Section 10 for the distilled building code definition of **Approved**

Los Angeles Municipal Code, SEC. 98.0503. TESTING AGENCIES

<https://up.codes/viewer/california/ca-building-code-2022/chapter/17/special-inspections-and-tests#1707.1>

New York City, The Rules of the City of New York, § 101-07 Approved Agencies

New York City, The Rules of the City of New York, § 101-07 Approved Agencies

<https://up.codes/viewer/new-jersey/ibc-2018/chapter/17/special-inspections-and-tests#1707.1>

<https://www.nj.gov/dca/divisions/codes/codreg/ucc.html>

<https://www.ecfr.gov/current/title-24/subtitle-B/chapter-XX/part-3282/subpart-A/section-3282.14>

<https://www.ecfr.gov/current/title-24/subtitle-B/chapter-XX/part-3280>

IBC 2021, Section 1706 Design Strengths of Materials, 1706.2 New Materials. Adopted law pursuant to IBC model code language 1706.2.

IBC 2021, Section 1707 Alternative Test Procedure, 1707.1 General. Adopted law pursuant to IBC model code language 1707.1.

<https://www.nspe.org/resources/issues-and-advocacy/professional-policies-and-position-statements/regulation-professional> AND <https://apassociation.org/list-of-engineering-boards-in-each-state-archive/>

IBC 2021, Section 1706 Design Strengths of Materials, Section 1706.1 Conformance to Standards Adopted law pursuant to IBC model code language 1706.1.

[https://iaf.nu/en/about-iaf-](https://iaf.nu/en/about-iaf-mla/#:~:text=it%20is%20required%20to%20recognise%20certificates%20and%20validation%20and%20verification%20statements%20issued%20by%20conformity%20assessment%20bodies%20accredited%20by%20all%20other%20signatories%20of%20the%20IAF%20MLA%2C%20with%20the%20appropriate%20scope)

[mla/#:~:text=it%20is%20required%20to%20recognise%20certificates%20and%20validation%20and%20verification%20statements%20issued%20by%20conformity%20assessment%20bodies%20accredited%20by%20all%20other%20signatories%20of%20the%20IAF%20MLA%2C%20with%20the%20appropriate%20scope](https://iaf.nu/en/about-iaf-mla/#:~:text=it%20is%20required%20to%20recognise%20certificates%20and%20validation%20and%20verification%20statements%20issued%20by%20conformity%20assessment%20bodies%20accredited%20by%20all%20other%20signatories%20of%20the%20IAF%20MLA%2C%20with%20the%20appropriate%20scope)

True for all ANAB accredited product evaluation agencies and all International Trade Agreements.

<https://www.justice.gov/crt/deprivation-rights-under-color-law> AND <https://www.justice.gov/atr/mission>