



Technical Evaluation Report™ - Canada

A Duly Authenticated Report from an Approved Agency

Report No: 2501-108



Issue Date: June 18, 2025

Revision Date: May 13, 2026

Subject to Renewal: July 1, 2027

Trex® Metal Railing Systems - Canada

Trade Secret Report Holder:

Trex® Company, Inc.

2500 Trex Way
Winchester, VA 22601-6520
Phone: 800-289-8739
Website: www.trex.com

CSI Designations:

DIVISION: 05 00 00 - METALS

Section: 05 52 00 - Metal Railings

Section: 05 52 23 - Aluminum Railings

Section: 05 72 00 - Decorative Metal Handrails and Railings

Section: 05 73 16 - Wire Rope Decorative Metal Railings

1 Innovative Products Evaluated¹

1.1 Trex Metal Railing Systems:

- 1.1.1 Trex Signature® X-Series™ Cable Rail
- 1.1.2 Trex Enhance® Steel Rail
- 1.1.3 Trex Signature® Rod Rail
- 1.1.4 Trex Signature® Mesh Railing
- 1.1.5 Trex Signature® Glass Railing

2 Product Description and Materials

2.1 The innovative products evaluated in this report are shown in **Figure 1** through **Figure 5**, and are described in **Table 1**.

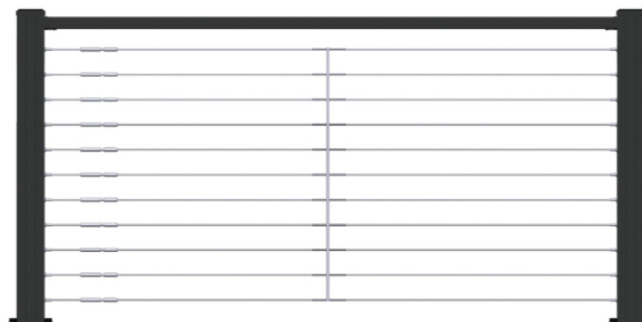


Figure 1. Trex Signature X-Series Cable Rail

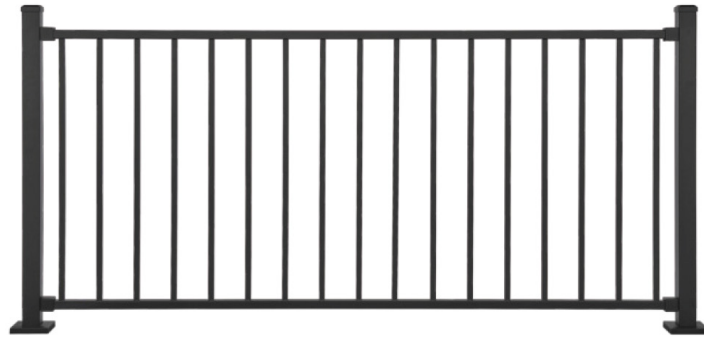


Figure 2. Trex Enhance Steel Rail

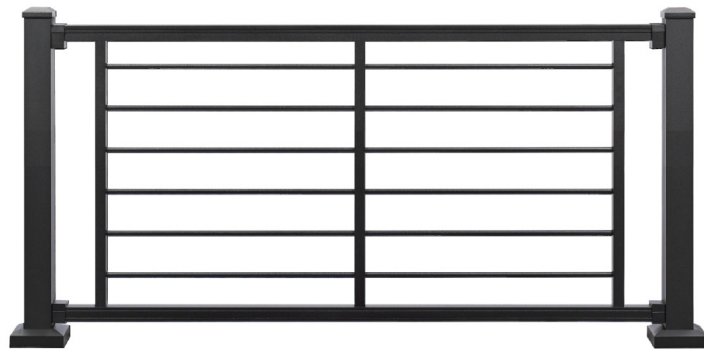


Figure 3. Trex Signature Rod Rail

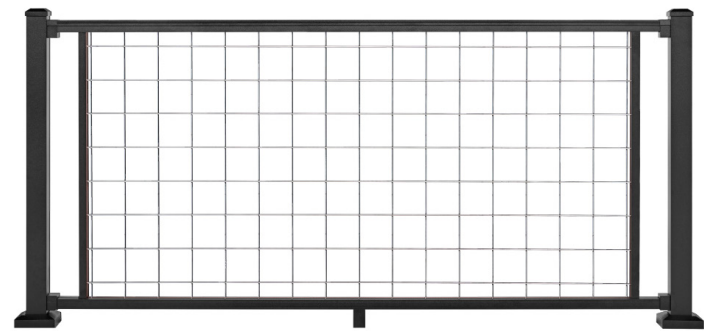


Figure 4. Trex Signature Mesh Railing

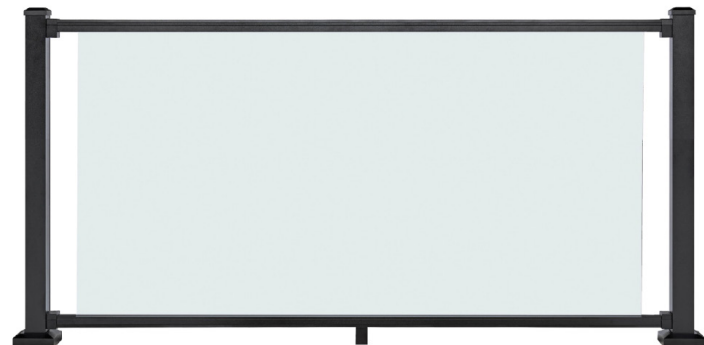


Figure 5. Trex Signature Glass Railing



Table 1. Approved Trex Metal Railing Systems

Railing System	Description	Maximum Allowable Dimensions	Railing Assembly Infill	Railing Assembly Total Dimensions		Applications
				Heights	Lengths	
Trex Signature X-Series Cable Rail ²	Aluminum Railing Assembly with Stainless Steel Cable Infill	1.1 m (42") height 1.8 m (72") span ¹ between posts	1 x 19 Stainless Steel Cables, 3.2 mm (1/8") diameter	0.9 m and 1.1 m (36" and 42")	1.8 m, 3.7 m, and 5.5 m (72", 144", and 216")	Horizontal
Trex Enhance Steel Rail	Steel Railing Assembly	1.1 m (42") height 2.4 m (96") span between posts	Square Steel Balusters 16 mm x 16 mm (0.630" x 0.630")	0.9 m and 1.1 m (36" and 42")	1.8 m and 2.4 m (72" and 96")	
Trex Signature Rod Rail ²	Aluminum Railing Assembly	1.1 m (42") height 2.4 m (96") span between posts	12.7 mm (1/2") Round Horizontal Aluminum Rods	0.9 m and 1.1 m (36" and 42")	1.8 m and 2.4 m (72" and 96")	
Trex Signature Mesh Railing	Aluminum Railing Assembly		Stainless Steel Mesh		1.8 m and 2.4 m (72" and 96")	
Trex Signature Glass Railing	Aluminum Railing Assembly with Glass Infill	1.1 m (42") height 1.8 m (72") span between posts	6.4 mm (1/4") Thick Tempered Glass		1.8 m (72")	

Imperial: 1 mm = 0.0394 in, 1 m = 3.28 ft

- For kits larger than 1.8 m (72"), additional structural Pass-Through Posts are provided.
- Per the NBCC, these systems are approved for use only where the walking surface is not more than 4.2 m (165") above the adjacent level. These systems are not permitted in Ontario regardless of height.



2.1.1 Approved railing posts for use with Trex Metal Railing Systems are listed in **Table 2**.

Table 2. Approved Posts for use with Trex Metal Railing Systems

Approved Posts	Approved Railing System	Maximum Railing Height	Post Cross-Section Dimensions mm (in)	Base Plate Dimensions mm (in)	Maximum Allowable Post Spacing
Trex X-Series Post	Trex Signature X-Series Cable Rail	1.1 m (42")	89 x 89 (3.5" x 3.5") with Internal X Structure	140 x 140 x 12.7 (5.5" x 5.5" x 0.5")	1.8 m (72") Between Posts
Trex X-Series Pass-Through Post ¹			25 mm x 51 mm (1" x 2") Rectangular Post	89 x 140 x 12.7 (3.5" x 5.5" x 0.5")	
Trex Enhance 2" Steel Post	Trex Enhance Steel Rail	1.1 m (42")	51 x 51 x 2.6 (2" x 2" x 0.101")	102 x 102 x 7.8 (4" x 4" x 0.306")	2.4 m (96") Between Posts
Trex Enhance 3" Steel Post			76 x 76 x 2.1 (3" x 3" x 0.083")	140 x 140 x 7.9 (5.5" x 5.5" x 0.31")	
Trex Signature Post or Crossover Post	Trex Signature Railing, Trex Signature Mesh Railing, Signature Rod Rail	1.1 m (42")	64 x 64 x 3.3 (2.5" x 2.5" x 0.13")	102 x 102 x 12.7 (4.0" x 4.0" x 0.50")	2.4 m (96") Between Posts
Trex Signature Post or Crossover Post	Signature Glass Railing		64 x 64 x 3.3 (2.5" x 2.5" x 0.13")	102 x 102 x 12.7 (4.0" x 4.0" x 0.50")	1.8 m (72") Between Posts

Imperial: 1 mm = 0.0394 in, 1 m = 3.28 ft

1. Pass-Through Posts are only for use with the Trex Signature X-Series Cable Rail system and are installed between X-Series posts.

2.2 Trex Signature X-Series Cable Rail

2.2.1 Trex Signature X-Series Cable Rail is a guardrail system consisting of extruded aluminum components and zinc alloy (Zamak 3) brackets. The cables are spring-loaded stainless steel 1 x 19 cables.

2.2.1.1 X-Series Posts, Pass-Through Posts, Top Rails, and Brackets are available in charcoal black color.

2.2.1.1.1 X-Series Posts are comprised of a Specialized Internal X structure, Corner Covers, Flat Side Covers, and a Base Plate. X-Series Posts are mechanically connected to the X-Series Base Plate via machine screws.

2.2.1.2 Pass-Through Posts are comprised of a Pass-Through Post Bar and a Pass-Through Base Plate.

2.2.1.2.1 The Pass-Through Post Bar is mechanically connected to the Pass-Through Base Plate via machine screws.

2.2.1.2.2 The Top Rail is mechanically connected to the X-Series Post and Pass-Through Posts, where applicable, via X-Series Straight Brackets and X-Series Pass-Through Brackets.

2.2.1.3 The 1 x 19 stainless steel cables have a nominal diameter of 3 mm (1/8").

2.2.1.3.1 Spacing of the cables is 80 mm (3.15") on center.

2.2.2 Trex Signature X-Series Cable Rail is available in two heights, 0.9 m (36") and 1.1 m (42"), and three length configurations:

2.2.2.1 1.8 m (6') Horizontal Cable Rail configuration (**Figure 6**)

2.2.2.2 3.7 m (12') Horizontal Cable Rail configuration (**Figure 7**)

2.2.2.3 5.5 m (18') Horizontal Cable Rail configuration (**Figure 8**)

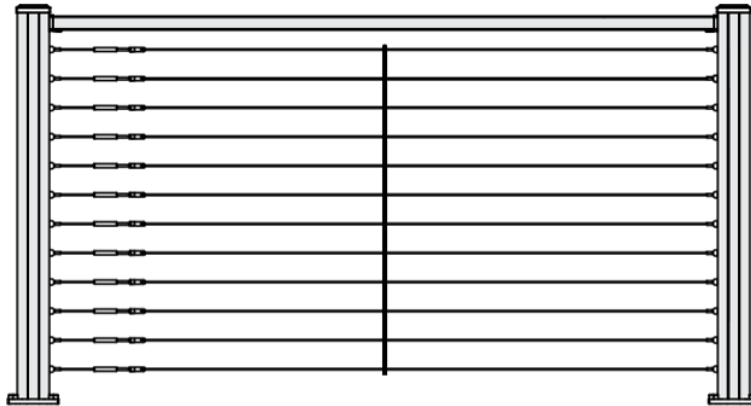


Figure 6. 1.8 m (6') Trex Signature X-Series Cable Rail

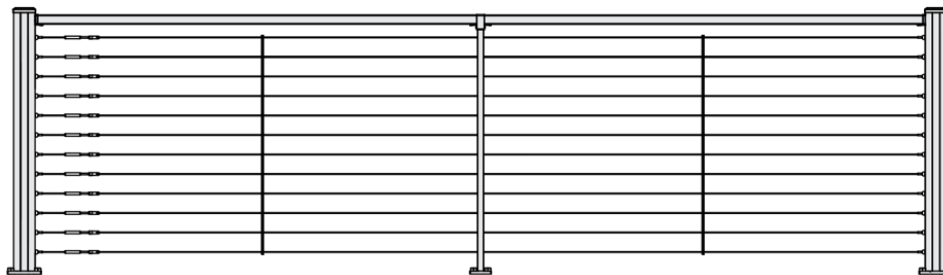


Figure 7. 3.7 m (12') Trex Signature X-Series Cable Rail

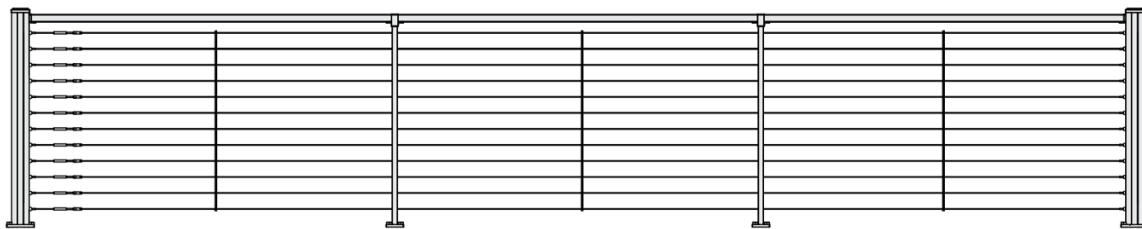


Figure 8. 5.5 m (18') Trex Signature X-Series Cable Rail

2.3 Trex Enhance Steel Rail

2.3.1 Trex Enhance Steel Rail is a guardrail system consisting of extruded coated steel posts, rails, square balusters, and coated steel brackets.

- 2.3.1.1 Trex Enhance Steel Posts and the pre-assembled rail/baluster panels, in addition to the brackets are available in charcoal black powder coat.
- 2.3.1.2 Trex Enhance Steel Post is welded to the Steel Base Plate.
- 2.3.1.3 Trex Enhance Steel Posts are available in two options. The first option is the Post with pre-installed brackets. The second option is the Post without pre-installed brackets.
- 2.3.1.4 The Enhance Steel Balusters are welded onto the Steel Top and Bottom Rails
- 2.3.1.5 Vertical Square Steel Balusters of the pre-assembled panel are positioned with a maximum of 92.5 mm (3.64") clearance between them.

2.3.2 Trex Enhance Steel Rail is available in two heights, 0.9 m (36") and 1.1 m (42"), and two length configurations:

- 2.3.2.1 1.83 m (6') configuration (**Figure 9**)
- 2.3.2.2 2.44 m (8') configuration (**Figure 10**)

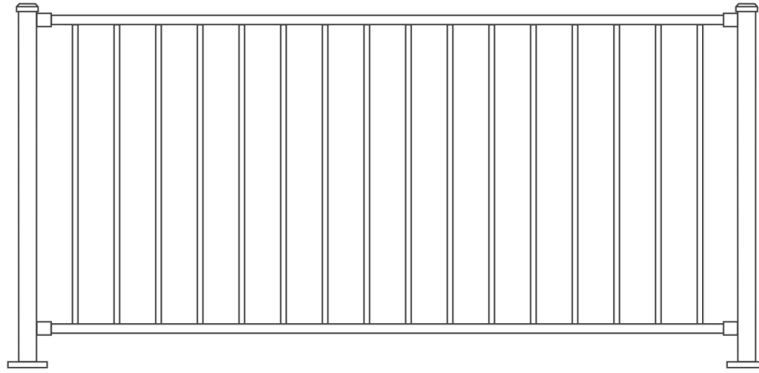


Figure 9. 1.8 m (6') Trex Enhance Steel Rail

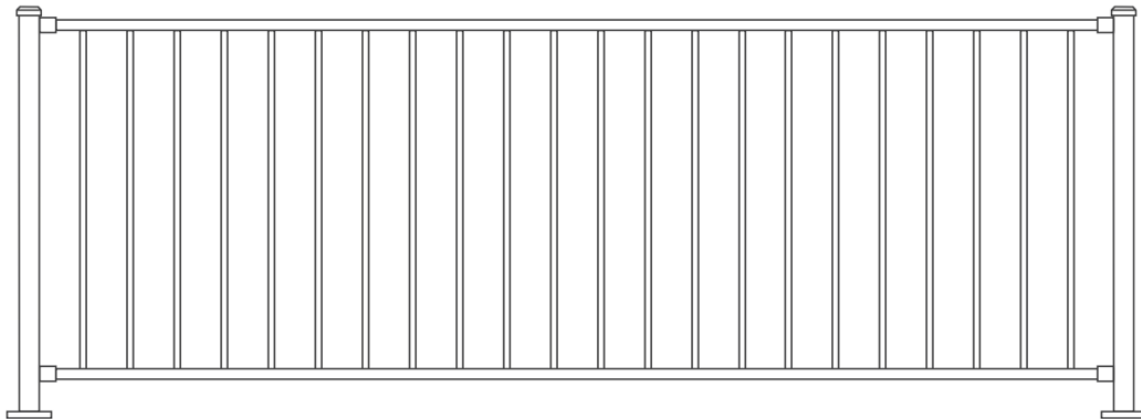


Figure 10. 2.4 m (8') Trex Enhance Steel Rail

2.4 Trex Signature Rod Rail

2.4.1 Trex Signature Rod Rail is a guardrail system consisting of extruded aluminum components secured with stainless steel fasteners and zinc alloy (Zamak 3) brackets.

- 2.4.1.1 Trex Signature Rod Rail has an in-fill system comprising of spaced horizontal rods that pass through openings in vertical members at the middle and each end of the rail section.

2.4.2 Trex Signature Rod Rail is available in two heights, 0.9 m (36") and 1.1 m (42"), and two length configurations:

- 2.4.2.1 1.83 m (6') configuration
- 2.4.2.2 2.44 m (8') configuration

2.5 Trex Signature Mesh Rail

2.5.1 Trex Signature Mesh Rail is a guardrail system consisting of extruded aluminum components secured with stainless steel fasteners and zinc alloy (Zamak 3) brackets.

- 2.5.1.1 Trex Signature Mesh Rail has a stainless steel mesh infill with two vertical rails.



2.5.2 Trex Signature Mesh Rail is available in two heights, 0.9 m (36") and 1.1 m (42"), and two length configurations:

2.5.2.1 1.83 m (6') configuration

2.5.2.2 2.44 m (8') configuration

2.6 Trex Signature Glass Rail

2.6.1 Trex Signature Glass Rail is a guardrail system consisting of extruded aluminum components secured with stainless steel fasteners and zinc alloy (Zamak 3) brackets.

2.6.1.1 Trex Signature Glass Rail has a 1/4" thick tempered glass panel infill.

2.6.2 Trex Signature Glass Rail is available in two heights, 0.9 m (36") and 1.1 m (42"), and one length configuration:

2.6.2.1 1.83 m (6') configuration

Table 3. Component Details of Trex Signature X-Series Cable Rail

Component	Description
Trex Signature X-Series Cable Rail	
Top Rail	38 mm high x 51 mm wide x 3.2 mm (1 1/2" high x 2" wide x 1/8") wall 6063-T6 extruded aluminum.
Infill	<i>Cable Brace:</i> 6.4 mm x 6.4 mm (1/4" x 1/4") square 316 stainless steel brace, 3.6 mm (0.141") diameter holes spaced 3.2 mm (1/8") on-center from the edges, 9.5 mm (3/8") on center from the ends and 80 mm (3.15") on center from each other. Assembly Height 0.9 m (36"), Cable Brace Height 0.75 m (29"), Number of Holes 10 Assembly Height 1.1 m (42"), Cable Brace Height 0.9 m (36"), Number of Holes 12
	<i>Pass-Through Post Base Plate:</i> 89 mm x 140 mm x 12.7 mm thick (3 1/2" x 5 1/2" x 1/2") 6063-T6 aluminum base plate with two 12.7 mm (1/2") diameter holes located approximately 55 mm (2.15") on-center from the long edge and 44.5 mm (1 3/4") on center from the short edge and approximately 30.5 mm (1.2") apart on-center, four 13.5 mm (17/32") diameter holes located approximately 14.6 mm (0.575") on-center from each edge.
	<i>Pass-Through Post:</i> 25.4 mm x 51 mm (1" x 2") rectangular post with 3.8 mm (0.150") diameter holes spaced 65 mm (2.555") on-center from the bottom plate, and 80 mm (3.15") on-center from each other. There is also a 5.6 mm (0.221") diameter hole located 66.7 mm (2 5/8") on-center from the topmost 3.8 mm (0.150") diameter hole and 7.1 mm (0.28") on-center from the top of the post. Assembly Height 0.9 m (36"), Post Height (34.1"), Number of Holes 10 Assembly Height 1.1 m (42"), Post Height (40.1"), Number of Holes 12
	1 x 19 Stainless Steel Cables, 3.2 mm (1/8") diameter, held in place by 6005A aluminum Cable Infill Adapters. Assembly Height 0.9 m (36"), Number of Cables 10 Assembly Height 1.1 m (42"), Number of Cables 12
Rail Attachment	<i>Top Rail Straight Bracket:</i> Cast zinc bracket (top rail). <i>Pass-Through Post Bracket:</i> Cast zinc bracket (top rail).
Trex Signature X-Series Post	
X-Series Post	89 mm (3 1/2") overall square profile with a specialized internal X structure made of 6061A extruded aluminum.
Base Plate	140 mm x 140 mm x 12.7 mm (5 1/2" x 5 1/2" x 1/2") thick 6063-T6 aluminum base plate with four 10.1 mm (0.397") diameter holes located approximately 42 mm (1.654") on-center from each edge and approximately 56 mm (2.192") apart on-center, four 13.5 mm (0.531") diameter holes located approximately 14.6 mm (0.575") on-center from each edge and approximately 111 mm (4.35") apart on-center.
Imperial: 1 mm = 0.0394 in, 1 m = 3.28 ft	



Table 4. Component Details of Trex Enhance Steel Rail

Component	Overall Dimensions		Individual Component	Individual Component Dimensions	Description	Material
	Length x Width	Height				
Horizontal Panel	838 mm x 25.4 mm (33" x 1") or 991 mm x 25.4 mm (39" x 1")	1,816 mm (71½") or 2,426 mm (95½")	Top and Bottom Rail	25 mm x 25 mm (0.984" x 0.984")	Pre-assembled Top and Bottom Rails with Balusters	Powder Coated Q195 Steel
			Square Baluster	16 mm x 16 mm (0.630" x 0.630")	Balusters are welded to Top and Bottom Rails; Balusters are positioned with 92.5 mm (3.64") maximum clearance between them	
Trex Enhance Steel 51 mm (2") Post with Baseplate	102 mm x 102 mm (4" x 4")	946 mm (37¼") or 1,099 mm (43¼")	51 mm (2") Post (Corner)	51 mm x 51 mm x 2.6 mm (2" x 2" x 0.101")	Post is welded to base plate	Powder Coated Q195 Steel
			51 mm (2") Post (Line)			
			51 mm (2") Post (End)			
			51 mm (2") Post (No Brackets)			
			102 mm (4") Base Plate	102 mm x 102 mm x 7.8 mm (4" x 4" x 0.306")	Steel base plate has four 13.3 mm (0.525") diameter holes with centers located approximately 13.7 mm (0.54") from each edge and approximately 74.6 mm (2.94") apart on-center	
			51 mm (2") Post Cap	51 mm x 51 mm x 13 mm (2" x 2" x 0.5")	Cap is installed on top of Post	
51 mm (2") Post Skirt	102 mm x 102 mm x 13 mm (4" x 4" x 0.5")	Skirt is installed around base plate	Zamak 3			
Trex Enhance 76 mm (3") Steel Post with Base Plate	140 mm x 140 mm (5.5" x 5.5")	946 mm (37¼") or 1,099 mm (43¼")	76 mm (3") Post (Corner)	76 mm x 76 mm x 2.1 mm (3" x 3" x 0.083")	Post is welded to base plate	Powder Coated Q195 Steel
			76 mm (3") Post (Line)			
			76 mm (3") Post (End)			
			76 mm (3") Post (No Brackets)			



Table 4. Component Details of Trex Enhance Steel Rail

Component	Overall Dimensions		Individual Component	Individual Component Dimensions	Description	Material
	Length x Width	Height				
Trex Enhance 76 mm (3") Steel Post with Base Plate <i>Continued</i>	140 mm x 140 mm (5.5" x 5.5")	946 mm (37 ¹ / ₄ ") or 1,099 mm (43 ¹ / ₄ ")	140 mm (5.5") Base Plate	140 mm x 140 mm x 7.9 mm (5.5" x 5.5" x 0.31")	Steel base plate has four 15 mm (0.59") diameter holes with centers located approxi- mately 15 mm (0.6") from each edge and approximately 109 mm (4.3") apart on-center	Powder Coated Q195 Steel
			76 mm (3") Post Cap	76 mm x 76 mm x 13 mm (3" x 3" x 0.5")	Cap is installed on top of Post	Zamak 3
			76 mm (3") Post Skirt	140 mm x 140 mm x 13 mm (5.5" x 5.5" x 0.5")	Skirt is installed around base plate	Zamak 3

Imperial: 1 mm = 0.0394 in

Table 5. Hardware Component Details of Trex Enhance Steel Rail

Individual Components	Component Dimensions	Description	Material
Steel Brackets	36 mm x 33 mm x 35 mm (1.40" x 1.29" x 1.38") 3.3 mm (0.131") thickness	Bracket has two 0.235" rear screw holes and are approximately 0.475" apart on-center; two 0.235" side screw holes and are approximately 0.643" from bottom of bracket	Powder Coated Q235B Steel
Steel Bracket Covers	37 mm x 39 mm x 36 mm (1.456" x 1.525" x 1.425")	Cover for Top and Bottom Brackets	
#12 Self-Tapping Screw	#12 x 3/4" Drill-Point Screw (Flat Head)	Two Screws for Bracket to Post One Screw for Bracket to Rail	C1018 Steel

Imperial: 1 mm = 0.0394 in



Table 6. Component Details of Trex Signature Rod Rail Systems

Component	Description
Top Rail	38 mm x 44 mm (1 1/2" high by 1 3/4" wide) (overall dimensions) two-piece component consisting of 9.5 mm x 44 mm (3/8" high by 1 3/4" wide) by 2.8 mm (0.11") wall 6063-T6 extruded aluminum Top Rail Cover, and 33 mm by 40 mm (1 5/16" high by 1 9/16" wide) by 2.8 mm (0.11") wall, 6105-T5 extruded aluminum Top Rail. The two pieces include the Top Rail Cover and the Top Rail.
Bottom Rail	32 mm x 44 mm (1 1/4" high by 1 3/4" wide) (overall dimensions) two-piece component consisting of 30 mm x 44 mm (1 3/16" high by 1 3/4" wide) by 2.5 mm (0.10") wall 6063-T6 extruded aluminum top section and 7.9 mm x 44 mm (5/16" high by 1 3/4" wide) by 1.5 mm (0.06") wall, 6063-T6 extruded aluminum Bottom Rail. The two pieces include the Bottom Rail Cover and the Bottom Rail.
Supports	<i>Intermediate:</i> and <i>Vertical:</i> 25.4 mm x 32 mm (1" x 1.25") rectangular 6063-T6 extruded aluminum vertical supports with machined holes to define the spacing for the horizontal round baluster rods.
Top Rail Stiffener	32 mm x 3.3 mm (1 1/4" wide by 0.13" thick) 6061-T6 aluminum plate (required for spans greater than 1.83 m [72"])
Foot Block	35 mm (1 3/8") square by 51 mm (2") long by 3.3 mm (0.13") wall 6063-T52 extruded aluminum (one located at midspan). (Foot block required for all spans greater than 1.83 m [72"])
Rail Attachment	Standard – Cast aluminum saddle brackets (top and bottom rail).
	Crossover – 64 mm (2 1/2") square by 14.3 mm (9/16") thick cast aluminum post mount cap plate with two 27 mm (1 1/16") high flanges (top rail only).
Rod	12.7 mm (1/2") O.D. solid wall 6105-T5 extruded aluminum horizontal rods
Imperial: 1 mm = 0.0394 in	

Table 7. Component Details of Trex Signature Mesh and Glass Railing Systems

Component	Description	
Top Rail	37 mm x 44 mm (1 7/16" high by 1 3/4" wide) by 2.3 mm (0.09") wall 6063-T6 extruded aluminum	
Bottom Rail	32 mm x 44 mm (1 1/4" high by 1 3/4" wide) by 2.3 mm (0.09") wall 6063-T6 extruded aluminum	
Top/Bottom Rail and Support Baluster Insert	Trex Signature Mesh Railing 15.7 mm x 14 mm (0.62" high by 0.55" wide) by 0.8 mm (0.03") wall PVC "U"-Channel with internal longitudinal ribs running entire length	
	Trex Signature Glass Railing	13 mm x 14.5 mm (0.51" high by 0.57") wide by 2.3 mm (0.09") wall EPDM "U"-Channel with external longitudinal ribs running entire length (top rail)
		17.8 mm x 14.5 mm (0.70" high by 0.57") wide by 2.3 mm (0.09") wall EPDM "U"-Channel with external longitudinal ribs running entire length (bottom rail)
Bottom Rail Support Block	35 mm x 51 mm (1 3/8" square by 2" long) by 3.3 mm (0.13") wall 6063-T52 extruded aluminum located midspan	
Infill	Trex Signature Mesh Railing	Vertical Support – 25.4 mm x 32 mm (1" wide by 1 1/4" deep) by 2.0 mm (0.08/0.09") wall 6063-T6 extruded aluminum (two per guardrail, one located on either side of the mesh infill)
		Mesh Infill – 2.44 m x 0.98 m (96" wide by 38 1/2" high) by 4.8 mm (0.19") diameter 316 stainless steel mesh infill, 102 mm (4") square center-to-center spacing throughout center and 102 mm (4") wide by 76 mm (3") tall center-to-center spacing on top and bottom
	Trex Signature Glass Railing	Glass Infill – 1.63 m x 0.97 m (64" long by 38 5/16" high) by 6.4 mm (1/4") thick tempered monolithic glass
Rail Attachment	Standard – Cast zinc saddle brackets (top and bottom rail)	
	Crossover – 64 mm (2 1/2") square by 14.3 mm (9/16") thick cast zinc post mount cap plate with two 27 mm (1 1/16") high flanges (top rail only)	
	Support Baluster to Top/Bottom Rail – Plastic angle connector	
Imperial: 1 mm = 0.0394 in		



Table 8. Details of Posts used with Trex Signature Railing Systems

Component	Description
Trex Signature Post or Crossover Post	
Post	64 mm x 64 mm x 3.3 mm (2.5" x 2.5" x 0.13") 6063-T6 extruded aluminum
Base Plate	102 mm x 102 mm x 12.7 mm (4" x 4" x 0.5") 6063-T6 aluminum base plate with four 9.7 mm (3/8") diameter holes located approximately 9.7 mm (3/8") on-center from each edge, and one 9.7 mm (3/8") diameter hole located in the center
Imperial: 1 mm = 0.0394 in	

2.7 As needed, review material properties for design in **Section 4** and the regulatory evaluation in **Section 5**.

3 Applicable Codes and Standards²

3.1 Codes

- 3.1.1 NBCC — 15, 20, 25: National Building Code of Canada
- 3.1.2 BCBC — 18, 24: British Columbia Building Code
- 3.1.3 NBC-Alberta — 19, 23: National Building Code - Alberta
- 3.1.4 O Reg. 163/24: Ontario Building Code (OBC)³

3.2 Standards and Referenced Documents

- 3.2.1 ASTM E935: Standard Test Methods for Performance of Permanent Metal Railing Systems and Rails for Buildings
- 3.2.2 CSA S157: Strength Design in Aluminum
- 3.2.3 CAN/CGSB-12.1: Tempered or Laminated Safety Glass
- 3.2.4 MMAH Supplementary Standard SB-13: Glass in Guards

4 Tabulated Properties Generated from Nationally Recognized Standards

4.1 General

- 4.1.1 Trex Metal Railing Systems are used as guardrail systems where a minimum guardrail height of 1,070 mm (42") is required in accordance with NBCC Sentence 3.3.1.18(1), NBCC Article 9.8.8.1, and NBCC Sentence 9.8.8.3(1).

4.2 Structural Performance

- 4.2.1 Trex Metal Railing Systems were tested and met the structural requirements of NBCC Clause 4.1.5.14(1)(c), NBCC Sentence 4.1.5.14(6), NBCC Article 9.8.8.2, and NBCC Table 9.8.8.2 for guards within dwelling units and exterior guards serving not more than two dwelling units. See also corresponding Sections 9.8.8.2 in 2024 BCBC and 2023 NBC-Alberta.
 - 4.2.1.1 See **Table 9** for assessment of Trex Signature X-Series Cable Rail, Trex Signature Rod Rail, Trex Signature Mesh Rail, and Trex Signature Glass Rail
 - 4.2.1.2 See **Table 10** for assessment of Trex Enhance Steel Rail



Table 9. Allowable Design Live Loads for Trex Signature X-Series Cable Rail

Load Type	Location	Regulatory Source	Design Service-Level Live Load Assessment
Infill Load	Geometric Center	NBCC Table 9.8.8.2	0.5 kN (113 lb), (Load Over Square Loading Plate of 300 mm x 300 mm)
	Lower Center		
	Center Adjacent to Post		
	Bottom Adjacent to Post		
	Center Adjacent to Cable Coupling		
	Bottom Adjacent to Cable Coupling		
	Center of Support Baluster		
	Bottom of Support Baluster		
Uniform Load	Horizontal – Top Rail	NBCC Clause 4.1.5.14(1)(c) NBCC Table 9.8.8.2	0.75 kN/m (52 lb/ft)
	Vertical – Top Rail	NBCC Sentence 4.1.5.14(6) NBCC Table 9.8.8.2	1.5 kN/m (103 lb/ft)
Concentrated Load (Horizontal)	Midspan – Top Rail	NBCC Clause 4.1.5.14(1)(c) NBCC Table 9.8.8.2	1.0 kN (225 lb)
	Adjacent to Post – Top Rail		
	Top of Intermediate Post		
	Top of End Post		
Concentrated Load (Vertical)	Midspan – Top Rail	NBCC Clause 4.1.5.14(1)(c) NBCC Table 9.8.8.2	1.0 kN (225 lb)
	Adjacent to Post – Top Rail		
	Top of Intermediate Post		

Imperial: 1 N = 0.225 lb, 1 kN/m = 737.6 lb/ft



Table 10. Allowable Design Live Loads for Trex Enhance Steel Rail, Signature Rod Rail, Signature Mesh Railing, and Signature Glass Railing

Load Type	Location	Regulatory Source	Design Service-Level Live Load Assessment
Infill Load	Geometric Center	NBCC Table 9.8.8.2	0.5 kN (113 lb), Applied Over 300 mm x 300 mm ¹
	Lower Center		
Uniform Load	Horizontal – Top Rail	NBCC Clause 4.1.5.14(1)(c) NBCC Table 9.8.8.2	0.75 kN/m (52 lb/ft)
	Vertical – Top Rail	NBCC Sentence 4.1.5.14(6) NBCC Table 9.8.8.2	1.5 kN/m (103 lb/ft)
Adjacent Vertical Element Separation Force ²	Baluster Infill	NBCC Sentence 9.8.8.2(2)	0.1 kN (22 lb) Applied in Opposite Directions (Without Exceeding 100 mm)
Post Concentrated Load	2" Post – Top of Post	NBCC Table 9.8.8.2	1.0 kN (225 lb)
	3" Post – Top of Post		2.0 kN (450 lb)
Concentrated Load (Horizontal)	Midspan – Top Rail	NBCC Clause 4.1.5.14(1)(c) NBCC Table 9.8.8.2	1.0 kN (225lb)
	Adjacent to Post – Top Rail		
	Top of Single Post		
Concentrated Load (Vertical)	Midspan – Top Rail	NBCC Clause 4.1.5.14(1)(c) NBCC Table 9.8.8.2	1.0 kN (225lb)
	Adjacent to Post – Top Rail		

Imperial: 1 N = 0.225 lb, 1 kN/m = 737.6 lb/ft

- Signature Rod Rail/Glass Railing also pass load applied over 100 mm x 100 mm.
- Only applies to vertical baluster infills (Enhance Steel Railing).

4.3 Alternative techniques shall be permitted in accordance with accepted engineering practice and experience. These provisions for the use of alternative materials, designs, and methods of construction are not intended to prevent the installation of any material or to prohibit any design or method of construction not specifically prescribed herein. This includes, but is not limited to, the following areas of engineering: mechanics of materials, structures, building science, and fire science.



5 Regulatory Evaluation and Accepted Engineering Practice

- 5.1 Trex Metal Railing Systems comply with the following adopted codes and/or accepted engineering practice for the following reasons:
- 5.1.1 Conformance to the appropriate requirements in NBCC Section 9.8 for use in dwelling units as specified in NBCC Article 3.3.4.7.
 - 5.1.2 Structural performance in accordance with NBCC Clause 4.1.5.14(1)(c), NBCC Sentence 4.1.5.14(6), NBCC Article 9.8.8.2 and NBCC Table 9.8.8.2 for guards within dwelling units and exterior guards serving not more than two dwelling units.
 - 5.1.2.1 Trex Signature X-Series Cable Rail and Trex Signature Rod Rail infill runs horizontally. The conditions stated in NBCC Sentence 4.1.5.14(4) or NBCC Sentence 9.8.8.2(2) are for infills with vertical elements and does not apply to Trex Signature X-Series Cable Rail nor Trex Signature Rod Rail.
 - 5.1.2.2 Trex Enhance Steel Rail infill was evaluated in accordance with NBCC Sentence 4.1.5.14(4) or NBCC Sentence 9.8.8.2(2). See also corresponding Article 9.8.8.2 in both 2024 BCBC and 2023 NBC-Alberta.
 - 5.1.3 Compliance with the minimum height requirement of 1,070 mm (42") with NBCC Sentence 3.3.1.18(1) and NBCC Sentence 9.8.8.3(1).
 - 5.1.3.1 Height compliance with NBCC Sentence 9.8.8.3(1) also complies with the minimum height specified in NBCC Sentence 9.8.8.3(2) and NBCC Sentence 9.8.8.3(3).
 - 5.1.4 Compliance with opening size in accordance with NBCC Sentence 3.3.1.18(2) and NBCC Article 9.8.8.5.
 - 5.1.4.1 Trex Signature X-Series Cable Rail, Trex Enhance Steel Rail, Trex Signature Rod Rail, and Trex Signature Mesh Railing systems are designed with infill elements spaced so that any opening will prevent the passage of a spherical object having a diameter of 100 mm, in compliance with NBCC Article 9.8.8.5.
 - 5.1.4.2 The glass infill of Trex Signature Glass Rail, being a solid panel, inherently complies with this requirement.
 - 5.2 Trex Signature X-Series Cable Rail, Trex Signature Rod Rail, and Trex Signature Mesh Railing comply with the provision prescribed in NBCC Sentence 3.3.1.18(4) and NBCC Article 9.8.8.6., provided the guardrail for the protected level is not above 4.2 m (165") from the adjacent level. See also the corresponding Article 9.8.8.2 in both 2024 BCBC and 2023 NBC-Alberta.
 - 5.2.1 **Note:** Trex Signature X-Series Cable Rail, and Trex Signature Rod Rail, and Trex Signature Mesh Railing are not permitted to be used in Ontario per Article 9.8.8.6 of the Ontario Building Code.
 - 5.3 Trex Signature Glass Rail complies with the NBCC requirements for guards. In addition to meeting the structural load requirements, the system uses 6.3 mm (1/4") tempered glass that conforms to CAN/CGSB-12.1 as specified in NBCC Clause 9.8.8.7(1)(a).
 - 5.3.1 The use of safety glazing is a mandatory requirement for glass used in guards. Annex A of CAN/CGSB-12.1 identifies guards as areas of human impact.
 - 5.3.2 For applications in Ontario, the glass infill conforms to the requirements of MMAH Supplementary Standard SB-13 per 2024 OBC Article 3.1.21.1, which provides prescriptive solutions for the type of glass required based on its proximity to the slab edge and addresses post-breakage retention.
 - 5.4 Any building code, regulation and/or accepted engineering evaluations (i.e., research reports, duly authenticated reports, etc.) that are conducted for this report were performed by DrJ, which is an ISO/IEC 17065 accredited certification body and a professional engineering company operated by RDP or approved sources. DrJ is qualified⁴ to practice product and regulatory compliance services within its scope of accreditation and engineering expertise,⁵ respectively.

- 5.5 Testing and related engineering evaluations are defined as intellectual property and/or trade secrets.⁶
- 5.6 Engineering evaluations are conducted with DrJ's ANAB accredited ICS code scope of expertise that is also its areas of professional engineering competence.⁷

6 Installation

- 6.1 Installation shall comply with the approved construction documents, the manufacturer installation instructions, this report, and the applicable building code.
- 6.2 In the event of a conflict between the manufacturer installation instructions and this report, contact the manufacturer for counsel on the proper installation method.
- 6.3 *Installation Procedure*
 - 6.3.1 *Trex Signature X-Series Anchor Posts/Pass-Through Posts on Wood:*
 - 6.3.1.1 Blocking (2) shall be installed below all post locations in accordance with **Figure 11** or **Figure 12**.
 - 6.3.1.2 Material shall be nominal 2 x 8 Pressure Preservative Treated (PPT) Southern Pine (SP) with a specific gravity of 0.55.
 - 6.3.1.3 Fasteners shall be #10 x 3" PPT compatible wood screws (36 screws per post location). The fastening schedule per component is presented in **Table 11**.
 - 6.3.2 *Trex Signature Posts/Crossover Posts to Wood:*
 - 6.3.2.1 Blocking (2) shall be installed below all post locations in accordance with **Figure 11** or **Figure 12**.
 - 6.3.2.1.1 Material shall be nominal 2 x 8 Pressure Preservative Treated (PPT) Southern Pine (SP) with a specific gravity of 0.55.
 - 6.3.2.1.2 Fasteners shall be #10 x 3" PPT compatible wood screws (36 screws per post location).
 - 6.3.2.1.3 If attaching posts directly to PPT wood, two stainless steel barrier strips shall be inserted under base plate of posts.
 - 6.3.2.1.3.1 Stainless steel barrier strips shall also be required for installation on concrete.
 - 6.3.2.1.4 Using the post as a template mark the locations of the four holes on the post and drill through the decking and blocking boards using a $\frac{5}{8}$ " masonry bit.
 - 6.3.2.1.5 Post shall be attached to the wood using four $\frac{3}{8}$ " x 6" hex cap bolts, washers, and nuts as depicted in **Figure 13**.
 - 6.3.2.1.5.1 **Note:** If the project uses the 64 mm (2.5") post, then the back plate shown in **Figure 13** is required.

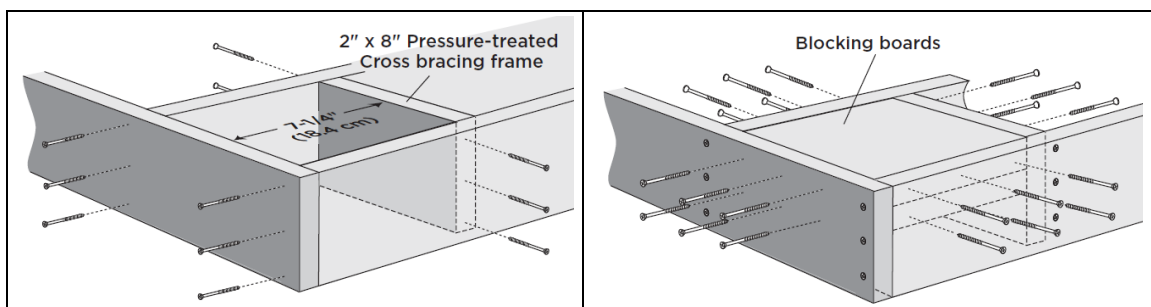


Figure 11. Corner Post Blocking – Post - Wood Installation

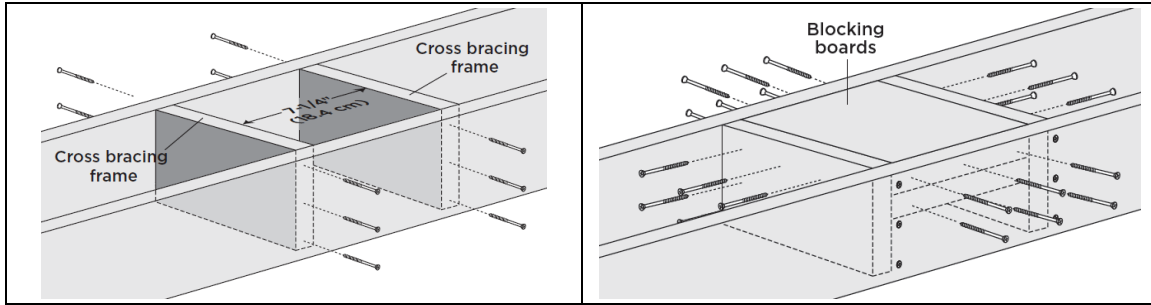


Figure 12. In-line Post Blocking – Post - Wood Installation

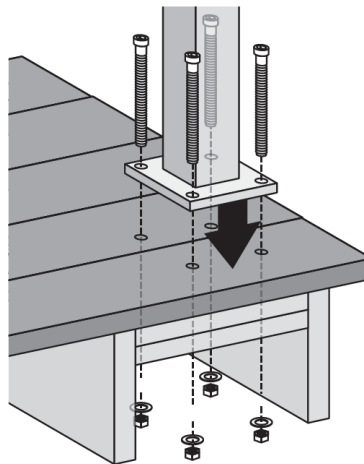


Figure 13. Post Installation into Wood

6.3.3 *Trex Signature Posts/Crossover Posts/Trex Aluminum Posts on Concrete:*

- 6.3.3.1 Using the post as a template mark the locations of the four holes on the post and drill into the concrete at least 67 mm (2⁵/₈") using a 9.5 mm (3/₈") masonry bit.
- 6.3.3.2 Post shall be attached to the concrete using four Trex supplied 9.5 mm x 95 mm (3/₈" x 3³/₄") wedge anchors as depicted in **Figure 14**. Use appropriate shims if the posts are not plumb.

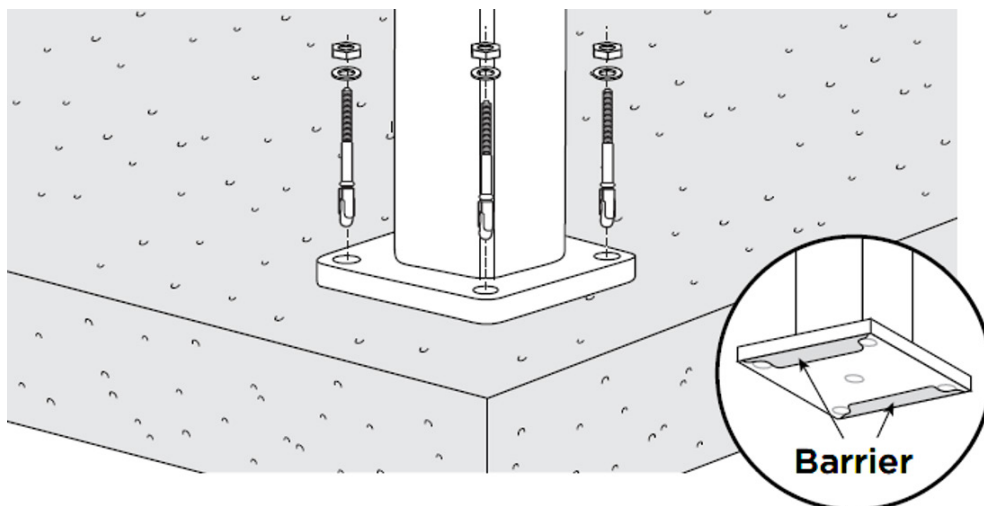


Figure 14. Post Installation into Concrete



6.3.4 The fastening schedule per component is presented in **Table 11**, **Table 12**, **Table 13**, and **Table 14**.

Table 11. Fastening Schedule for Trex Signature X-Series Cable Rail

Component	Connection	Details
X-Series Post or Pass-Through Post	Post to Substructure	Wood: Four 1/2" x 6" stainless steel hex-cap bolts, stainless steel washers with stainless steel T-nuts installed into bottom of wood blocking
Top Rail	Top Rail Straight Bracket to X-Series Post	Bracket slides into channel and locked into place between the structural cover and locking assembly
	Top Rail Straight Bracket to Rail	One #8-18 x 1/2" pan head stainless steel screw per bracket
	Locking Block Assembly to Top Rail Straight Bracket and X-Series Post	Locking Block Assembly is composed of a stainless steel weld nut, 1/4"-20 bolt and a stainless steel locking block, which interfaces between X-Series Post and bracket
	Pass-Through Post Bracket to Pass-Through Post	Two 1/4" x 1 1/4" Barrel Bolts
	Pass-Through Post Bracket to Top Rail	Two #8-18 x 1/2" pan head stainless steel screws per bracket
Cable Brace	Cable Brace to Top/Bottom Cable	Cable Brace connects to the top and bottom cables via a #10-24 x 1/4" Thread Locking Cup point Set Screw in each end
Imperial: 1 mm = 0.039 in		

Table 12. Fastening Schedule for Trex Enhance Steel Rail

Component	Connection	Details
Trex Enhance 2" Steel Post	Post to Substructure	Qty 4: 1/2"-13 x 6" galvanized steel hex bolts fully threaded (grade A307 or equivalent)
Trex Enhance 3" Steel Post		Qty 4: 1/2" ID, 1 3/8" OD, 0.109" thick galvanized steel flat washer (grade A307) Qty 4: 1/2"-13 galvanized steel hex nut (grade 2) installed into bottom of wood blocking
Trex Enhance Steel Rail Brackets, Horizontal Panel, and Accessories	Upper Bracket to Post	Qty 2: C1018 #12 x 3/4" self-drilling T25 screws
	Lower Bracket to Post	
	Brackets to Panel	Slide Horizontal Panel onto the steel brackets and secure panel to bracket with one C1018 #12 x 3/4" self-drilling T25 screw
	Rail Bracket Covers to Brackets	Spread and snap corresponding bracket covers over opening in upper and bottom rails
	Post Skirt to Post Base Plate	Slide covers over post base plate from the side
	Post Cap to Post	Snap on post cap to post from the top (use of rubber mallet may be required for secure attachment)
Imperial: 1 mm = 0.039 in		



Table 13. Fastening Schedule for Trex Signature Aluminum and Rod Rail Systems

Component	Connection	Details
Top Rail	Standard Bracket to Post	Three #10-16 x 5/8" pan head, self-drilling, stainless steel screws
	Standard Bracket to Rail	Two #10-16 x 5/8" pan head, self-drilling, stainless steel screws
	Side-Fastening Bracket to Rail	Two #10-16 x 1" flat head, self-drilling, stainless steel screws
	Crossover Bracket to Post	Compression fit - no mechanical connection; One 5/16"-18 x 2" hex-head bolt with nut inserted through a 1 1/2" wide by 2 3/16" long by 0.23" thick aluminum plate washer and the crossover bracket. A 2 5/16" wide x 2 3/16" long by 1 3/16" high expandable extrusion is slid over the plate washer. The assembly is placed in the post and the nut tightened which causes the expandable extrusion to expand, locking it into the post.
	Crossover Bracket to Rail	Two #10-16 x 5/8" pan head, self-drilling, stainless steel screws
Bottom Rail	Bracket to Post	Two #10-16 x 5/8" pan head, self-drilling, stainless steel screws
	Bracket to Rail	One #10-16 x 5/8" pan head, self-drilling, stainless steel screws
Baluster	Baluster to Top/Bottom/Intermediate Rail	No mechanical connection; slip fit into routing
Intermediate Vertical Support (Trex Signature Rod Rail)	Intermediate Baluster to Top/Bottom Rail	Two #8-15 x 1 1/4" pan head stainless steel screw at each end
Imperial: 1 mm = 0.039 in		

Table 14. Fastening Schedule for Trex Signature Mesh and Glass Railing Systems

Component	Connection	Details
Top Rail	Standard Bracket to Post	Three #10-16 x 5/8" pan head, self-drilling, stainless steel screws
	Standard Bracket to Rail	Two #8-15 x 1 1/4" pan head stainless steel screws
	Crossover Bracket to Post	Compression fit - no mechanical connection; One 5/16"-18 x 2" hex-head bolt with nut inserted through a 1 1/2" wide by 2 3/16" long by 0.23" thick aluminum plate washer and the crossover bracket. A 2 5/16" wide x 2 3/16" long by 1 3/16" high expandable extrusion is slid over the plate washer. The assembly is placed in the post and the nut tightened which causes the expandable extrusion to expand, locking it into the post.
	Crossover Bracket to Rail	Two #8-15 x 1 1/4" pan head stainless steel screw at each end
Bottom Rail	Bracket to Post	Two #10-16 x 5/8" pan head, self-drilling, stainless steel screws
	Bracket to Rail	No mechanical connection; secure with 3/4" square adhesive strip
Vertical Support (Mesh Railing Only)	Vertical Baluster to Top/Bottom Rail	Plastic angle connects the support baluster to the top/bottom rail; the angle is compression-fit into the baluster and attached to the top/bottom rail with one #8 18 x 5/8" trim head, stainless steel screw.
Mesh/Glass Infill	Mesh/Glass Infill to Top/Bottom Rail	No mechanical connection; slip fit into provided inserts
Imperial: 1 mm = 0.039 in		

6.4 Installation of Trex Signature X-Series Cable Rail and Trex Enhance Steel Rail shall be installed on Trex Signature®, Trex Transcend® Lineage®, Trex Transcend®, Trex Select®, and Trex Enhance® decking, or decking with equivalent properties.



7 Substantiating Data

- 7.1 Testing has been performed under the supervision of a professional engineer and/or under the requirements of ISO/IEC 17025 as follows:
- 7.1.1 Guardrail service load testing in accordance with ASTM E935 test reports from approved sources:
 - 7.1.1.1 In-fill load tests
 - 7.1.1.2 Uniform load tests
 - 7.1.1.3 Concentrated load tests
 - 7.1.2 Vertical element separation within the infill region in accordance with NBCC Sentence 4.1.5.15(4).
 - 7.2 Information contained herein is the result of testing and/or data analysis by sources that conform to the evaluation requirements of NBC Volume 1 Relationship of the NBC to Standards Development and Conformity Assessment and/or professional engineering regulations. DrJ relies upon accurate data to perform its ISO/IEC 17065 evaluations.
 - 7.3 Where appropriate, DrJ's analysis is based on provisions that have been codified into law through provincial, territorial, or local adoption of codes and standards. The developers of these codes and standards are responsible for the reliability of published content. DrJ analysis may use code-adopted provisions as a control sample. A control sample versus a test sample establishes a product as being equivalent to that prescribed in this code in quality, strength, effectiveness, fire resistance, durability and safety.
 - 7.4 The accuracy of the provisions provided herein may be reliant upon the published properties of raw materials, which are defined by the grade mark, grade stamp, mill certificate, listings, certified reports, duly authenticated reports from approved agencies, and research reports prepared by approved agencies and/or approved sources provided by the suppliers of products, materials, designs, assemblies and/or methods of construction. These are presumed to be minimum properties and relied upon to be accurate. The reliability of DrJ's engineering practice, as contained in this report, may be dependent upon published design properties by others.
 - 7.5 *Testing and Engineering Analysis*
 - 7.5.1 The strength, rigidity and/or general performance of component parts and/or the integrated structure are determined by suitable tests that simulate the actual conditions of application that occur and/or by accepted engineering practice and experience.
 - 7.6 Where additional condition of use and/or code compliance information is required, please search for Trex Metal Railing Systems on the [DrJ Certification website](#).

8 Findings

- 8.1 As outlined in **Section 4**, Trex Metal Railing Systems have performance characteristics that were tested and/or meet applicable regulations. In addition, they are suitable for use pursuant to its specified purpose.
- 8.2 When used and installed in accordance with this duly authenticated report and the manufacturer installation instructions, Trex Metal Railing Systems shall be approved for the following applications:
 - 8.2.1 Use as a guardrail system where a guardrail height of 1,070 mm (42") is allowed in accordance with NBCC Sentence 3.3.1.18(1), NBCC Article 9.8.8.1, and NBCC Sentence 9.8.8.3(1).
- 8.3 Any application specific issues not addressed herein can be engineered by an RDP. Assistance with engineering is available from Trex Company, Inc.
- 8.4 These innovative products have been evaluated in the context of the codes listed in **Section 3** and are compliant with all known provincial, territorial, and local building codes. Where there are known variations in provincial, territorial, or local codes applicable to this report, they are listed here:
 - 8.4.1 No known variations



8.5 NBC Volume 1 Relationship of the NBC to Standards Development and Conformity Assessment:

Certification

Certification is the confirmation by an independent organization that a product, service, or system meets a requirement...Certification bodies publish lists of certified products and companies...Several organizations, including the Canadian Construction Materials Centre (CCMC), offer such evaluation services.

Evaluation

An evaluation is a written opinion by an independent professional organization that a product will perform its intended function. An evaluation is very often done to determine the ability of an innovative product, for which no standards exist, to satisfy the intent of the Code requirement...

8.6 ISO/IEC 17065 accredited third-party certification bodies,⁸ including but not limited to, Standards Council of Canada (SCC)⁹ and ANSI National Accreditation Board (ANAB),¹⁰ confirm that product certification bodies have the expertise to provide technical evaluation services within their scope of accreditation. All SCC and ANAB product certification bodies meet NBC requirements to offer evaluation services for alternative solutions.¹¹

8.6.1 DrJ is an ISO/IEC 17065 ANAB-Accredited Product Certification Body – Accreditation #1131¹² and employs professional engineers.¹³

8.7 Through ANAB accreditation and the IAF Multilateral Agreements, this report can be used to obtain product approval in any jurisdiction or country that has IAF MLA Members & Signatories to meet the Purpose of the MLA – “certified once, accepted everywhere.” IAF specifically says, “Once an accreditation body is a signatory of the IAF MLA, it is required to recognise certificates and validation and verification statements issued by conformity assessment bodies accredited by all other signatories of the IAF MLA, with the appropriate scope.”¹⁴

8.8 Product certification organizations, accredited by the SCC and ANAB, are defined as equivalent evaluation services:

8.8.1 Canada-United States-Mexico Agreement (CUSMA), Article 11.6 Conformity Assessment confirms mutual recognition by stating, “...each Party shall accord to conformity assessment bodies located in the territory of another Party treatment no less favorable than that it accords to conformity assessment bodies located in its own territory or in the territory of the other Party.”

8.8.2 The SCC National Conformity Assessment Principles states, “SCC is a member of a number of international organizations developing voluntary conformity assessment agreements that help ensure the international acceptance of Canadian conformity assessment results. Signatories to these agreements (like SCC) recognize each other’s accreditations as being equivalent to their own.”¹⁵

8.9 Building official approval of a licensed professional engineer is performed by verifying the professional engineer and/or their business entity are listed by the engineering regulators of the relevant jurisdiction.

9 Conditions of Use

9.1 As defined in **Section 4**, where material and/or engineering mechanics properties are created for load resisting design purposes, the resistance to the applied load shall not exceed the ability of the defined properties to resist those loads using the principles of accepted engineering practice.

9.2 As listed herein, Trex Metal Railing Systems shall be limited to the following conditions:

9.2.1 Trex Metal Railing Systems have only been evaluated for live loads for use as guards. Other loadings are outside of the scope of this report.

9.2.2 The compatibility of the fasteners and all other metallic parts listed in this report with the supporting structure is outside of the scope of this report. This includes treated wood products.



- 9.2.3 Shims are not required to prevent direct contact between the post base plate and supporting structure. Shims are permitted between the post base plate and supporting structure where necessary to plumb the posts.
- 9.2.4 Trex Signature X-Series Cable Rail, Trex Signature Rod Rail, and Trex Signature Mesh Railing are approved for use only where the walking surface protected by the guard is not more than 4.2 m (165") above the adjacent level, except in jurisdictions such as Ontario where such designs are not permitted regardless of height.
- 9.3 When required by regulation and enforced by the building official, also known as the Authority Having Jurisdiction (AHJ) in which the project is to be constructed:
 - 9.3.1 Any calculations incorporated into the construction documents shall conform to accepted engineering practice and, when prepared by an approved source, shall be approved when signed and sealed.
 - 9.3.2 This report and the installation instructions shall be submitted at the time of permit application.
 - 9.3.3 These innovative products have an internal quality control program and a third-party quality assurance program.
 - 9.3.4 At a minimum, these innovative products shall be installed per **Section 6** of this report.
 - 9.3.5 This report shall be reviewed for code compliance by the AHJ in concert with the duties and powers granted to the building official by the provincial regulations governing such duties and powers.
 - 9.3.6 The application of these innovative products in the context of this report is dependent upon the accuracy of the construction documents, implementation of installation instructions, inspections, and any other regulatory requirements that may apply.
- 9.4 Design loads shall be determined in accordance with the building code adopted by the jurisdiction in which the project is to be constructed and/or by the building designer (i.e., owner).
- 9.5 The actual design, suitability, and use of this report for any particular building, is the responsibility of the owner or the authorized agent of the owner.

10 Identification

- 10.1 Trex Metal Railing Systems, as listed in **Section 1.1**, are identified by a label on the board or packaging material bearing the manufacturer name, product name, this report number, and other information to confirm code compliance.
- 10.2 Additional technical information can be found at www.trex.com/products/railing.

11 Review Schedule

- 11.1 This report is subject to periodic review and revision. For the latest version, visit www.drjcertification.org.
- 11.2 For information on the status of this report, please contact [DrJ Certification](http://www.drjcertification.org).



Notes

- 1 For more information, visit drjcertification.org or call us at 608-310-6748.
- 2 Unless otherwise noted, all references in this report are from the 2020 version of the NBC. This alternative solution is also approved for use with the 2010 and 2015 NBC and the standards referenced therein.
- 3 References in this report to the National Building Code of Canada (NBC) apply to the Ontario Building Code (OBC), unless noted otherwise.
- 4 Qualification is performed by a legislatively defined Accreditation Body. ANSI National Accreditation Board (ANAB) is the largest independent accreditation body in North America and provides services in more than 75 countries. DrJ is an ANAB accredited product certification body.
- 5 <https://anabpd.ansi.org/Accreditation/product-certification/AllDirectoryDetails?prqID=1&orgID=2125&statusID=4#:~:text=Bill%20Payment%20Date-,Accredited%20Scopes,-13%20ENVIRONMENT.%20HEALTH>
- 6 18 U.S. Code § 1831 - Economic espionage - Whoever, intending or knowing that the offense will benefit any foreign government, foreign instrumentality, or foreign agent, knowingly steals, or without authorization appropriates, takes, carries away, or conceals, or by fraud, artifice, or deception obtains a trade secret shall be fined not more than \$5,000,000 or imprisoned not more than 15 years, or both. Any organization that commits any offense described shall be fined not more than the greater of \$10,000,000 or 3 times the value of the stolen trade secret to the organization, including expenses for research and design and other costs of reproducing the trade secret that the organization has thereby avoided. <https://www.law.cornell.edu/uscode/text/18/part-I/chapter-90>.
- 7 ANAB is part of the USMCA and IAF MLA, where the purpose of these agreements are to ensure mutual recognition of accredited certification and validation/verification statements between agreement signatories, and subsequent acceptance of ANAB accredited certification and validation/verification statements by professional engineers based upon having one universal approval process for the timely approval of innovative materials, products, designs, services, assemblies and/or methods of construction.
- 8 <https://anabpd.ansi.org/Accreditation/product-certification/DirectoryListingAccredited?menuID=1&prqID=1>
- 9 https://iaf.nu/en/member-details/?member_id=91
- 10 https://iaf.nu/en/member-details/?member_id=14
- 11 NBC Division A Clause A-1.2.1.1.(1)(b) provides information on code compliance via alternative solutions and defines alternative solutions as "...achiev[ing] at least the minimum level of performance required by Division B." NBC Division C Section 2.3 includes additional guidance for documentation of alternative solutions.
- 12 <https://anabpd.ansi.org/Accreditation/product-certification/AllDirectoryDetails?prqID=1&OrgID=2125&statusID=4>
- 13 Through ANAB accreditation and the IAF MLA, DrJ certification can be used to obtain material, product, design, or method of construction approval in any jurisdiction or country that has IAF MLA Members & Signatories to meet the Purpose of the MLA – "certified once, accepted everywhere".
- 14 <https://iaf.nu/en/about-iaf-mla/#:~:text=required%20to%20recognise>
- 15 The National Conformity Assessment Principles states, "Product regulations and standards may vary from country to country. If these are set arbitrarily, they could be deemed as protectionist. The World Trade Organization (WTO) Agreement on Technical Barriers to Trade (TBT Agreement) is intended to ensure that technical regulations, standards and conformity assessment procedures of member countries do not create unnecessary obstacles to trade. Under the TBT Agreement, members of the WTO agree to use international standards, including conformity assessment standards and guides, as a basis for their technical requirements."