

## **Listing and Technical Evaluation Report™**

**A Duly Authenticated Report from an Approved Agency**

**Report No: 2404-01**



Issue Date: January 6, 2026

Revision Date: January 6, 2026

Subject to Renewal: April 1, 2027

### **W2W Shera™ Board Diaphragm Panel**

**Trade Secret Report Holder:**

**Wall To Wall, LLC (W2W)**

Phone: 650-292-0752

Website: [www.veev.com](http://www.veev.com)

Email: [ycohen@veev.com](mailto:ycohen@veev.com)

#### **CSI Designations:**

**DIVISION: 05 00 00 - METALS**

Section: 05 40 00 - Cold-Formed Metal Framing

Section: 05 42 00 - Cold-Formed Metal Joist Framing

**DIVISION: 06 00 00 - WOOD, PLASTICS AND COMPOSITES**

Section: 06 12 00 - Structural Panels

Section: 06 16 63 - Cementitious Sheathing

## **1 Innovative Product Evaluated<sup>1</sup>**

### **1.1 Shera Board Diaphragm Panel**

## **2 Product Description and Materials**

### **2.1 The innovative product evaluated in this report is shown in **Figure 1**.**



**Figure 1.** Installation of Shera Board Diaphragm Panel



2.2 Shera Board Diaphragm Panel is a floor diaphragm assembly comprised of the following:

2.2.1 *Sheathing:*

2.2.1.1 Shera Floor Boards are used as the subfloor sheathing panels and are installed with the long dimension perpendicular to the floor joists using #8 x 1<sup>5/8</sup>" Simpson Strong-Tie Quik Drive® Screws spaced 6" on center along panel edges and 12" on center in the field. 18 mm thick and 20 mm thick Shera Floor Boards were evaluated.

2.2.2 *Floor Joist:*

2.2.2.1 54 mils thick, 12" deep, 2<sup>1/2</sup>" wide flange (1200S250-54) Cold-Formed Steel (CFS) studs (C-sections) with a specified yield strength,  $F_y$ , of 50 ksi are used as floor joists.

2.2.2.1.1 Floor joists are spaced 16" on center.

2.2.2.1.2 Floor joists are connected to the rim joists with 2<sup>3/8</sup>" x 2<sup>3/8</sup>" x 6" L-Clips and then fastened with #12 14 x 3<sup>3/4</sup>" self-drilling, hex head screws. Three screws are installed on each side of the L-Clips.

2.2.2.1.3 Corners formed between the floor joists and the rim joists are reinforced with 18-gauge, 1<sup>1/2</sup>" x 1<sup>1/2</sup>" x 2" L-Clips and fastened with #12 14 x 3<sup>3/4</sup>" self-drilling, hex head screws.

2.2.3 *Rim Joist:*

2.2.3.1 54 mils thick, 12" deep, 2" wide flange (1200T250-54) CFS tracks with a specified yield strength,  $F_y$ , of 50 ksi are used as rim joists.

2.2.4 *Bridging:*


2.2.4.1 One 3" wide, 16-gauge strap member connects bottom of all joists at midspan.

2.2.5 *Blocking:*

2.2.5.1 Two CFS studs, with size identical to the floor joists, are used as blocking members at midspan in between the rim joist and the outermost floor joist.

2.2.5.1.1 Blocking members are connected to the floor joists with 16-gauge, 4<sup>1/2</sup>" x 2" x 10" and 16-gauge, 2" x 2" x 10" L-Clips.

2.2.5.2 See **Figure 2** for an overview of the assembly.

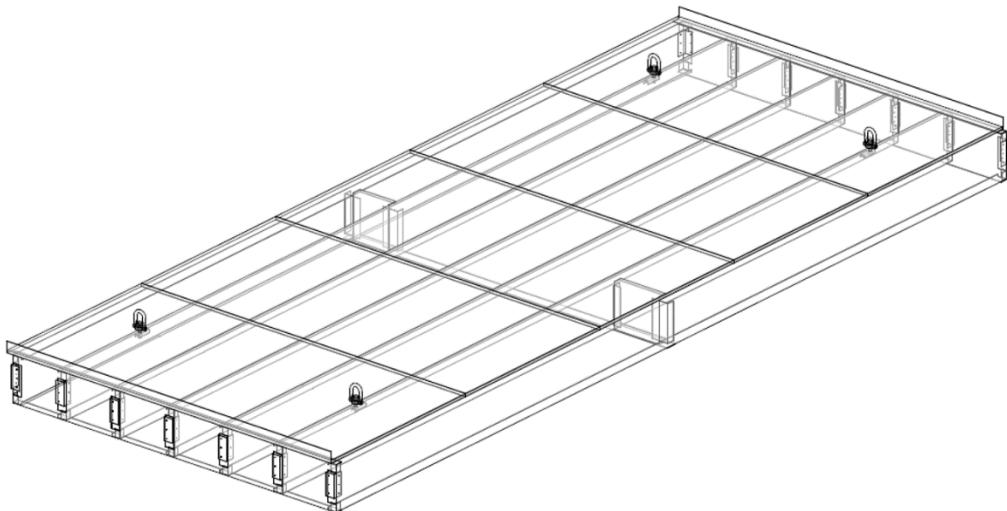

**Figure 2.** Shera Board Diaphragm Panel Diagram

2.3 As needed, review material properties for design in **Section 6** and the regulatory evaluation in **Section 8**.



### 3 Definitions<sup>2</sup>

- 3.1 New Materials<sup>3</sup> are defined as building materials, equipment, appliances, systems, or methods of construction, not provided for by prescriptive and/or legislatively adopted regulations, known as alternative materials.<sup>4</sup> The design strength and permissible stresses shall be established by tests<sup>5</sup> and/or engineering analysis.<sup>6</sup>
- 3.2 Duly authenticated reports<sup>7</sup> and research reports<sup>8</sup> are test reports and related engineering evaluations that are written by an approved agency<sup>9</sup> and/or an approved source.<sup>10</sup>
  - 3.2.1 These reports utilize intellectual property and/or trade secrets to create public domain material properties for commercial end-use.
    - 3.2.1.1 This report protects confidential Intellectual Property and trade secrets under the regulation, 18.U.S.Code.90, also known as Defend Trade Secrets Act of 2016 (DTSA).<sup>11</sup>
- 3.3 An approved agency is “approved” when it is ANAB ISO/IEC 17065 accredited. DrJ Engineering, LLC (DrJ) is accredited and listed in the ANAB directory.
- 3.4 An approved source is “approved” when a professional engineer (i.e., Registered Design Professional, hereinafter RDP) is properly licensed to transact engineering commerce. The regulatory authority governing approved sources is the state legislature via its professional engineering regulations.<sup>12</sup>
- 3.5 Testing and/or inspections conducted for this duly authenticated report were performed by an ISO/IEC 17025 accredited testing laboratory, an ISO/IEC 17020 accredited inspection body, and/or a licensed RDP.
  - 3.5.1 The Center for Building Innovation (CBI) is ANAB<sup>13</sup> ISO/IEC 17025 and ISO/IEC 17020 accredited.
- 3.6 The regulatory authority shall enforce<sup>14</sup> the specific provisions of each legislatively adopted regulation. If there is a non-conformance, the specific regulatory section and language of the non-conformance shall be provided in writing<sup>15</sup> stating the nonconformance and the path to its cure.
- 3.7 The regulatory authority shall accept duly authenticated reports from an approved agency and/or an approved source with respect to the quality and manner of use of new materials or assemblies as provided for in regulations regarding the use of alternative materials, designs, or methods of construction.<sup>16</sup>
- 3.8 ANAB is an International Accreditation Forum (IAF) Multilateral Recognition Arrangement (MLA) signatory. Therefore, recognition of certificates and validation statements issued by conformity assessment bodies accredited by all other signatories of the IAF MLA with the appropriate scope shall be approved.<sup>17</sup> Thus, all ANAB ISO/IEC 17065 duly authenticated reports are approval equivalent,<sup>18</sup> and can be used in any country that is an MLA signatory found at this link: <https://iaf.nu/en/recognised-abs/>
- 3.9 Approval equity is a fundamental commercial and legal principle.<sup>19</sup>

### 4 Applicable Local, State, and Federal Approvals; Standards; Regulations<sup>20</sup>

#### 4.1 Local, State, and Federal

- 4.1.1 Approved in all local jurisdictions pursuant to ISO/IEC 17065 duly authenticated report use, which includes, but is not limited to, the following featured local jurisdictions: Austin, Baltimore, Broward County, Chicago, Clark County, Dade County, Dallas, Detroit, Denver, DuPage County, Fort Worth, Houston, Kansas City, King County, Knoxville, Las Vegas, Los Angeles City, Los Angeles County, Miami, Nashville, New York City, Omaha, Philadelphia, Phoenix, Portland, San Antonio, San Diego, San Jose, San Francisco, Seattle, Sioux Falls, South Holland, St. Louis County, Texas Department of Insurance, and Wichita.<sup>21</sup>
- 4.1.2 Approved in all state jurisdictions pursuant to ISO/IEC 17065 duly authenticated report use, which includes, but is not limited to, the following featured states: California, Florida, New Jersey, Oregon, New York, Texas, Washington, and Wisconsin.<sup>22</sup>



4.1.3 Approved by the Code of Federal Regulations Manufactured Home Construction: Pursuant to Title 24, Subtitle B, Chapter XX, Part 3282.14<sup>23</sup> and Part 3280<sup>24</sup> pursuant to the use of ISO/IEC 17065 duly authenticated reports.

4.1.4 Approved means complying with the requirements of local, state, or federal legislation.

## 4.2 Regulations

4.2.1 *IBC – 18, 21, 24: International Building Code®*

4.2.2 *IRC – 18, 21, 24: International Residential Code®*

## 4.3 Standards

4.3.1 *AISI S100: North American Specification for the Design of Cold-Formed Steel Structural Members*

4.3.2 *AISI S230: Standard for Cold-Formed Steel Framing – Prescriptive Method for One and Two-Family Dwellings*

4.3.3 *AISI S240: North American Standard for Cold-Formed Steel Structural Framing*

4.3.4 *ASTM E455: Standard Test Method for Static Load Testing of Framed Floor or Roof Diaphragm Constructions for Buildings*

## 5 Listed<sup>25</sup>

5.1 Equipment, materials, products, or services included in a List published by a nationally recognized testing laboratory (i.e., CBI), an approved agency (i.e., CBI and DrJ), and/or an approved source (i.e., DrJ), or other organization(s) concerned with product evaluation (i.e., DrJ), that maintains periodic inspection (i.e., CBI) of production of listed equipment or materials, and whose listing states either that the equipment or material meets nationally recognized standards or has been tested and found suitable for use in a specified manner.

## 6 Tabulated Properties Generated from Nationally Recognized Standards

### 6.1 General

6.1.1 Shera Board Diaphragm Panels use an alternative sheathing material to the ones specified in AISI S240 per IBC Section 2206.1,<sup>26</sup> and AISI S230 per IBC Section 2206.1.2.<sup>27</sup>

### 6.2 Structural Applications

6.2.1 Shear capacity of Shera Board Diaphragm Panel was evaluated in accordance with ASTM E455.

6.2.1.1 Allowable Stress Design (ASD) values determined in accordance with the methodology prescribed in AISI S240 Section B5.4.2.5 are shown in **Table 1**.

**Table 1.** Shera Board Diaphragm Panel ASD Values for Lateral Resistance

Product <sup>1</sup>	Sheathing Thickness	Sheathing Orientation	Fastener Spacing (in o.c.)	Maximum Aspect Ratio	Allowable Shear Value (plf)	Apparent Shear Stiffness, $G_a$ (kips/in)
Shera Board Diaphragm Panel	18 mm ( $\frac{23}{32}$ "")	Perpendicular to Floor Joist	6:12	2.5	670	36.5
	20 mm ( $\frac{25}{32}$ "")		6:12	2.5	670	36.5

SI: 1 in = 25.4 mm, 1 lb/ft = 0.0146 kN/m

1. See **Section 2** for assembly details.



6.2.1.2 Load Resistance Factor Design (LRFD) values determined in accordance with the methodology prescribed in AISI S240 Section B5.4.2.5 are shown **Table 2**.

**Table 2.** Shera Board Diaphragm Panel Strength Design (LRFD) Values for Lateral Resistance

Product <sup>1</sup>	Sheathing Thickness	Sheathing Orientation	Fastener Spacing (in o.c.)	Maximum Aspect Ratio	Factored Shear Strength (plf)	Apparent Shear Stiffness, G <sub>a</sub> (kips/in)
Shera Board Diaphragm Panel	18 mm (23/32")	Perpendicular to Floor Joist	6:12	2.5	1,130	36.5
	20 mm (25/32")		6:12	2.5	1,130	36.5

SI: 1 in = 25.4 mm, 1 lb/ft = 0.0146 kN/m

1. See **Section 2** for assembly details.

6.3 Where the application falls outside of the performance evaluation, conditions of use, and/or installation requirements set forth herein, alternative techniques shall be permitted in accordance with accepted engineering practice and experience. This includes but is not limited to the following areas of engineering: mechanics or materials, structural, building science, and fire science.

## 7 Certified Performance<sup>28</sup>

7.1 All construction methods shall conform to accepted engineering practices to ensure durable, livable, and safe construction and shall demonstrate acceptable workmanship reflecting journeyman quality of work of the various trades.<sup>29</sup>

7.2 The strength and rigidity of the component parts and/or the integrated structure shall be determined by engineering analysis or by suitable load tests to simulate the actual loads and conditions of application that occur.<sup>30</sup>

## 8 Regulatory Evaluation and Accepted Engineering Practice

8.1 Shera Board Diaphragm Panel complies with the following legislatively adopted regulations and/or accepted engineering practice for the following reasons:

8.1.1 In accordance with IBC Section 2206.1,<sup>31</sup> the design and installation of floor structural framing systems comprised of cold-formed steel light-frame construction, including their members and connections, shall be in accordance with AISI S240.

8.1.1.1 Shera Board Diaphragm Panel were evaluated in accordance with ASTM E455 per AISI S240 Section B5.4.2.5 and AISI S100 Section K2.1(a).

8.1.2 For prescriptive framing for detached one and two-family dwellings and townhouses, less than or equal to three stories above grade plane, IBC Section 2206.1.2<sup>32</sup> requires construction to be in accordance with AISI S230.

8.1.2.1 Furthermore, for floors exceeding the provisions of IRC Section R505.1.1, design and construction shall be in accordance with AISI S230.

8.2 Any building code, regulation and/or accepted engineering evaluations (i.e., research reports, duly authenticated reports, etc.) that are conducted for this Listing were performed by DrJ, which is an ISO/IEC 17065 accredited certification body and a professional engineering company operated by RDP or approved sources. DrJ is qualified<sup>33</sup> to practice product and regulatory compliance services within its scope of accreditation and engineering expertise,<sup>34</sup> respectively.



- 8.3 Engineering evaluations are conducted with DrJ's ANAB accredited ICS code scope of expertise, which is also its areas of professional engineering competence.
- 8.4 Any regulation specific issues not addressed in this section are outside the scope of this report.

## 9 Installation

- 9.1 Installation shall comply with the approved construction documents, the manufacturer installation instructions, this report, and the applicable building code.
- 9.2 In the event of a conflict between the manufacturer installation instructions and this report, contact the manufacturer for counsel on the proper installation method.
- 9.3 Shera Board Diaphragm Panel are generally delivered to the jobsite as part of a shop-fabricated floor cassette.
  - 9.3.1 In some occasions, the design and engineering plans requires some strips of the subfloor to be field installed over "Site Frames" (may also be referred to "Flush Beams" in construction documents), which are beams that support the floor cassettes.
- 9.4 Any generic details provided by Wall To Wall, LLC shall be evaluated and revised by an RDP for applicability to a specific building, as pertinent.
  - 9.4.1 Bearing conditions for support of Shera Board Diaphragm Panel (e.g., shear walls, foundation walls, footings) shall be designed by an RDP.
- 9.5 Shera Board Diaphragm Panel shall be installed in accordance with the plans and specifications designed and submitted for action on the application review by the building official.
- 9.6 All panels are stamped by the manufacturer (W2W) with sequencing identification to correspond to the approved construction documents for easy placement in the proper location.

## 10 Substantiating Data

- 10.1 Testing has been performed under the supervision of a professional engineer and/or under the requirements of ISO/IEC 17025 as follows:
  - 10.1.1 Lateral resistance performance of diaphragms tested in accordance with ASTM E455, Static Load Testing of Framed Floor or Roof Diaphragm Constructions for Buildings
- 10.2 Information contained herein may include the result of testing and/or data analysis by sources that are approved agencies, approved sources, and/or an RDP. Accuracy of external test data and resulting analysis is relied upon.
- 10.3 Where applicable, testing and/or engineering analysis are based upon provisions that have been codified into law through state or local adoption of regulations and standards. The developers of these regulations and standards are responsible for the reliability of published content. DrJ's engineering practice may use a regulation-adopted provision as the control. A regulation-endorsed control versus a simulation of the conditions of application to occur establishes a new material as being equivalent to the regulatory provision in terms of quality, strength, effectiveness, fire resistance, durability, and safety.
- 10.4 The accuracy of the provisions provided herein may be reliant upon the published properties of raw materials, which are defined by the grade mark, grade stamp, mill certificate, or duly authenticated reports from approved agencies and/or approved sources provided by the supplier. These are presumed to be minimum properties and relied upon to be accurate. The reliability of DrJ's engineering practice, as contained in this duly authenticated report, may be dependent upon published design properties by others.



## 10.5 Testing and Engineering Analysis

10.5.1 The strength, rigidity, and/or general performance of component parts and/or the integrated structure are determined by suitable tests that simulate the actual conditions of application that occur and/or by accepted engineering practice and experience.<sup>35</sup>

10.6 Where additional condition of use and/or regulatory compliance information is required, please search for Shera Board Diaphragm Panel on the [DrJ Certification website](#).

## 11 Findings

11.1 As outlined in **Section 6**, Shera Board Diaphragm Panel has performance characteristics that were tested and/or meet applicable regulations. In addition, they are suitable for use pursuant to its specified purpose.

11.2 When used and installed in accordance with this [duly authenticated report](#) and the manufacturer installation instructions, Shera Board Diaphragm Panel shall be approved for the following applications:

11.2.1 Use in floor diaphragms when designed and installed in accordance with **Section 9**.

11.3 Unless exempt by state statute, when Shera Board Diaphragm Panel is to be used as a structural and/or building envelope component in the design of a specific building, the design shall be performed by an [RDP](#).

11.4 Any application specific issues not addressed herein can be engineered by an [RDP](#). Assistance with engineering is available from Wall To Wall, LLC.

11.5 [IBC Section 104.2.3](#)<sup>36</sup> ([IRC Section R104.2.2](#)<sup>37</sup> and [IFC Section 104.2.3](#)<sup>38</sup> are similar) in pertinent part state:

**104.2.3 Alternative Materials, Design and Methods of Construction and Equipment.** The provisions of this code are not intended to prevent the installation of any material or to prohibit any design or method of construction not specifically prescribed by this code, provided that any such alternative is not specifically prohibited by this code and has been approved.

11.6 **Approved:**<sup>39</sup> Building regulations require that the [building official](#) shall accept [duly authenticated reports](#).<sup>40</sup>

11.6.1 An [approved agency](#) is “approved” when it is [ANAB ISO/IEC 17065 accredited](#).

11.6.2 An [approved source](#) is “approved” when an [RDP](#) is properly licensed to transact engineering commerce.

11.6.3 Federal law, [Title 18 US Code Section 242](#), requires that, where the alternative product, material, service, design, assembly, and/or method of construction is not approved, the building official shall respond in writing, stating the reasons why the alternative was not approved. Denial without written reason deprives a protected right to free and fair competition in the marketplace.

11.7 DrJ is a licensed engineering company, employs licensed [RDPs](#) and is an [ANAB Accredited Product Certification Body](#) – Accreditation #1131.

11.8 Through the [IAF Multilateral Arrangement \(MLA\)](#), this [duly authenticated report](#) can be used to obtain product approval in any [jurisdiction](#) or [country](#) because all ANAB ISO/IEC 17065 [duly authenticated reports](#) are equivalent.<sup>41</sup>

## 12 Conditions of Use

12.1 Material properties shall not fall outside the boundaries defined in **Section 6**.

12.2 As defined in **Section 6**, where material and/or engineering mechanics properties are created for load resisting design purposes, the resistance to the applied load shall not exceed the ability of the defined properties to resist those loads using the principles of accepted engineering practice.

12.3 As listed herein, Shera Board Diaphragm Panel shall be subject to the following conditions:

12.3.1 Maximum aspect ratio for floor diaphragms shall be 2.5:1



12.4 When required by adopted legislation and enforced by the building official, also known as the Authority Having Jurisdiction (AHJ) in which the project is to be constructed:

- 12.4.1 Any calculations incorporated into the construction documents shall conform to accepted engineering practice and, when prepared by an approved source, shall be approved when signed and sealed.
- 12.4.2 This report and the installation instructions shall be submitted at the time of permit application.
- 12.4.3 This innovative product has an internal quality control program and a third-party quality assurance program.
- 12.4.4 At a minimum, this innovative product shall be installed per **Section 9**.
- 12.4.5 The review of this report by the AHJ shall comply with IBC Section 104.2.3.2 and IBC Section 105.3.1.
- 12.4.6 This innovative product has an internal quality control program and a third party quality assurance program in accordance with IBC Section 104.7.2, IBC Section 110.4, IBC Section 1703, IRC Section R104.7.2, and IRC Section R109.2.
- 12.4.7 The application of this innovative product in the context of this report is dependent upon the accuracy of the construction documents, implementation of installation instructions, inspection as required by IBC Section 110.3, IRC Section R109.2, and any other regulatory requirements that may apply.

12.5 The approval of this report by the AHJ shall comply with IBC Section 1707.1, where legislation states in part, *“the building official shall make, or cause to be made, the necessary tests and investigations; or the building official shall accept duly authenticated reports from approved agencies in respect to the quality and manner of use of new materials or assemblies as provided for in Section 104.2.3”*, all of IBC Section 104, and IBC Section 105.3.

12.6 Design loads shall be determined in accordance with the regulations adopted by the jurisdiction in which the project is to be constructed and/or by the building designer (i.e., owner or RDP).

12.7 The actual design, suitability, and use of this report for any particular building, is the responsibility of the owner or the authorized agent of the owner.

## 13 Identification

13.1 Shera Board Diaphragm Panel, as listed in **Section 1.1**, is identified by a label on the board or packaging material bearing the manufacturer name, product name, this report number, and other information to confirm code compliance.

13.2 Additional technical information can be found at [www.veev.com](http://www.veev.com).

## 14 Review Schedule

14.1 This report is subject to periodic review and revision. For the latest version, visit [www.drjcertification.org](http://www.drjcertification.org).

14.2 For information on the status of this report, please contact DrJ Certification.



## Notes

- 1 For more information, visit [drjcertification.org](http://drjcertification.org) or call us at 608-310-6748.
- 2 Capitalized terms and responsibilities are defined pursuant to the applicable building code, applicable reference standards, the latest edition of TPI 1, the NDS, AISI S202, US professional engineering law, Canadian building code, Canada professional engineering law, Qualtim External Appendix A: Definitions/Commentary, Qualtim External Appendix B: Project/Deliverables, Qualtim External Appendix C: Intellectual Property and Trade Secrets, definitions created within Design Drawings and/or definitions within Reference Sheets. Beyond this, terms not defined shall have ordinarily accepted meanings as the context implies. Words used in the present tense include the future; words stated in the masculine gender include the feminine and neuter; the singular number includes the plural and the plural, the singular.
- 3 <https://up.codes/viewer/mississippi/ibc-2024/chapter/17/special-inspections-and-tests#1702>
- 4 Alternative Materials, Design and Methods of Construction and Equipment: The provisions of any regulation code are not intended to prevent the installation of any material or to prohibit any design or method of construction not specifically prescribed by a regulation. Please review <https://www.justice.gov/atr/mission> and <https://up.codes/viewer/mississippi/ibc-2024/chapter/1/scope-and-administration#104.2.3>
- 5 <https://up.codes/viewer/mississippi/ibc-2024/chapter/17/special-inspections-and-tests#1706.2.~:text=the%20design%20strengths%20and%20permissible%20stresses%20shall%20be%20established%20by%20tests>
- 6 The design strengths and permissible stresses of any structural material shall conform to the specifications and methods of design of accepted engineering practice. <https://up.codes/viewer/mississippi/ibc-2024/chapter/17/special-inspections-and-tests#1706.1.~:text=Conformance%20to%20Standards-The%20design%20strengths%20and%20permissible%20stresses,-of%20any%20structural>
- 7 <https://up.codes/viewer/mississippi/ibc-2024/chapter/17/special-inspections-and-tests#1707.1.~:text=the%20building%20official%20shall%20make%20C%20or%20cause%20to%20be%20made%2C%20the%20necessary%20tests%20and%20investigations%3B%20or%20the%20building%20official%20shall%20accept%20duly%20authenticated%20reports%20from%20approved%20agencies%20in%20respect%20to%20the%20quality%20and%20manner%20of%20use%20of%20new%20materials%20or%20assemblies%20as%20provided%20for%20in%20Section%20104.2.3>
- 8 <https://up.codes/viewer/mississippi/ibc-2024/chapter/17/special-inspections-and-tests#1703.4.2>
- 9 [https://up.codes/viewer/mississippi/ibc-2024/chapter/2/definitions#approved\\_agency](https://up.codes/viewer/mississippi/ibc-2024/chapter/2/definitions#approved_agency)
- 10 [https://up.codes/viewer/mississippi/ibc-2024/chapter/2/definitions#approved\\_source](https://up.codes/viewer/mississippi/ibc-2024/chapter/2/definitions#approved_source)
- 11 <https://www.law.cornell.edu/uscode/text/18/1832> (b) Any organization that commits any offense described in subsection (a) shall be fined not more than the greater of \$5,000,000 or 3 times the value of the stolen trade secret to the organization, including expenses for research and design and other costs of reproducing the trade secret that the organization has thereby avoided. The federal government and each state have a public records act. To follow DTSA and comply state public records and trade secret legislation requires approval through ANAB ISO/IEC 17065 accredited certification bodies or approved sources. For more information, please review this website: Intellectual Property and Trade Secrets.
- 12 <https://www.nspe.org/resources/issues-and-advocacy/professional-policies-and-position-statements/regulation-professional> AND <https://apassociation.org/list-of-engineering-boards-in-each-state-archive/>
- 13 <https://www.cbitest.com/accreditation/>
- 14 <https://up.codes/viewer/mississippi/ibc-2024/chapter/1/scope-and-administration#104.1.~:text=directed%20to%20enforce%20the%20provisions%20of%20this%20code>
- 15 <https://up.codes/viewer/mississippi/ibc-2024/chapter/1/scope-and-administration#104.2.3> AND <https://up.codes/viewer/mississippi/ibc-2024/chapter/1/scope-and-administration#105.3.1>
- 16 <https://up.codes/viewer/mississippi/ibc-2024/chapter/17/special-inspections-and-tests#1707.1>
- 17 <https://iaf.nu/en/about-iaf-mla#:~:text=Once%20an%20accreditation%20body%20is%20a%20signatory%20of%20the%20IAF%20MLA%2C%20it%20is%20required%20to%20recognise%20certificates%20and%20validation%20and%20verification%20statements%20issued%20by%20conformity%20assessment%20bodies%20accredited%20by%20all%20other%20signatories%20of%20the%20IAF%20MLA%2C%20with%20the%20appropriate%20scope>
- 18 True for all ANAB accredited product evaluation agencies and all International Trade Agreements.
- 19 <https://www.justice.gov/crt/deprivation-rights-under-color-law> AND <https://www.justice.gov/atr/mission>
- 20 Unless otherwise noted, the links referenced herein use un-amended versions of the 2024 International Code Council (ICC) 2024 International Code Council (ICC) model codes as foundation references. Mississippi versions of the IBC 2024 and the IRC 2024 are un-amended. This material, product, design, service and/or method of construction also complies with the 2000-2012 versions of the referenced codes and the standards referenced therein. As pertinent to this technical and code compliance evaluation, CBI and/or DrJ staff have reviewed any state or local regulatory amendments to assure this report is in compliance.
- 21 See Adoptions by Publisher for the latest adoption of a non-amended or amended model code by the local jurisdiction. <https://up.codes/codes/general>
- 22 See Adoptions by Publisher for the latest adoption of a non-amended or amended model code by state. <https://up.codes/codes/general>
- 23 <https://www.ecfr.gov/current/title-24 subtitle-B chapter-XX part-3282 subpart-A section-3282.14>
- 24 <https://www.ecfr.gov/current/title-24 subtitle-B chapter-XX part-3280>
- 25 [https://www.ecfr.gov/current/title-24 subtitle-B chapter-XX part-3280#p-3280.2\(Listed%20or%20certified\)](https://www.ecfr.gov/current/title-24 subtitle-B chapter-XX part-3280#p-3280.2(Listed%20or%20certified)); <https://up.codes/viewer/mississippi/ibc-2024/chapter/2/definitions#listed> AND <https://up.codes/viewer/mississippi/ibc-2024/chapter/2/definitions#labeled>
- 26 [2021 IBC Section 2211.1](#)
- 27 [2021 IBC Section 2211.1.2](#)
- 28 <https://up.codes/viewer/mississippi/ibc-2024/chapter/17/special-inspections-and-tests#1703.4>
- 29 <https://www.ecfr.gov/current/title-24 subtitle-B chapter-XX part-3280#:~:text=All%20construction%20methods%20shall%20be%20in%20conformance%20with%20accepted%20engineering%20practices%20to%20insure%20durable%2C%20ivable%2C%20and%20safe%20housing%20and%20shall%20demonstrate%20acceptable%20workmanship%20reflecting%20journeyman%20quality%20of%20work%20of%20the%20various%20trades>



---

30 <https://www.ecfr.gov/current/title-24/subtitle-B/chapter-XX/part-3280#:~:text=The%20strength%20and%20rigidity%20of%20the%20component%20parts%20and/or%20the%20integrated%20structure%20shall%20be%20determined%20by%20engineering%20analysis%20or%20by%20suitable%20load%20tests%20to%20simulate%20the%20actual%20loads%20and%20conditions%20of%20application%20that%20occur>

31 [2021 IBC Section 2211.1](#)

32 [2021 IBC Section 2211.1.2](#)

33 Qualification is performed by a legislatively defined [Accreditation Body](#). [ANSI National Accreditation Board \(ANAB\)](#) is the largest independent accreditation body in North America and provides services in more than 75 countries. [DrJ](#) is an ANAB accredited product certification body.

34 <https://anabpd.ansi.org/Accreditation/product-certification/AllDirectoryDetails?prgID=1&orgID=2125&statusID=4#:~:text=Bill%20Payment%20Date,-Accredited%20Scopes,-13%20ENVIRONMENT.%20HEALTH>

35 See Code of Federal Regulations (CFR) Title 24 Subtitle B Chapter XX Part 3280 for definition: <https://www.ecfr.gov/current/title-24/subtitle-B/chapter-XX/part-3280>

36 [2021 IBC Section 104.11](#)

37 [2021 IRC Section R104.11](#)

38 2018: <https://up.codes/viewer/wyoming/ifc-2018/chapter/1/scope-and-administration#104.9> AND 2021: <https://up.codes/viewer/wyoming/ibc-2021/chapter/1/scope-and-administration#104.11>

39 Approved is an adjective that modifies the noun after it. For example, Approved Agency means that the Agency is accepted officially as being suitable in a particular situation. This example conforms to IBC/IRC/IFC [Section 201.4](#) (<https://up.codes/viewer/mississippi/ibc-2024/chapter/2/definitions#201.4>) where the building code authorizes sentences to have an ordinarily accepted meaning such as the context implies.

40 <https://up.codes/viewer/mississippi/ibc-2024/chapter/17/special-inspections-and-tests#1707.1>

41 Multilateral approval is true for all ANAB accredited product evaluation agencies and all International Trade Agreements.