



Listing and Technical Evaluation Report™

A Duly Authenticated Report from an Approved Agency

Report No: 1009-01



Issue Date: March 27, 2011

Revision Date: February 26, 2025

Subject to Renewal: April 1, 2026

Use Of FastenMaster® HeadLOK® Fasteners to Attach Cladding and/or Furring to Wood Framing Through Foam Sheathing

Trade Secret Report Holder:

OMG®, Inc. dba FastenMaster®

Phone: 800-518-3569

Website: www.fastenmaster.com

Email: mguthrie@omginc.com

CSI Designations:

DIVISION: 06 00 00 - WOOD, PLASTICS AND COMPOSITES

Section: 06 02 00 - Design Information

Section: 06 05 23 - Wood, Plastic, and Composite Fastenings

Section: 06 11 00 - Wood Framing

Section: 06 12 00 - Structural Panels

Section: 06 16 00 - Sheathing

Section: 06 17 00 - Shop-Fabricated Structural Wood

1 Innovative Product Evaluated¹

1.1 FastenMaster® HeadLOK® Heavy Duty Flat Head Fasteners

2 Product Description and Materials

2.1 The innovative product evaluated in this report is shown in **Figure 1** and **Figure 2**.

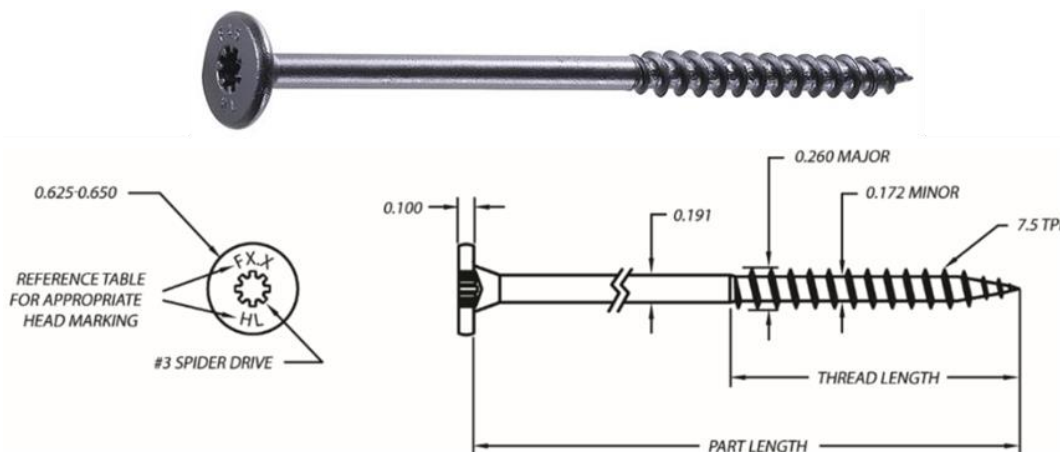


Figure 1. HeadLOK Heavy Duty Fastener – Spider Drive

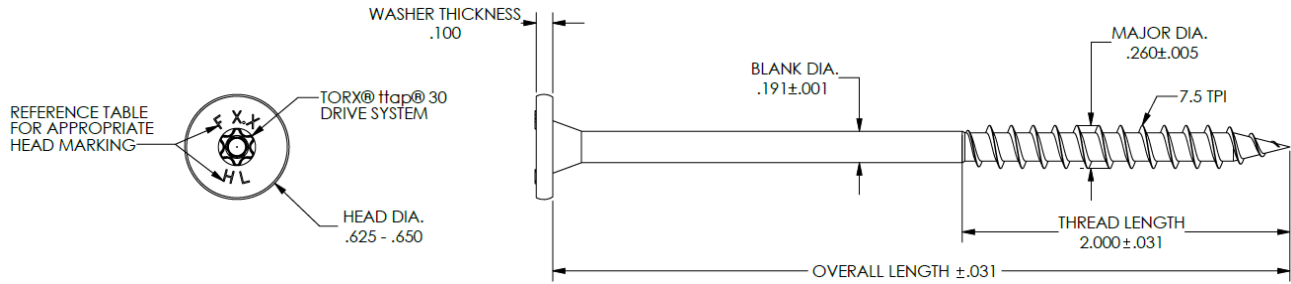


Figure 2. HeadLOK Heavy Duty Fastener – Torx Drive (T30)

- 2.2 HeadLOK fasteners are partially threaded, dowel-type fasteners with a flat head and a gimlet point designed to be installed in wood without the need for predrilling.
- 2.2.1 HeadLOK fasteners are available in two drive systems as shown in **Figure 1** and **Figure 2**:
 - 2.2.1.1 #3 Spider drive
 - 2.2.1.2 T30 Torx drive
- 2.3 HeadLOK fasteners are manufactured using a standard cold-formed process followed by a heat-treating process from 1022 carbon steel or 10B21 wire conforming to ASTM A510 with a minimum ultimate tensile strength of 60-ksi.
- 2.4 HeadLOK fastener specifications shown in **Table 1**.

**Table 1.** Fastener Specifications for Evaluated HeadLOK Fasteners

Fastener Designation ¹	Dimension (in)					Bending Yield Strength, ⁴ F _{yb} (psi)	Allowable Fastener Strength (lb)	
	Fastener Length ²	Thread Length ³	Shank Diameter	Minor Diameter	Major Diameter		Tensile	Shear ⁵
FMHLGM158	1 ⁵ / ₈	2	0.191	0.172	0.260	187,300	1,215	965
FMHLGM278	2 ⁷ / ₈							
FMHLGM334	3 ³ / ₄							
FMHLGM412	4 ¹ / ₂							
FMHLGM005	5							
FMHLGM512	5 ¹ / ₂							
FMHLGM006	6							
FMHLGM612	6 ¹ / ₂							
FMHLGM007	7							
FMHLGM712	7 ¹ / ₂							
FMHLGM008	8							
FMHLGM812	8 ¹ / ₂							
FMHLGM009	9	2	0.191	0.172	0.260	187,300	1,215	965
FMHLGM912	9 ¹ / ₂							
FMHLGM010	10							
FMHLGM011	11							
FMHLGM012	12							
FMHLGM013	13							
FMHLGM014	14							
FMHLGM015	15							
FMHLGM016	16							
FMHLGM018	18							

St: 1 in = 25.4 mm, 1 psi = 6.895 kPa, 1 lb = 4.448 N

1. Fastener designations are found on the product packaging. Individual fasteners may be marked according to this table
2. Fastener length is measured from the tip to bottom surface of the head.
3. Length of thread includes the tip.
4. Bending yield strength determined from ASTM F1575 and calculated using the minor diameter.
5. Allowable shear strength values apply to the unthreaded shank portion of the fastener.



2.5 Corrosion Resistance

2.5.1 HeadLOK fasteners have a proprietary coating, which may be used as an alternative to the protection provided by code-approved hot-dipped galvanized coatings meeting ASTM A153, Class D ([IBC Section 2304.10.6²](#) and [IRC Section R317.3](#)).

2.5.1.1 HeadLOK fasteners may be used where screws are required to exhibit corrosion resistance when exposed to adverse environmental conditions, which are subject to the limitations of this report. HeadLOK fasteners have been evaluated for use in wood treated with waterborne alkaline copper quaternary type D (ACQ-D) preservatives with a retention of 0.40-pcf (6.4 kg/m³).

2.6 Pressure-Preservative Treated (PPT) Wood Applications

2.6.1 HeadLOK fasteners having the proprietary coating are recognized for use in PPT lumber provided the conditions set forth by the PPT lumber manufacturer are met, including appropriate strength reductions.

2.7 Fire-Retardant Treated (FRT) Wood Applications

2.7.1 HeadLOK fasteners having the proprietary coating are recognized for use in FRT lumber provided the conditions set forth by the FRT lumber manufacturer are met, including appropriate strength reductions.

2.8 HeadLOK fasteners are approved for use in interior applications.

2.9 As needed, review material properties for design in **Section 6** and to regulatory evaluation in **Section 8**.



3 Definitions

- 3.1 New Materials³ are defined as building materials, equipment, appliances, systems, or methods of construction not provided for by prescriptive and/or legislatively adopted regulations, known as alternative materials.⁴ The design strengths and permissible stresses shall be established by tests⁵ and/or engineering analysis.⁶
- 3.2 Duly Authenticated Reports⁷ and Research Reports⁸ are test reports and related engineering evaluations, which are written by an approved agency⁹ and/or an approved source.¹⁰
- 3.2.1 These reports contain intellectual property and/or trade secrets, which are protected by the Defend Trade Secrets Act (DTSA).¹¹
- 3.3 An approved agency is “approved” when it is ANAB ISO/IEC 17065 accredited. DrJ Engineering, LLC (DrJ) is listed in the ANAB directory.
- 3.4 An approved source is “approved” when a professional engineer (i.e., Registered Design Professional) is properly licensed to transact engineering commerce. The regulatory authority governing approved sources is the state legislature via its professional engineering regulations.¹²
- 3.5 Testing and/or inspections conducted for this Duly Authenticated Report were performed by an ISO/IEC 17025 accredited testing laboratory, an ISO/IEC 17020 accredited inspection body, and/or a licensed Registered Design Professional (RDP).
- 3.5.1 The Center for Building Innovation (CBI) is ANAB¹³ ISO/IEC 17025 and ISO/IEC 17020 accredited.
- 3.6 The regulatory authority shall enforce¹⁴ the specific provisions of each legislatively adopted regulation. If there is a non-conformance, the specific regulatory section and language of the non-conformance shall be provided in writing¹⁵ stating the nonconformance and the path to its cure.
- 3.7 The regulatory authority shall accept Duly Authenticated Reports from an approved agency and/or an approved source with respect to the quality and manner of use of new materials or assemblies as provided for in regulations regarding the use of alternative materials, designs, or methods of construction.¹⁶
- 3.8 ANAB is an International Accreditation Forum (IAF) Multilateral Recognition Arrangement (MLA) signatory where recognition of certificates, validation, and verification statements issued by conformity assessment bodies accredited by all other signatories of the IAF MLA with the appropriate scope, shall be approved.¹⁷ Therefore, all ANAB ISO/IEC 17065 Duly Authenticated Reports are approval equivalent.¹⁸
- 3.9 Approval equity is a fundamental commercial and legal principle.¹⁹

4 Applicable Standards for the Listing; Regulations for the Regulatory Evaluation²⁰

4.1 Standards

- 4.1.1 *ANSI/AWC NDS: National Design Specification (NDS) for Wood Construction*
- 4.1.2 *ASCE/SEI 7: Minimum Design Loads and Associated Criteria for Buildings and Other Structures*
- 4.1.3 *ASTM A153: Standard Specification for Zinc Coating (Hot-Dip) on Iron and Steel Hardware*
- 4.1.4 *ASTM A510: Standard Specification for General Requirements for Wire Rods and Coarse Round Wire, Carbon Steel, and Alloy Steel*
- 4.1.5 *ASTM B117: Standard Practice for Operating Salt Spray (Fog) Apparatus*
- 4.1.6 *AWC TR 12: General Dowel Equations for Calculating Lateral Connection Values*

4.2 Regulations

- 4.2.1 *IBC – 15, 18, 21: International Building Code®*
- 4.2.2 *IRC – 15, 18, 21: International Residential Code®*



5 Listed²¹

- 5.1 A nationally recognized testing laboratory such as CBI, states that the materials, designs, methods of construction, and/or equipment have met nationally recognized standards and/or have been tested and found suitable for use in a specified manner.

6 Tabulated Properties Generated from Nationally Recognized Standards

- 6.1 HeadLOK fasteners are used to attach wall sheathing, furring and/or cladding to the wall framing through an intermediate layer of foam sheathing to provide resistance to transverse loads in conventional light-frame wood construction.
- 6.1.1 See **Table 2** for a prescriptive solution to fastener spacing requirements for various installation conditions.
- 6.2 HeadLOK fasteners are used to support the dead load of wall sheathing, furring and/or cladding when connected to the wall framing through an intermediate layer of foam sheathing.
- 6.2.1 See **Table 2** for fastening requirements for various siding weight and framing conditions.
- 6.3 *Design Procedure*
- 6.3.1 *Calculate the Fastener Spacing:*
- 6.3.1.1 *Step 1:* Determine the spacing between studs or framing members, either 16" or 24" o.c.
- 6.3.1.2 *Step 2:* Calculate the correct thickness of rigid foam, up to 4", needed to obtain the required insulation effect or R-value.
- 6.3.1.3 *Step 3:* Choose the furring or sheathing (substrate) material that the cladding will be affixed to:
- 6.3.1.3.1 Minimum $\frac{3}{4}$ " x $3\frac{1}{2}$ " wood or Wood Structural Panel (WSP) furring
- 6.3.1.3.2 Minimum $\frac{3}{8}$ " WSP sheathing
- 6.3.1.3.3 Ensure that the substrate allows for cladding connections that are compliant with the cladding manufacturer installation and connection instructions and meet the applicable building code.
- 6.3.1.4 *Step 4:* Determine the actual weight for the cladding materials being installed, per square foot, as given by the cladding manufacturer specifications.
- 6.3.1.4.1 Typical cladding weights are 1.3-psf for vinyl siding, 2.5-psf for cement board siding, 11-psf for Portland cement stucco and 25-psf for adhered masonry veneer; use actual weights for materials installed.
- 6.3.1.4.2 Wood furring may add up to 1-psf of additional weight; wood sheathing may add up to 1.5-psf, depending on thickness.
- 6.3.1.5 *Step 5:* Using these four values together, find the proper fastening pattern of between 6" and 24" o.c. using **Table 2**.



Table 2. Recommended Fastener Spacing for Various Thicknesses of Foam Sheathing, Stud Spacing, And Cladding Weight when Connected to Wood Studs Using HeadLOK Fasteners^{1,2,3,4,6,7,8,9}

Stud Spacing ¹	Foam Thickness (in)	Maximum Allowable Cladding Weight (psf) to be Supported ^{5,10}									
		10	15	20	25	30	10	15	20	25	30
		Fastener Spacing (in) When Using Minimum 3/4" x 3 1/2" Wood or WSP Furring					Fastener Spacing (in) When Using Minimum 3/8" WSP Sheathing				
16" o.c.	1.0	24 o.c.			16 o.c.		12 o.c.				
	1.5	24 o.c.		16 o.c.		12 o.c.	12 o.c.				
	2.0	24 o.c.	16 o.c.		12 o.c.	8 o.c.	12 o.c.			8 o.c.	
	3.0	24 o.c.	16 o.c.	12 o.c.	8 o.c.		12 o.c.		8 o.c.	6 o.c.	
	4.0	16 o.c.	12 o.c.	8 o.c.		6 o.c.	12 o.c.	8 o.c.		6 o.c.	N/A
24" o.c.	1.0	24 o.c.		16 o.c.	12 o.c.		12 o.c.			8 o.c.	
	1.5	16 o.c.		12 o.c.	8 o.c.		12 o.c.			8 o.c.	
	2.0	16 o.c.	12 o.c.	8 o.c.		6 o.c.	12 o.c.		8 o.c.	6 o.c.	
	3.0	16 o.c.	8 o.c.		6 o.c.	N/A	12 o.c.	8 o.c.	6 o.c.		N/A
	4.0	12 o.c.	8 o.c.	6 o.c.	N/A		8 o.c.	6 o.c.	N/A		

SI: 1 in = 25.4 mm, 1 psf = 0.0479 kN/m²

1. Wood framing (studs) shall be a minimum of 2" nominal thickness.
2. Wood framing and furring shall be minimum Spruce-Pine-Fir or any species with specific gravity, G, of 0.42 or greater.
3. Wood framing, furring, and sheathing shall be designed by others and shall be of adequate size, species and grade to resist design loads and requirements in accordance with the applicable building code.
4. Furring may be installed vertically or horizontally and shall be installed at the same on-center spacing as the studs. All fasteners shall be installed through the furring and into the studs with a minimum 2" of penetration. Alternately, where the furring is installed horizontally and where the required fastener spacing is 8" o.c. or 12" o.c., the furring may be installed at 16" o.c. or 24" o.c. respectively, provided two (2) fasteners are installed at stud location. Likewise, where the fastener spacing is 6" o.c., the furring may be installed horizontally at 12" o.c. and two (2) fasteners used at each stud. Where multiple fasteners are used, furring or sheathing (substrate) shall be of adequate size to provide proper edge, end and fastener spacing distances.
5. Maximum allowable cladding weight shall include weight of furring, sheathing, cladding and other supported materials.
6. Furring type and thickness shall be selected based on the cladding manufacturer installation requirements (i.e., required fastener penetration into furring).
7. When using horizontal furring, or where durability of the furring is a concern due to moisture between the cladding and the sheathing, consideration should be given to using preservative treated furring.
8. Tabulated solutions are limited to 4" maximum thickness of foam sheathing. Special design required for thicknesses of foam sheathing greater than 4". For cladding attachment over foam sheathing exceeding 4" thickness, a design professional should be consulted.
9. Foam plastic insulation shall be a minimum 15-psi compressive strength and shall be in conformance to ASTM C578 or ASTM C1289, as applicable.
10. For cladding system weights exceeding 30-psf, a design professional should be consulted.



6.3.2 Check for Wind Resistance:

6.3.2.1 *Step 1:* Using the information derived from *Step 1* through *Step 5* in **Section 6.3.1**, determine the allowable design wind pressure using HeadLOK fasteners from **Table 3**.

Table 3. Allowable Design Wind Pressure for Connections Using HeadLOK Fasteners^{1,3,4}

Furring or WSP Installation Condition	Min. 1x4 Wood Furring ² 16" o.c. studs				Min. 1x4 Wood Furring ² 24" o.c. studs				Min. 3/8" WSP ² 16" o.c. studs			Min. 3/8" WSP ² 24" o.c. studs		
HeadLOK Fastener Spacing in Furring or Sheathing (in)	24	16	12	8	24	16	12	8	12	8	6	12	8	6
Connection Allowable Design Wind Pressure (psf) ⁵	49	73	98	147	33	49	65	98	49	73	98	33	49	65

SI: 1 in = 25.4 mm, 1 psf = 0.0479 kN/m²

1. Wood framing and furring shall be minimum Spruce-Pine-Fir or any species with specific gravity, G, of 0.42 or greater.
2. Wood framing, furring and sheathing shall be designed by others and shall be of adequate size, species, and grade to resist design loads and requirements in accordance with the applicable building code.
3. Connection allowable design wind pressure applies to connection resistance only and shall meet or exceed design wind pressure.
4. Where required by the applicable building code, adequate resistance of connections and materials to seismic forces shall be provided based on local seismic ground motion hazard and the weight of the supported cladding system.
5. For use with the Allowable Stress Design load combinations of ASCE 7.

6.3.2.2 *Step 2:* Based on the design wind speed (105-150 mph) and wind exposure category (B-D) specific to your region, determine the design wind pressure to be resisted for your application from **Table 4**.

Table 4. Example of Components & Cladding Design Wind Loads^{1,2,3,4,5,7}

Exposure Category	Wind Speed (V_{ult}) (mph) / Exposure						
B	105	110	115	120	130	140	150
C	-	-	-	-	110	120	130
D	-	-	-	-	-	110	120
Design Negative Wind Pressure Load to be Resisted (psf) ⁶	15.9	17.5	19.1	20.8	24.4	29.1	34.5

SI: 1 in = 25.4 mm, 1 psf = 0.0479 kN/m²

1. Mean roof height shall not exceed 30' (measured vertically from grade plane to middle of roof slope),
 - a. Exp B: $K_z=0.70$
 - b. Exp C: $K_z=0.98$
 - c. Exp D: $K_z=1.16$
2. Refer to applicable building code for wind exposure descriptions (B = typical suburban/wooded terrain; C = open flat terrain; D = ocean/lake exposure).
3. Where topographic effects occur (i.e., wind speed up due to hilltop exposure), refer to the building code for wind load.
4. Tabulated wind pressures are from ASCE 7-22, for wall corner zones. For lesser values away from wall corners, refer to the building code.
5. Tabulated wind pressures assume 100% of wind load is resisted by the cladding/foam sheathing or furring/foam sheathing layer and are not otherwise distributed or shared with other wall assembly layers.
6. Wind pressures, W, are given as 0.6W as defined in ASCE 7-22 for comparison to the allowable Design Wind Pressure of the fasteners as shown in **Table 3**.
7. Topographic factor $K_{zt}=1.0$, Ground elevation factor $K_e=1.0$, Wind directionality factor $K_d=0.85$, Enclosed building $GC_p=0.18$.



6.3.2.3 *Step 3:* Verify that the allowable design wind pressure using HeadLOK fasteners (**Table 3**) meets or exceeds the design wind pressure for your project (**Table 4**).

6.3.3 *Design Example:*

Given

Foam Sheathing Thickness:	3"
Cladding Material:	Fiber cement lap siding
Cladding Weight from Manufacturer Data:	3-psf
Design Wind Speed/Exposure:	120 / Exp. B
Seismic Design Category:	B (exempt)
Wood Framing:	2x6 at 24" o.c.

Solution

- Step 1:* Choose the furring type and orientation that will be used. This example uses 1x4 (min.) wood furring in a vertical orientation over studs (**Figure 3**).
- Step 2:* Consult siding manufacturer data for siding weight (3-psf) and add 1-psf for furring. Total = 4-psf.
- Step 3:* Using **Table 2**, min. 1x4 wood furring at 24" o.c. attached to studs at 24" o.c. supporting up to 10-psf requires maximum 16" o.c. fastener spacing.
- Step 4:* From **Table 3**, the connection allowable design wind pressure resistance is 49-psf.
- Step 5:* Check the applicable building code to verify the wind pressure resistance required. **Table 4** gives an example of the IBC wind pressures (ASCE 7-22), and this example's connection resistance of 49-psf exceeds the required resistance of 34.5-psf for wind speeds of 150 mph in Exposure B, 130 mph in Exposure C and 120 mph in Exposure D.
- Step 6:* The required minimum length of HeadLOK fasteners is $\frac{3}{4}"$ (furring) + 3" (foam) + 2" (penetration) = $5\frac{3}{4}"$. Select a 6" HeadLOK fastener.

Notes:

1. Add length for thickness of additional sheathing material layer behind foam, if included.
2. Verify that furring provides adequate thickness for siding fastener per code or siding manufacturer installation instructions, or specify an appropriate siding fastener for use in $\frac{3}{4}"$ thick furring.
3. Verify that furring is adequate to resist the required design loads.

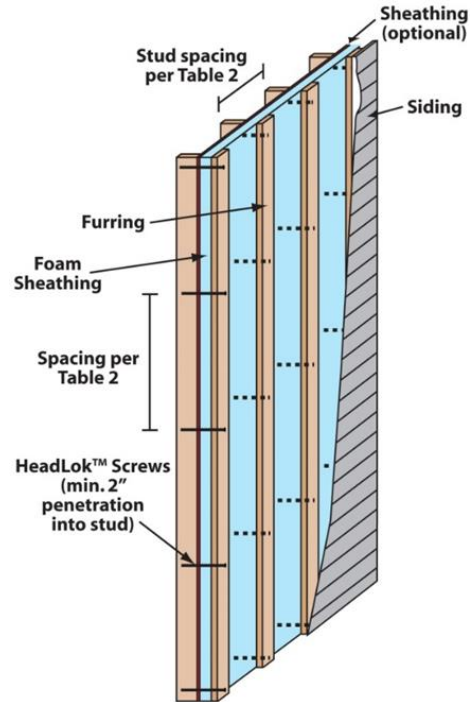


Figure 3. Exterior Wall Covering Assembly with Vertically Oriented Furring

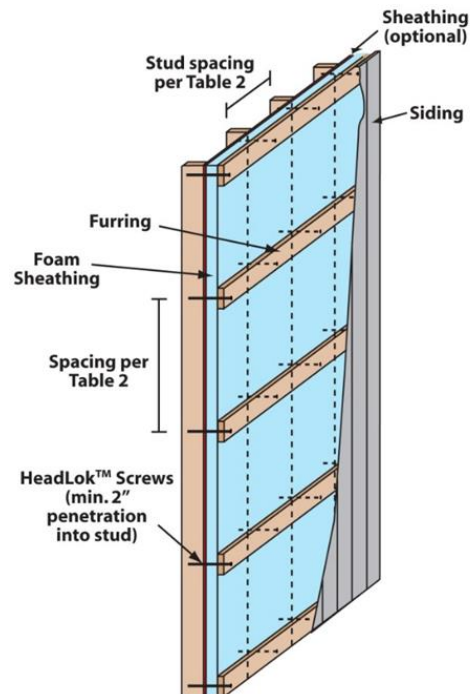


Figure 4. Exterior Wall Covering Assembly with Horizontally Oriented Furring



- 6.4 Where the application falls outside of the performance evaluation, conditions of use and/or installation requirements set forth herein, alternative techniques shall be permitted in accordance with accepted engineering practice and experience. This includes but is not limited to the following areas of engineering: mechanics or materials, structural, building science, and fire science.

7 Certified Performance²²

- 7.1 All construction methods shall conform to accepted engineering practices to ensure durable, livable, and safe construction and shall demonstrate acceptable workmanship reflecting journeyman quality of work of the various trades.²³
- 7.2 The strength and rigidity of the component parts and/or the integrated structure shall be determined by engineering analysis or by suitable load tests to simulate the actual loads and conditions of application that occur.²⁴

8 Regulatory Evaluation and Accepted Engineering Practice

- 8.1 HeadLOK fasteners comply with the following legislatively adopted regulations and/or accepted engineering practice for the following reasons:
- 8.1.1 HeadLOK fasteners were evaluated, using their tested allowable design values described below, as an alternate means of attaching cladding systems over exterior mounted rigid foam insulation. The following properties were evaluated:
- 8.1.1.1 Dowel bending strength of HeadLOK fasteners for use as an alternative to wood screws or lag screws in shear, where the fasteners are applied horizontally and the load is applied vertically.
- 8.1.1.2 Withdrawal strength of HeadLOK fasteners for use as an alternative to wood screws or lag screws in tension where the fasteners are applied horizontally and the load is applied vertically causing the fastener to pull out.
- 8.1.1.3 Head pull through strength of HeadLOK fasteners for use as an alternative to wood screws or lag screws in tension where the fasteners are applied horizontally and the load is applied vertically causing the fastener head to pull through.
- 8.1.1.4 Shear strength of the HeadLOK fasteners for use as an alternative to wood screws or lag screws in shear where the fasteners are applied horizontally and the load is applied vertically either parallel or perpendicular to wood grain.
- 8.1.1.5 Corrosion resistance in accordance with ASTM B117 (modified with freshwater instead of saltwater exposure) for use as an alternative to fasteners and connectors prescribed in IBC Section 2304.10.6²⁵ and IRC Section R317.3.
- 8.2 Any building code, regulation, and/or accepted engineering evaluations (i.e., research reports, duly authenticated reports, etc.) that are conducted for this Listing were performed by DrJ Engineering, LLC (DrJ), an ISO/IEC 17065 accredited certification body and a professional engineering company operated by RDP/approved sources. DrJ is qualified²⁶ to practice product and regulatory compliance services within its scope of accreditation and engineering expertise, respectively.
- 8.3 Engineering evaluations are conducted with DrJ's ANAB accredited ICS code scope of expertise, which are also its areas of professional engineering competence.
- 8.4 Any regulation specific issues not addressed in this section are outside the scope of this report.



9 Installation

- 9.1 Installation shall comply with the approved construction documents, the manufacturer installation instructions, this report, and the applicable building code.
- 9.2 In the event of a conflict between the manufacturer installation instructions and this report, the more restrictive shall govern.
- 9.3 *Installation Procedure*
 - 9.3.1 Add up the total thickness of furring, rigid insulation and sheathing, and then select the appropriate length of HeadLOK fastener (see **Table 1**) that will attach these combined materials and provide a minimum 2" penetration into the wood framing.
 - 9.3.2 Using a high torque 1/2" drill, drive the HeadLOK fastener through the center of the furring strip and into the insulation and wall framing.
 - 9.3.2.1 Lead holes are not required, but may be used if wood is prone to splitting.
 - 9.3.2.2 Lead holes shall be bored in accordance with Section 12.1 of the NDS.
 - 9.3.3 Fasteners should be aligned perpendicular to the face of the wall stud so that the point engages the center of the wall stud and at a minimum distance of 3" from the end of the stud or furring material.
 - 9.3.4 Fasteners must be installed in a manner to avoid over-driving yet snug enough to remove any gaps between the layers of materials being fastened.
 - 9.3.5 **Figure 3** and **Figure 4** provide example graphics of two types of furring installations as a guide.
- 9.4 Install fasteners prior to utility installations in exterior walls to avoid accidental penetration of utilities (i.e., electrical wiring, plumbing, etc.).

10 Substantiating Data

- 10.1 Testing has been performed under the supervision of a professional engineer and/or under the requirements of ISO/IEC 17025 as follows:
 - 10.1.1 HeadLOK fastener design property calculations for HeadLOK screws based on TR 12, NDS and NYSEDA reports; Crandell
 - 10.1.2 HeadLOK fastener performance from the FastenMaster Technical Bulletin for HeadLOK fasteners
 - 10.1.3 FastenMaster installation instructions for HeadLOK fasteners
 - 10.1.4 Cladding Attachment Over Thick Exterior Insulating Sheathing; P. Baker, P. Eng, and R. Lepage, Building Science Corporation
 - 10.1.5 Initial and Long-Term Movement of Cladding Installed Over Exterior Rigid Insulation; Peter Baker; Building Science Corporation
 - 10.1.6 Corrosion resistance performance from an approved source
- 10.2 Information contained herein may include the result of testing and/or data analysis by sources that are approved agencies, approved sources, and/or RDPs. Accuracy of external test data and resulting analysis is relied upon.
- 10.3 Where pertinent, testing and/or engineering analysis are based upon provisions that have been codified into law through state or local adoption of regulations and standards. The developers of these regulations and standards are responsible for the reliability of published content. DrJ's engineering practice may use a regulation-adopted provision as the control. A regulation-endorsed control versus a simulation of the conditions of application to occur establishes a new material as being equivalent to the regulatory provision in terms of quality, strength, effectiveness, fire resistance, durability, and safety.



- 10.4 The accuracy of the provisions provided herein may be reliant upon the published properties of raw materials, which are defined by the grade mark, grade stamp, mill certificate, or Duly Authenticated Reports from approved agencies and/or approved sources provided by the supplier. These are presumed to be minimum properties and relied upon to be accurate. The reliability of DrJ's engineering practice, as contained in this Duly Authenticated Report, may be dependent upon published design properties by others.
- 10.5 Testing and engineering analysis: The strength, rigidity, and/or general performance of component parts and/or the integrated structure are determined by suitable tests that simulate the actual conditions of application that occur and/or by accepted engineering practice and experience.²⁷
- 10.6 Where additional condition of use and/or regulatory compliance information is required, please search for HeadLOK on the DrJ Certification website.

11 Findings

- 11.1 As outlined in **Section 6**, HeadLOK fasteners have performance characteristics that were tested and/or meet applicable regulations and are suitable for use pursuant to its specified purpose.
- 11.2 When used and installed in accordance with this duly authenticated report and the manufacturer installation instructions, HeadLOK fasteners shall be approved for the following applications:
- 11.2.1 Use as an alternative material, design and method of construction for the attachment of furring, sheathing or cladding over foam sheathing and into wood framing.
 - 11.2.2 Use per the listed editions of the IRC for positive and negative wind pressure resistance.
 - 11.2.3 Use per the listed editions of the IRC for lateral shear strength to support cladding materials installed over foam sheathing.
 - 11.2.4 Use per the listed editions of the IBC for positive and negative wind pressure resistance.
 - 11.2.5 Use per the listed editions of the IBC for lateral shear strength to support cladding materials installed over foam sheathing.
 - 11.2.6 Pressure-treated (ACQ) lumber, provided the conditions set forth by the pressure-treated lumber manufacturer are met, including appropriate strength reductions.
 - 11.2.7 Fire-retardant treated lumber, provided the conditions set forth by the fire-retardant treated lumber manufacturer are met, including appropriate strength reductions.
 - 11.2.8 Areas with exposure to freshwater.
 - 11.2.8.1 Allowable loads shall be adjusted with the Wet service factor, C_M , where applicable.
- 11.3 Unless exempt by state statute, when HeadLOK fasteners are to be used as a structural and/or building envelope component in the design of a specific building, the design shall be performed by an RDP.
- 11.4 Any application specific issues not addressed herein can be engineered by an RDP. Assistance with engineering is available from OMG®, Inc. dba FastenMaster®.
- 11.5 IBC Section 104.11 (IRC Section R104.11 and IFC Section 104.10²⁸ are similar) in pertinent part states:

104.11 Alternative materials, design and methods of construction and equipment. The provisions of this code are not intended to prevent the installation of any material or to prohibit any design or method of construction not specifically prescribed by this code. Where the alternative material, design or method of construction is not approved, the building official shall respond in writing, stating the reasons the alternative was not approved.



- 11.6 **Approved:**²⁹ Building regulations require that the building official shall accept Duly Authenticated Reports.³⁰
- 11.6.1 An approved agency is “approved” when it is ANAB ISO/IEC 17065 accredited.
- 11.6.2 An approved source is “approved” when an RDP is properly licensed to transact engineering commerce.
- 11.6.3 Federal law, Title 18 US Code Section 242, requires that where the alternative product, material, service, design, assembly, and/or method of construction is not approved, the building official shall respond in writing, stating the reasons why the alternative was not approved. Denial without written reason deprives a protected right to free and fair competition in the marketplace.
- 11.7 DrJ is a licensed engineering company, employs licensed RDPs and is an ANAB-Accredited Product Certification Body – Accreditation #1131.
- 11.8 Through the IAF Multilateral Agreements (MLA), this Duly Authenticated Report can be used to obtain product approval in any jurisdiction or country because all ANAB ISO/IEC 17065 Duly Authenticated Reports are equivalent.³¹

12 Conditions of Use

- 12.1 Material properties shall not fall outside the boundaries defined in **Section 6**.
- 12.2 As defined in **Section 6**, where material and/or engineering mechanics properties are created for load resisting design purposes, the resistance to the applied load shall not exceed the ability of the defined properties to resist those loads using the principles of accepted engineering practice.
- 12.3 HeadLOK fasteners covered by this report shall be installed in accordance with this report and the manufacturer installation instructions.
- 12.4 As listed herein, HeadLOK fasteners shall be subjected to the following conditions:
- 12.4.1 HeadLOK fastener spacing shall not exceed **Table 2** for the installation conditions considered.
- 12.4.1.1 Foam sheathing shall be minimum Type II (expanded polystyrene) or Type X (extruded polystyrene) conforming to ASTM C578 or Type 1 (polyiso) conforming to ASTM C1289.
- 12.4.1.2 Types with greater compressive strength are acceptable.
- 12.4.1.3 Ensure furring or sheathing material provides adequate substrate and thickness for the application of the siding fastener per the code requirements for siding application and the siding manufacturer installation instructions.
- 12.4.1.3.1 For example, if the siding manufacturer requires the fastener for the siding to penetrate more than $\frac{3}{4}$ " into the furring, a 1x 4 furring strip (actual dimension of $\frac{3}{4}$ " x $3\frac{1}{2}$ ") would not be adequate and a thicker furring strip, such as a 2x4, would be required.
- 12.5 Use of HeadLOK fasteners to connect bracing materials in braced wall panels or shear walls is outside the scope of this report.
- 12.6 Use of HeadLOK fasteners shall be limited to dry service conditions in treated or untreated wood.
- 12.6.1 Exposure to freshwater water is permitted. Wet service factor shall be applied to the listed allowable values in **Section 6** as applicable.
- 12.6.2 Use of HeadLOK fasteners in environments with the possibility of exposure to saltwater is outside the scope of this report.
- 12.7 For conditions not covered in this report, connections shall be designed in accordance with accepted engineering practice.
- 12.8 When required by adopted legislation and enforced by the building official, also known as the authority having jurisdiction (AHJ) in which the project is to be constructed:



- 12.8.1 Any calculations incorporated into the construction documents shall conform to accepted engineering practice and, when prepared by an approved source, shall be approved when signed and sealed.
- 12.8.2 This report and the installation instructions shall be submitted at the time of permit application.
- 12.8.3 This innovative product has an internal quality control program and a third-party quality assurance program.
- 12.8.4 At a minimum, this innovative product shall be installed per **Section 9** of this report.
- 12.8.5 The review of this report by the AHJ shall comply with IBC Section 104 and IBC Section 105.4.
- 12.8.6 This innovative product has an internal quality control program and a third party quality assurance program in accordance with IBC Section 104.4, IBC Section 110.4, IBC Section 1703, IRC Section R104.4, and IRC Section R109.2.
- 12.8.7 The application of this innovative product in the context of this report is dependent upon the accuracy of the construction documents, implementation of installation instructions, inspection as required by IBC Section 110.3, IRC Section R109.2, and any other regulatory requirements that may apply.
- 12.9 The approval of this report by the AHJ shall comply with IBC Section 1707.1, where legislation states in part, *"the building official shall accept duly authenticated reports from approved agencies in respect to the quality and manner of use of new material or assemblies as provided for in Section 104.11,"* all of IBC Section 104, and IBC Section 105.4.
- 12.10 Design loads shall be determined in accordance with the regulations adopted by the jurisdiction in which the project is to be constructed and/or by the building designer (i.e., owner or RDP).
- 12.11 The actual design, suitability, and use of this report for any particular building, is the responsibility of the owner or the authorized agent of the owner.

13 Identification

- 13.1 The innovative product listed in **Section 1.1** is identified by a label on the board or packaging material bearing the manufacturer name, product name, this report number, and other information to confirm code compliance.
- 13.2 Additional technical information can be found at www.fastenmaster.com.

14 Review Schedule

- 14.1 This report is subject to periodic review and revision. For the latest version, visit drjcertification.org.
- 14.2 For information on the status of this report, please contact [DrJ Certification](#).

15 Approved for Use Pursuant to U.S. and International Legislation Defined in Appendix A

- 15.1 FastenMaster HeadLOK Heavy Duty Flat Head Fasteners are included in this report published by an approved agency that is concerned with evaluation of products or services, maintains periodic inspection of the production of listed materials or periodic evaluation of services. This report states either that the material, product, or service meets recognized standards or has been tested and found suitable for a specified purpose. This report meets the legislative intent and definition of being acceptable to the AHJ.



Appendix A

1 Legislation that Authorizes AHJ Approval

- 1.1 **Fair Competition:** State legislatures have adopted Federal regulations for the examination and approval of building code referenced and alternative products, materials, designs, services, assemblies, and/or methods of construction that:
 - 1.1.1 Advance innovation,
 - 1.1.2 Promote competition so all businesses have the opportunity to compete on price and quality in an open market on a level playing field unhampered by anticompetitive constraints, and
 - 1.1.3 Benefit consumers through lower prices, better quality, and greater choice.
- 1.2 **Adopted Legislation:** The following local, state, and federal regulations affirmatively authorize this innovative product to be approved by AHJs, delegates of building departments, and/or delegates of an agency of the federal government:
 - 1.2.1 Interstate commerce is governed by the Federal Department of Justice to encourage the use of innovative products, materials, designs, services, assemblies, and/or methods of construction. The goal is to “*protect economic freedom and opportunity by promoting free and fair competition in the marketplace.*”
 - 1.2.2 Title 18 US Code Section 242 affirms and regulates the right of individuals and businesses to freely and fairly have new products, materials, designs, services, assemblies, and/or methods of construction approved for use in commerce. Disapproval of alternatives shall be based upon non-conformance with respect to specific provisions of adopted legislation and shall be provided in writing stating the reasons why the alternative was not approved, with reference to the specific legislation violated.
 - 1.2.3 The federal government and each state have a public records act. In addition, each state also has legislation that mimics the federal Defend Trade Secrets Act 2016 (DTSA),³² where providing test reports, engineering analysis and/or other related IP/TS is subject to prison of not more than ten years³³ and/or a \$5,000,000 fine or 3 times the value of³⁴ the Intellectual Property (IP) and Trade Secrets (TS).
 - 1.2.3.1 Compliance with public records and trade secret legislation requires approval through the use of Listings, certified reports, Technical Evaluation Reports, duly authenticated reports, and/or research reports prepared by approved agencies and/or approved sources.
 - 1.2.4 For new materials³⁵ that are not specifically provided for in any regulation, the design strengths and permissible stresses shall be established by tests, where suitable load tests simulate the actual loads and conditions of application that occur.
 - 1.2.5 The design strengths and permissible stresses of any structural material shall conform to the specifications and methods of design using accepted engineering practice.³⁶
 - 1.2.6 The commerce of approved sources (i.e., registered PEs) is regulated by professional engineering legislation. Professional engineering commerce shall always be approved by AHJs, except where there is evidence provided in writing, that specific legislation have been violated by an individual registered PE.
 - 1.2.7 The AHJ shall accept Duly Authenticated Reports from approved agencies in respect to the quality and manner of use of new materials or assemblies as provided for in IBC Section 104.11.³⁷



- 1.3 **Approved³⁸ by Los Angeles:** The Los Angeles Municipal Code (LAMC) states in pertinent part that the provisions of LAMC are not intended to prevent the use of any material, device, or method of construction not specifically prescribed by LAMC. The Department shall use Part III, Recognized Standards in addition to Part II, Uniform Building Code Standards of Division 35, Article 1, Chapter IX of the LAMC in evaluation of products for approval where such standard exists for the product or the material and may use other approved standards that apply. Whenever tests or certificates of any material or fabricated assembly are required by Chapter IX of the LAMC, such tests or certification shall be made by a testing agency approved by the Superintendent of Building to conduct such tests or provide such certifications. The testing agency shall publish the scope and limitation(s) of the listed material or fabricated assembly.³⁹ The Superintendent of Building Approved Testing Agency Roster is provided by the Los Angeles Department of Building and Safety (LADBS). The Center for Building Innovation (CBI) Certificate of Approval License is TA24945. Tests and certifications found in a DrJ Listing are LAMC approved. In addition, the Superintendent of Building shall accept Duly Authenticated Reports from approved agencies in respect to the quality and manner of use of new materials or assemblies as provided for in the California Building Code (CBC) Section 1707.1.⁴⁰
- 1.4 **Approved by Chicago:** The Municipal Code of Chicago (MCC) states in pertinent part that an Approved Agency is a Nationally Recognized Testing Laboratory (NRTL) acting within its recognized scope and/or a certification body accredited by the American National Standards Institute (ANSI) acting within its accredited scope. Construction materials and test procedures shall conform to the applicable standards listed in the MCC. Sufficient technical data shall be submitted to the building official to substantiate the proposed use of any product, material, service, design, assembly, and/or method of construction not specifically provided for in the MCC. This technical data shall consist of research reports from approved sources (i.e., MCC defined Approved Agencies).
- 1.5 **Approved by New York City:** The 2022 NYC Building Code (NYCBC) states in part that an approved agency shall be deemed⁴¹ an approved testing agency via ISO/IEC 17025 accreditation, an approved inspection agency via ISO/IEC 17020 accreditation, and an approved product evaluation agency via ISO/IEC 17065 accreditation. Accrediting agencies, other than federal agencies, must be members of an internationally recognized cooperation of laboratory and inspection accreditation bodies subject to a mutual recognition agreement⁴² (i.e., ANAB, International Accreditation Forum [IAF], etc.).
- 1.6 **Approved by Florida:** Statewide approval of products, methods, or systems of construction shall be approved, without further evaluation by:
- 1.6.1 A certification mark or listing of an approved certification agency,
 - 1.6.2 A test report from an approved testing laboratory,
 - 1.6.3 A product evaluation report based upon testing or comparative or rational analysis, or a combination thereof, from an approved product evaluation entity, or
 - 1.6.4 A product evaluation report based upon testing, comparative or rational analysis, or a combination thereof, developed, signed and sealed by a professional engineer or architect, licensed in Florida.
 - 1.6.5 For local product approval, products or systems of construction shall demonstrate compliance with the structural wind load requirements of the Florida Building Code (FBC) through one of the following methods:
 - 1.6.5.1 A certification mark, listing or label from a commission-approved certification agency indicating that the product complies with the code,
 - 1.6.5.2 A test report from a commission-approved testing laboratory indicating that the product tested complies with the code,
 - 1.6.5.3 A product-evaluation report based upon testing, comparative or rational analysis, or a combination thereof, from a commission-approved product evaluation entity which indicates that the product evaluated complies with the code,



- 1.6.5.4 A product-evaluation report or certification based upon testing or comparative or rational analysis, or a combination thereof, developed and signed and sealed by a Florida professional engineer or Florida registered architect, which indicates that the product complies with the code, or
- 1.6.5.5 A statewide product approval issued by the Florida Building Commission.
- 1.6.6 The [Florida Department of Business and Professional Regulation \(DBPR\)](#) website provides a listing of companies certified as a [Product Evaluation Agency](#) (i.e., EVLMiami 13692), a [Product Certification Agency](#) (i.e., CER10642), and as a [Florida Registered Engineer](#) (i.e., ANE13741).
- 1.7 **Approved by Miami-Dade County (i.e., Notice of Acceptance [NOA]):** A Florida statewide approval is an NOA. An NOA is a Florida local product approval. By Florida law, Miami-Dade County shall accept the statewide and local Florida Product Approval as provided for in Florida legislation [553.842](#) and [553.8425](#).
- 1.8 **Approved by New Jersey:** Pursuant to the 2018 Building Code of New Jersey in [IBC Section 1707.1 General](#),⁴³ it states: “*In the absence of approved rules or other approved standards, the building official shall accept duly authenticated reports from [approved agencies](#) in respect to the quality and manner of use of new materials or assemblies as provided for in the administrative provisions of the Uniform Construction Code (N.J.A.C. 5:23)*”.⁴⁴ Furthermore N.J.A.C 5:23-3.7 states: “*Municipal approvals of alternative materials, equipment, or methods of construction.*”
- 1.8.1 **Approvals:** Alternative materials, equipment, or methods of construction shall be approved by the appropriate subcode official provided the proposed design is satisfactory and that the materials, equipment, or methods of construction are suitable for the intended use and are at least the equivalent in quality, strength, effectiveness, fire resistance, durability, and safety of those conforming with the requirements of the regulations.
- 1.8.1.1 A field evaluation label and report or letter issued by a nationally recognized testing laboratory verifying that the specific material, equipment, or method of construction meets the identified standards or has been tested and found to be suitable for the intended use, shall be accepted by the appropriate subcode official as meeting the requirements of the above.
- 1.8.1.2 Reports of engineering findings issued by nationally recognized evaluation service programs such as but not limited to, the Building Officials and Code Administrators (BOCA), the International Conference of Building Officials (ICBO), the Southern Building Code Congress International (SBCCI), the International Code Council (ICC), and the National Evaluation Service, Inc., shall be accepted by the appropriate subcode official as meeting the requirements of the above.
- 1.8.2 The [New Jersey Department of Community Affairs](#) has confirmed that technical evaluation reports, from any accredited entity listed by [ANAB](#), meets the requirements of item the previous paragraph, given that the listed entities are no longer in existence and/or do not provide “*reports of engineering findings.*”
- 1.9 **Approved by the Code of Federal Regulations Manufactured Home Construction and Safety Standards:** Pursuant to Title 24, Subtitle B, Chapter XX, [Part 3282.14](#)⁴⁵ and [Part 3280](#),⁴⁶ the Department encourages innovation and the use of new technology in manufactured homes. The design and construction of a manufactured home shall conform to the provisions of Part 3282 and Part 3280 where key approval provisions in mandatory language follow:
- 1.9.1 “*All construction methods shall be in conformance with accepted engineering practices.*”
- 1.9.2 “*The strength and rigidity of the component parts and/or the integrated structure shall be determined by engineering analysis or by suitable load tests to simulate the actual loads and conditions of application that occur.*”
- 1.9.3 “*The design stresses of all materials shall conform to accepted engineering practice.*”



- 1.10 Approval by US, Local and State Jurisdictions in General:** In all other local and state jurisdictions, the adopted building code legislation states in pertinent part that:
- 1.10.1 For new materials that are not specifically provided for in this code, the design strengths and permissible stresses shall be established by tests.⁴⁷
 - 1.10.2 For innovative alternatives and/or methods of construction, the building official shall accept Duly Authenticated Reports from approved agencies with respect to the quality and manner of use of new materials or assemblies.⁴⁸
 - 1.10.2.1 An approved agency is “approved” when it is ANAB ISO/IEC 17065 accredited. DrJ Engineering, LLC (DrJ) is in the ANAB directory.
 - 1.10.2.2 An approved source is “approved” when an RDP is properly licensed to transact engineering commerce. The regulatory authority governing approved sources is the state legislature via its professional engineering regulations.⁴⁹
 - 1.10.3 The design strengths and permissible stresses of any structural material...shall conform to the specifications and methods of design of accepted engineering practice performed by an approved source.⁵⁰
- 1.11 Approval by International Jurisdictions:** The USMCA and GATT agreements provide for approval of innovative materials, designs, services, and/or methods of construction through the Agreement on Technical Barriers to Trade and the IAF Multilateral Recognition Arrangement (MLA), where these agreements:
- 1.11.1 State that conformity assessment procedures (i.e., ISO/IEC 17020, 17025, 17065, etc.) are prepared, adopted, and applied so as to grant access for suppliers of like products originating in the territories of other Members under conditions no less favourable than those accorded to suppliers of like products of national origin or originating in any other country, in a comparable situation.
 - 1.11.2 **Approved:** The purpose of the MLA is to ensure mutual recognition of accredited certification and validation/verification statements between signatories to the MLA and subsequently, acceptance of accredited certification and validation/verification statements in many markets based on one accreditation for the timely approval of innovative materials, designs, services, and/or methods of construction.
 - 1.11.3 ANAB is an IAF-MLA signatory where recognition of certificates, validation, and verification statements issued by conformity assessment bodies accredited by all other signatories of the IAF MLA, with the appropriate scope, shall be approved.⁵¹
 - 1.11.4 Therefore, all ANAB ISO/IEC 17065 Duly Authenticated Reports are approval equivalent.⁵²
- 1.12 Approval equity is a fundamental commercial and legal principle.⁵³



Notes

- 1 For more information, visit drjcertification.org or call us at 608-310-6748.
- 2 [2018 IBC Section 2304.10.5](#)
- 3 <https://up.codes/viewer/wyoming/ibc-2021/chapter/17/special-inspections-and-tests#1702>
- 4 Alternative Materials, Design and Methods of Construction and Equipment: The provisions of any regulation code are not intended to prevent the installation of any material or to prohibit any design or method of construction not specifically prescribed by a regulation. Please review <https://www.justice.gov/atr/mission> and <https://up.codes/viewer/colorado/ibc-2021/chapter/1/scope-and-administration#104.11>
- 5 <https://up.codes/viewer/wyoming/ibc-2021/chapter/17/special-inspections-and-tests#1706>:-:text=the%20design%20strengths%20and%20permissible%20stresses%20shall%20be%20established%20by%20tests%20as
- 6 The design strengths and permissible stresses of any structural material shall conform to the specifications and methods of design of accepted engineering practice. <https://up.codes/viewer/wyoming/ibc-2021/chapter/17/special-inspections-and-tests#1706>:-:text=shall%20conform%20to%20the%20specifications%20and%20methods%20of%20design%20of%20accepted%20engineering%20practice
- 7 <https://up.codes/viewer/wyoming/ibc-2021/chapter/17/special-inspections-and-tests#1707>:-:text=the%20building%20official%20shall%20accept%20duly%20authenticated%20reports%20from%20approved%20agencies
- 8 <https://up.codes/viewer/wyoming/ibc-2021/chapter/17/special-inspections-and-tests#1703.4.2>
- 9 https://up.codes/viewer/wyoming/ibc-2021/chapter/2/definitions#approved_agency
- 10 https://up.codes/viewer/wyoming/ibc-2021/chapter/2/definitions#approved_source
- 11 <https://www.law.cornell.edu/uscode/text/18/1832> (b) Any organization that commits any offense described in subsection (a) shall be fined not more than the greater of \$5,000,000 or 3 times the value of the stolen trade secret to the organization, including expenses for research and design and other costs of reproducing the trade secret that the organization has thereby avoided. The federal government and each state have a public records act. To follow DTSA and comply state public records and trade secret legislation requires approval through ANAB ISO/IEC 17065 accredited certification bodies or approved sources. For more information, please review this website: [Intellectual Property and Trade Secrets](#).
- 12 <https://www.nspe.org/resources/issues-and-advocacy/professional-policies-and-position-statements/regulation-professional> AND <https://apassociation.org/list-of-engineering-boards-in-each-state-archive/>
- 13 <https://www.cbiteest.com/accreditation/>
- 14 <https://up.codes/viewer/colorado/ibc-2021/chapter/1/scope-and-administration#104>:-:text=to%20enforce%20the%20provisions%20of%20this%20code
- 15 <https://up.codes/viewer/colorado/ibc-2021/chapter/1/scope-and-administration#104.11>:-:text=Where%20the%20alternative%20material%2C%20design%20or%20method%20of%20construction%20is%20not%20approved%2C%20the%20building%20official%20shall%20respond%20in%20writing%2C%20stating%20the%20reasons%20why%20the%20alternative%20was%20not%20approved AND <https://up.codes/viewer/colorado/ibc-2021/chapter/1/scope-and-administration#105.3.1>:-:text=If%20the%20application%20or%20the%20construction%20documents%20do%20not%20conform%20to%20the%20requirements%20of%20pertinent%20laws%2C%20the%20building%20official%20shall%20reject%20such%20application%20in%20writing%2C%20stating%20the%20reasons%20therefore
- 16 <https://up.codes/viewer/colorado/ibc-2021/chapter/17/special-inspections-and-tests#1707>:-:text=the%20building%20official%20shall%20accept%20duly%20authenticated%20reports%20from%20approved%20agencies%20in%20respect%20to%20the%20quality%20and%20manner%20of%20use%20of%20new%20materials%20or%20assemblies%20as%20provided%20for%20in%20Section%20104.11
- 17 <https://iaf.nu/en/about-iaf-mia/#>:-:text=it%20is%20required%20to%20recognise%20certificates%20and%20validation%20and%20verification%20statements%20issued%20by%20conformity%20assessment%20bodies%20accredited%20by%20all%20other%20signatories%20of%20the%20IAF%20MLA%2C%20with%20the%20appropriate%20scope
- 18 True for all ANAB accredited product evaluation agencies and all International Trade Agreements.
- 19 <https://www.justice.gov/crt/deprivation-rights-under-color-law> AND <https://www.justice.gov/atr/mission>
- 20 Unless otherwise noted, all references in this Listing are from the 2021 version of the codes and the standards referenced therein. This material, product, design, service and/or method of construction also complies with the 2000-2021 versions of the referenced codes and the standards referenced therein.
- 21 <https://www.ecfr.gov/current/title-24/subtitle-B/chapter-XX/part-3280#p-3280.2>(Listed%20or%20certified); <https://up.codes/viewer/colorado/ibc-2021/chapter/2/definitions#labeled>
- 22 <https://up.codes/viewer/colorado/ibc-2021/chapter/17/special-inspections-and-tests#1703.4>
- 23 <https://www.ecfr.gov/current/title-24/subtitle-B/chapter-XX/part-3280#>:-:text=All%20construction%20methods%20shall%20be%20in%20conformance%20with%20accepted%20engineering%20practices%20to%20insure%20durable%2C%20livable%2C%20and%20safe%20housing%20and%20shall%20demonstrate%20acceptable%20workmanship%20reflecting%20journeyman%20quality%20of%20work%20of%20the%20various%20trades
- 24 <https://www.ecfr.gov/current/title-24/subtitle-B/chapter-XX/part-3280#>:-:text=The%20strength%20and%20rigidity%20of%20the%20component%20parts%20and/or%20the%20integrated%20structure%20shall%20be%20determined%20by%20engineering%20analysis%20or%20by%20suitable%20load%20tests%20to%20simulate%20the%20actual%20loads%20and%20conditions%20of%20application%20that%20occur
- 25 [2018 IBC Section 2304.10.5](#)
- 26 Qualification is performed by a legislatively defined Accreditation Body. ANSI National Accreditation Board (ANAB) is the largest independent accreditation body in North America and provides services in more than 75 countries. DrJ is an ANAB accredited product certification body.
- 27 See Code of Federal Regulations (CFR) Title 24 Subtitle B Chapter XX Part 3280 for definition.
- 28 [2018 IFC Section 104.9](#)



Approved is an adjective that modifies the noun after it. For example, Approved Agency means that the Agency is accepted officially as being suitable in a particular situation. This example conforms to IBC/IRC/IFC Section 201.4 where the building code authorizes sentences to have an ordinarily accepted meaning such as the context implies.

<https://up.codes/viewer/wyoming/ibc-2021/chapter/17/special-inspections-and-tests#1707.1>

Multilateral approval is true for all ANAB accredited product evaluation agencies and all International Trade Agreements.

<http://www.drjengineering.org/AppendixC> AND <https://www.drjcertification.org/comell-2016-protection-trade-secrets>

<https://www.law.comell.edu/uscode/text/18/1832#:~:text=imprisoned%20not%20more%20than%2010%20years>

<https://www.law.comell.edu/uscode/text/18/1832#:~:text=Any%20organization%20that,has%20thereby%20avoided>

<https://up.codes/viewer/wyoming/ibc-2021/chapter/17/special-inspections-and-tests#1706.2>

IBC 2021, Section 1706.1 Conformance to Standards

IBC 2021, Section 1707 Alternative Test Procedure, 1707.1 General

See Section 11 for the distilled building code definition of **Approved**

Los Angeles Municipal Code, SEC. 98.0503. TESTING AGENCIES

<https://up.codes/viewer/california/ca-building-code-2022/chapter/17/special-inspections-and-tests#1707.1>

New York City, The Rules of the City of New York, § 101-07 Approved Agencies

New York City, The Rules of the City of New York, § 101-07 Approved Agencies

https://up.codes/viewer/new_jersey/ibc-2018/chapter/17/special-inspections-and-tests#1707.1

<https://www.nj.gov/dca/divisions/codes/codereg/ucc.html>

<https://www.ecfr.gov/current/title-24/subtitle-B/chapter-XX/part-3282/subpart-A/section-3282.14>

<https://www.ecfr.gov/current/title-24/subtitle-B/chapter-XX/part-3280>

IBC 2021, Section 1706 Design Strengths of Materials, 1706.2 New Materials. Adopted law pursuant to IBC model code language 1706.2.

IBC 2021, Section 1707 Alternative Test Procedure, 1707.1 General. Adopted law pursuant to IBC model code language 1707.1.

<https://www.nspe.org/resources/issues-and-advocacy/professional-policies-and-position-statements/regulation-professional> AND <https://apassociation.org/list-of-engineering-boards-in-each-state-archive/>

IBC 2021, Section 1706 Design Strengths of Materials, Section 1706.1 Conformance to Standards Adopted law pursuant to IBC model code language 1706.1.

<https://iaf.nu/en/about-iaf-mla/#:~:text=it%20is%20required%20to%20recognise%20certificates%20and%20validation%20and%20verification%20statements%20issued%20by%20conformity%20assessment%20bodies%20accredited%20by%20all%20other%20signatories%20of%20the%20IAF%20MLA%2C%20with%20the%20appropriate%20scope>

True for all ANAB accredited product evaluation agencies and all International Trade Agreements.

<https://www.justice.gov/crt/deprivation-rights-under-color-law> AND <https://www.justice.gov/atr/mission>